

1. Suggested gas line locations are to clear substructures. Locate in the Field.
2. All pipeline construction shall conform to applicable jurisdiction specifications.
3. Gas mains shall be purged per the Operations Manual.
4. Do not scale this drawing.
5. Any changes in the Main location must be authorized by SWG Engineer.
6. Trenching and Pavement Replacement are to conform with RTC Standards.
7. Contact Engineering for bypass information.
8. All main tie-ins requiring tees are to be full-flow tees unless otherwise stated.
9. Request for surveying and/or staking will be submitted to Engineering 72 hours in advance, minimum.
10. City of Las Vegas permit required.
11. Clark County permit required.


1. PERMANENT REPAIR IN VEGAS DRIVE TO BE COMPLETED BY THE CITY OF LAS VEGAS PER THE VEGAS DRIVE IMPROVEMENTS PROJECT.
2. BACKFILL TO COMPLY WITH RTC STANDARD 503 WITH TYPE II OR SLURRY USED AS BACKFILL, NOT CRUSHED ROCK.

PURGE PLAN WAS COMPLETED IN ACCORDANCE
WITH THE OPERATIONS MANUAL GUIDELINES BY:

PRINT: _____ DATE: _____
SIGNATURE: _____

MATERIAL LIST				
ITEM#	QTY. (DESIGN)	QTY. (AS-BUILT)	STOCK ID#	DESCRIPTION
①	230'		100-1024	Pipe STL CTD X-52 4-1/2"ODX0.237"WT DRL NMDA
②	2		140-3309	Cap Steel Weld 4" STD WT Grade B 49 CFR NMDA (TESTING ONLY)
③				
④				
⑤				
⑥				

1	ABANDON & REMOVE 4" STL '68 MOP 120# MAOP 120#	230'
---	---	------

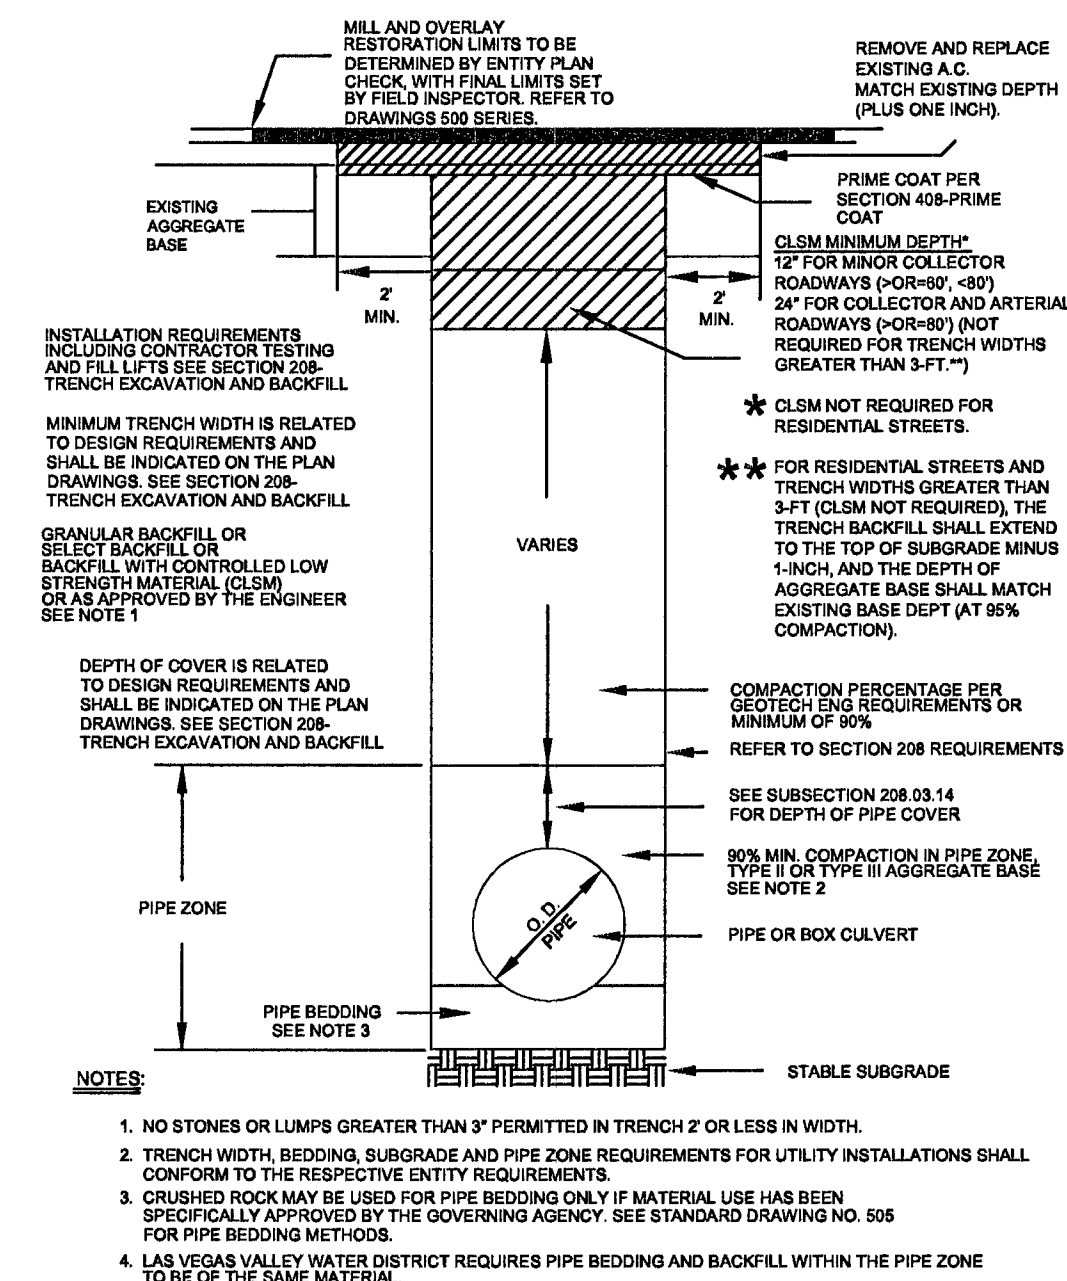

CPM Utility Plan Approval
 CPM Project Name Vegas Drive Improvements
 CPM Hansen # 11554 Date 5/15/14
 CPM Project Manager Lorrie Linnert, Durand x6738
 Approved by: Lorrie Linnert

PIPE TO SOIL _____

ANODE INSTALLED?

YES NO

☐ ☐

IF YES, PIPE TO SOIL _____

2 ☐ TAR WRAP
3 ☐ ASPHALT
4 ☐ PRITEC
6 ☐ FUSION BONDED EPOXY
8 ☐ PLASTIC TAPE WRAP
9 ☐ EXTRUDED POLY COATING
10 ☐ OTHER

E ☐ EXCELLENT
G ☐ GOOD
F ☐ FAIR
P ☐ POOR
N ☐ NO COATING

IF EXPOSED. EXTERNAL	IF CUT OR COUPON. INTERNAL
-------------------------	----------------------------------

EG	☐ GOOD	☐ IG
ESC	☐ SLIGHT CORROSION	☐ ISC
EHC	☐ HEAVY CORROSION	☐ IHC

Clark County Public Works
Development Review
APPROVED FOR PERMITTING

Night Work - Yes No

Encroachment Permit #

By: _____ Date: _____

1. CONTACT CP SUPERVISER AT (702) 365-2359 AND CP DEPARTMENT AT (702) 365-2388 AT LEAST 48 HOURS PRIOR TO COORDINATE INSTALLATION

CPID#: R-10 1-B

WMIS#: 21DCP0021139

AREA: VEGAS DR/MICHAEL

[illegible]