

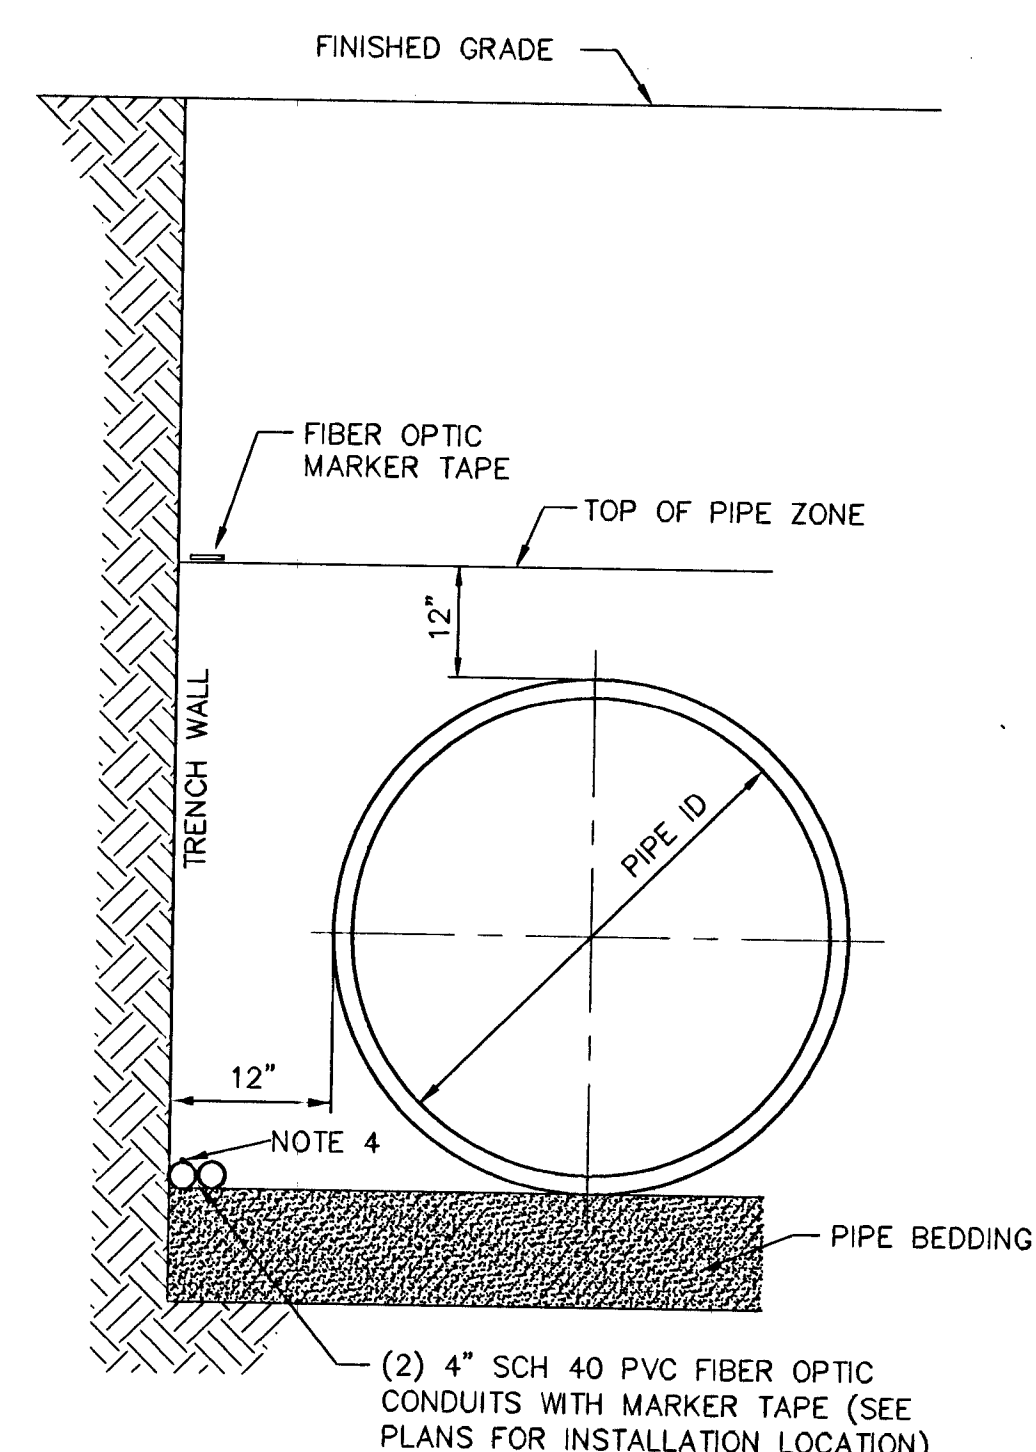
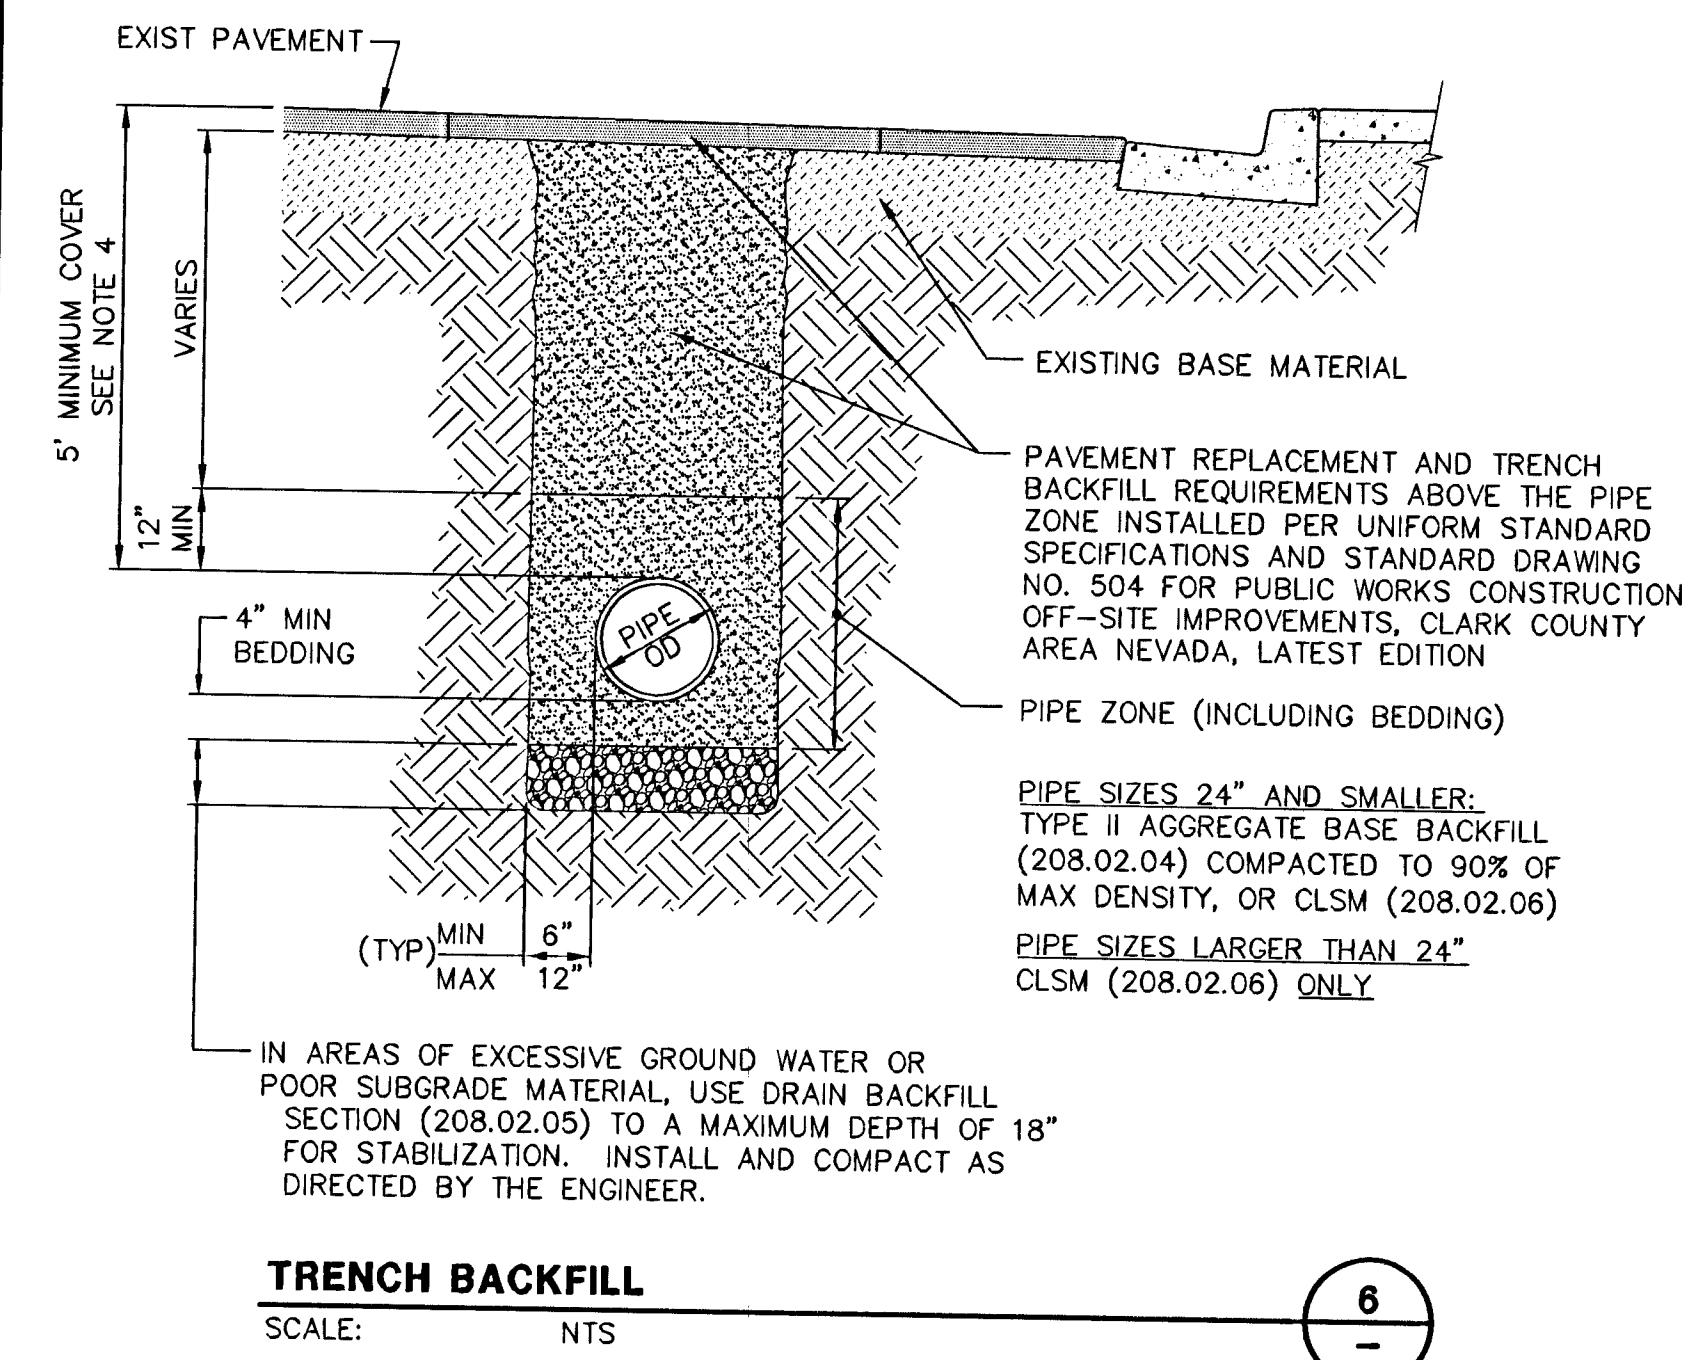
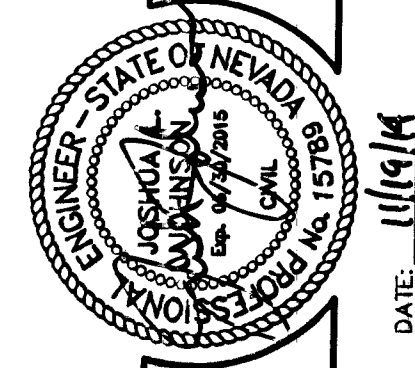
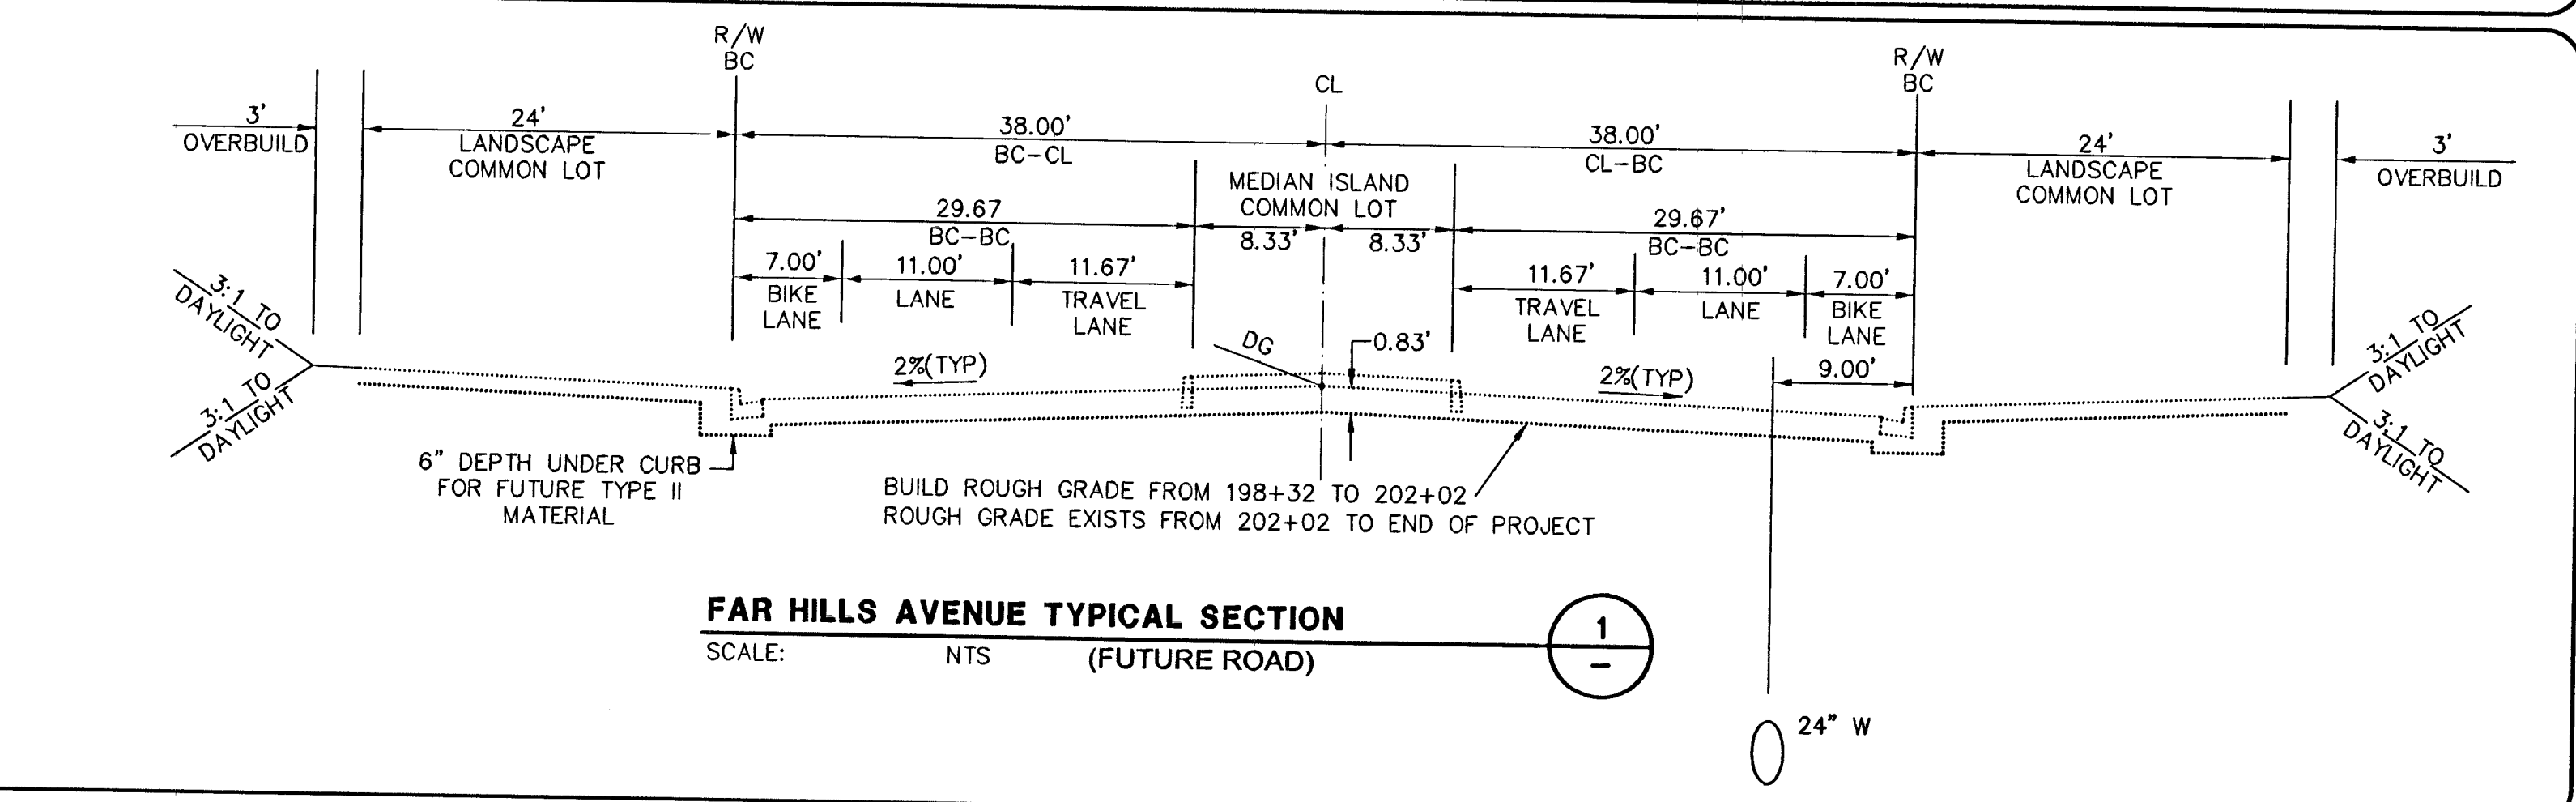
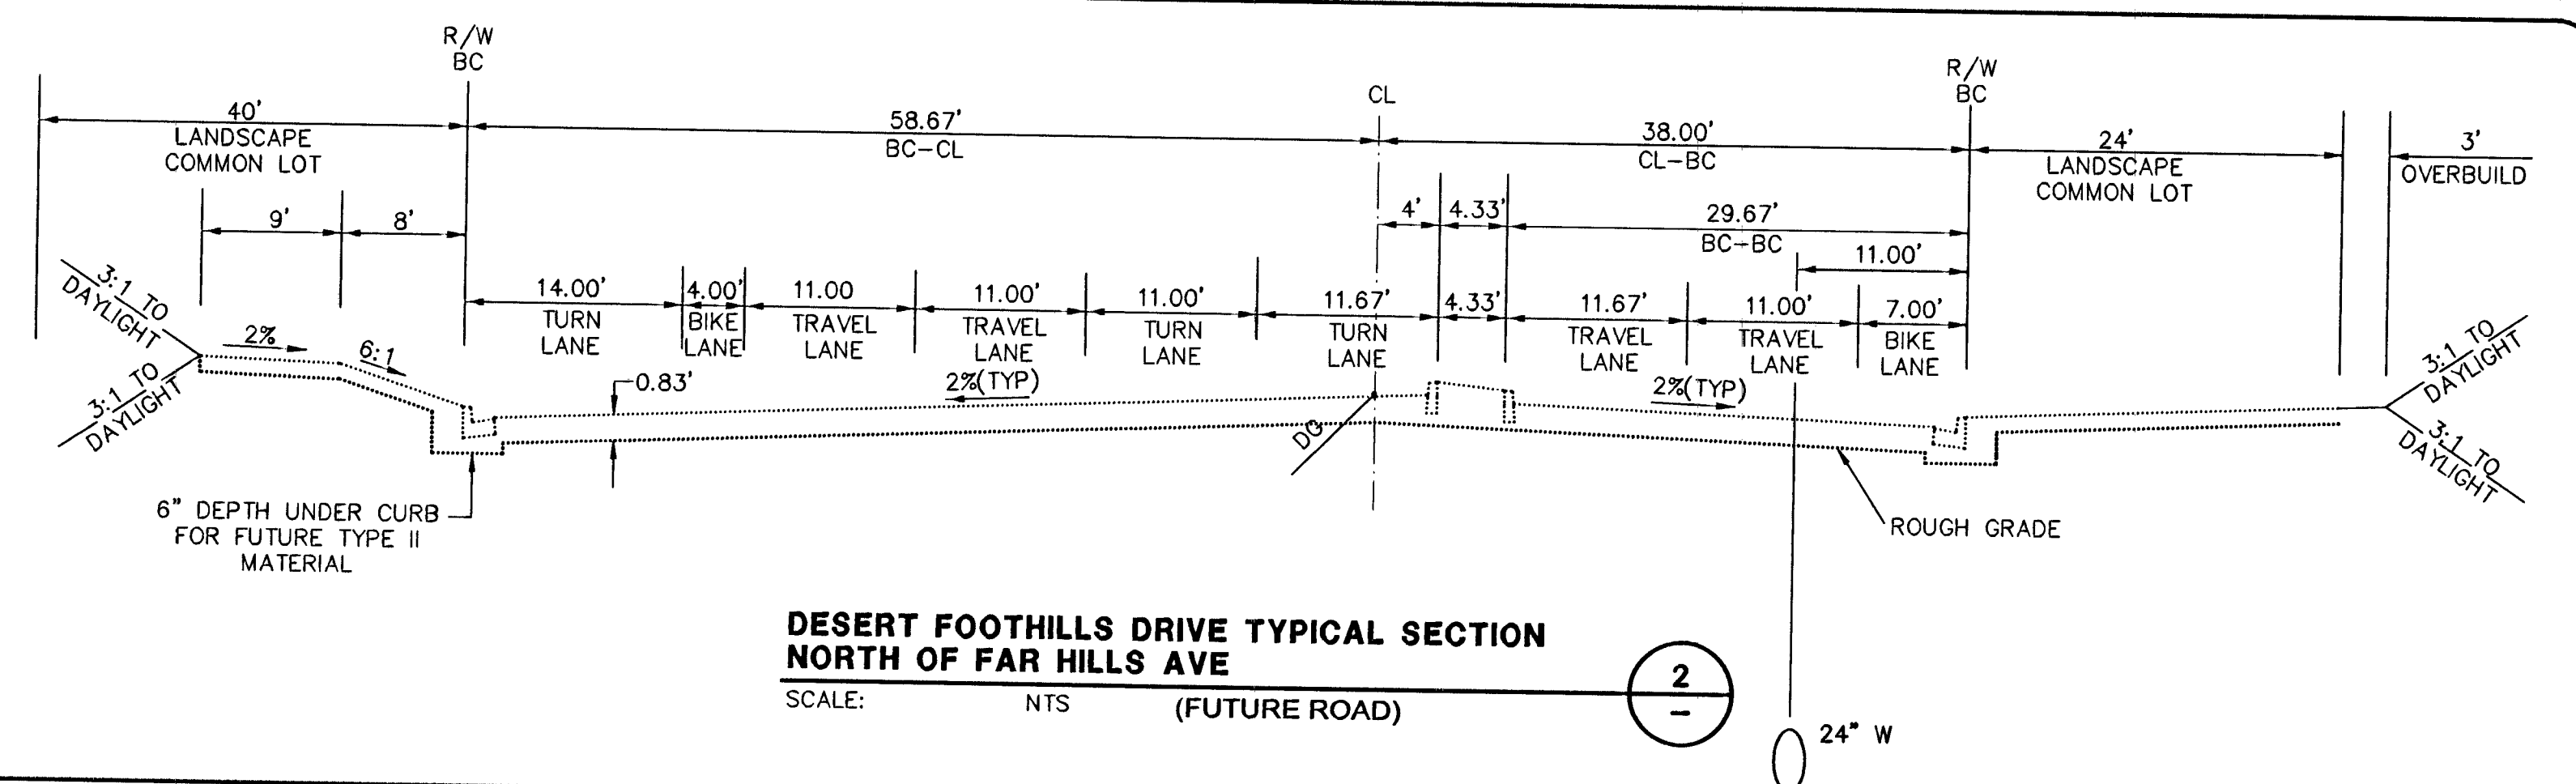


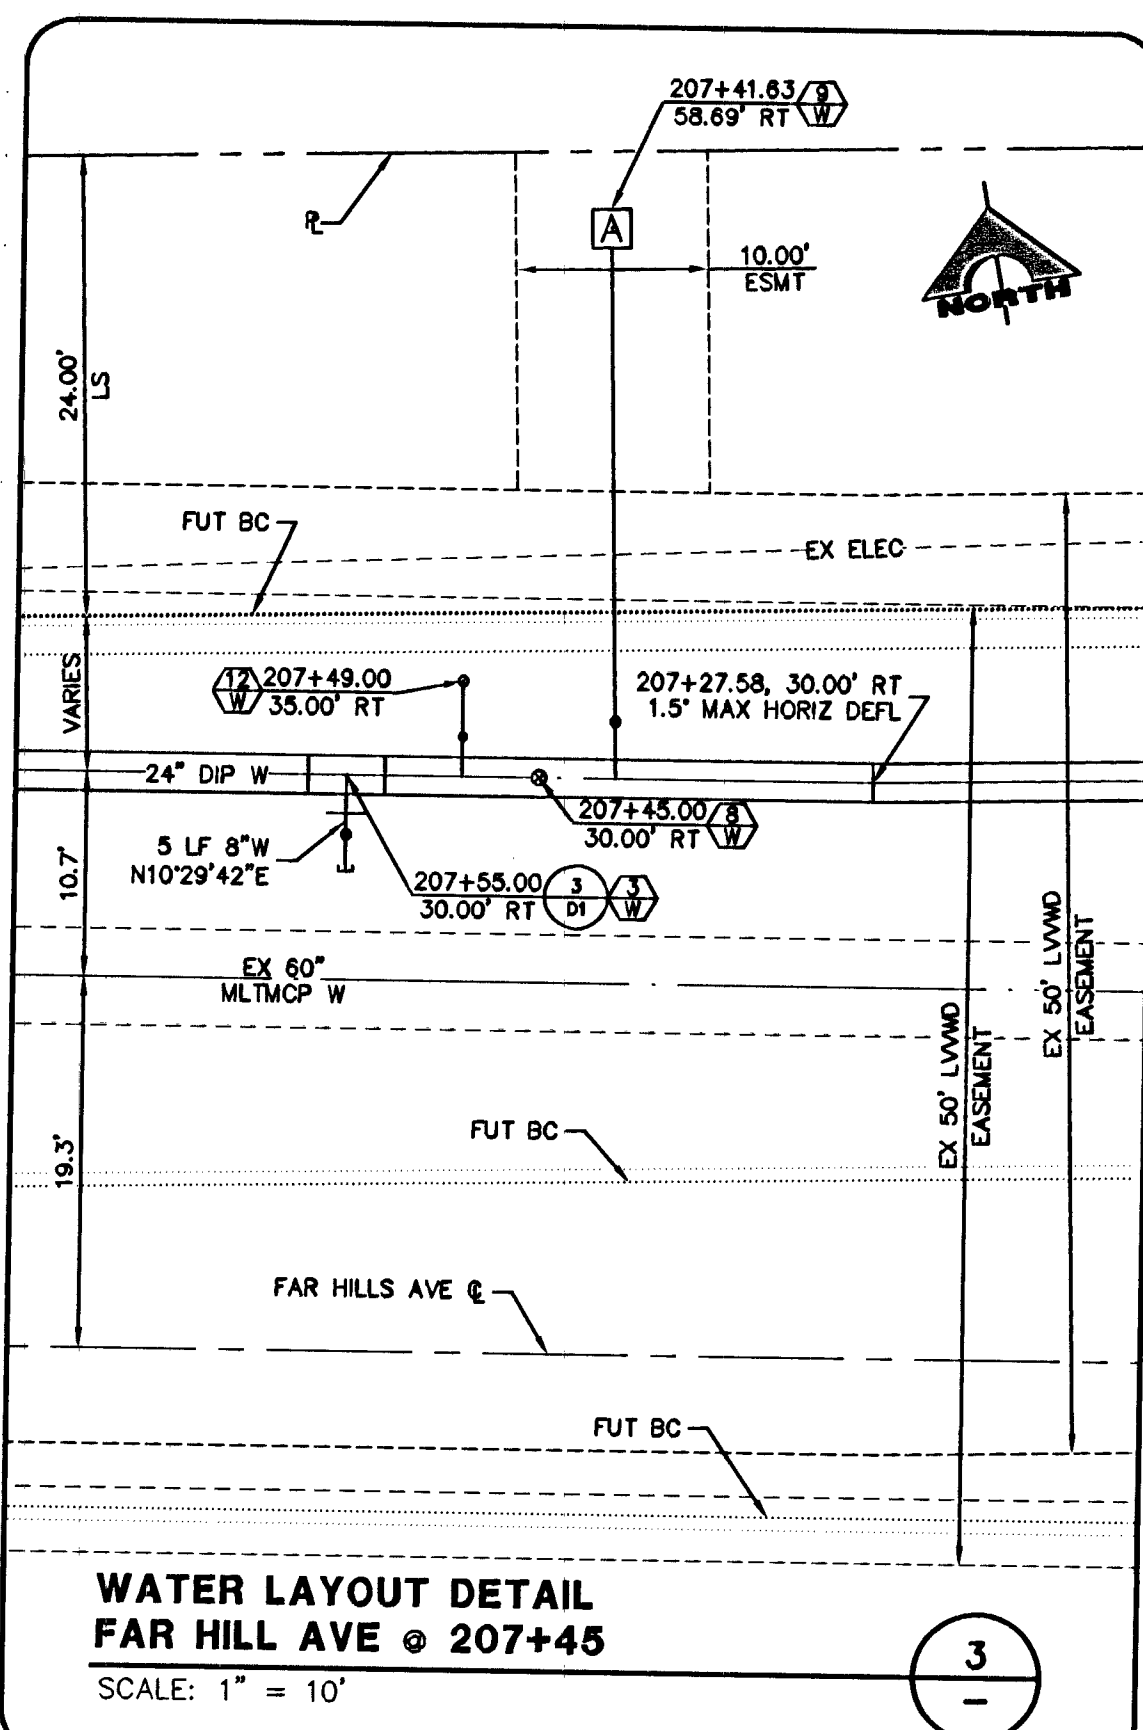

- NOTES:
- CHANGES IN DIRECTION OF THE FIBER OPTIC CONDUIT BY MORE THAN 10' HORIZONTALLY OR VERTICALLY SHALL BE ACCOMPLISHED USING BENDS WITH A MINIMUM RADIUS OF 12 TIMES THE CONDUIT DIAMETER.
 - FOR ADDITIONAL TRENCH BACKFILL REQUIREMENTS SEE DETAIL 6
 - SUPPORT FIBER OPTIC CONDUITS WITH SANDBAGS AND SPOT LOAD AS REQUIRED DURING INSTALLATION OF CLSM IN PIPE ZONE AND PIPE BEDDING AREAS.
 - 12 AWG TRACER WIRE WITH BLUE THW INSULATION. ATTACH TO CONDUIT EVERY 8 FEET WITH WRAPPED ELECTRICAL TAPE. LABEL TRACER WIRE "F.O. CONDUIT TRACER" IN ACCORDANCE WITH SECTION 16075. SPACE LABELS EVERY 8' ALONG THE PIPELINE AND EVERY 4" IN THE SPLICE PIT AND PULL BOXES.

APPROVED FOR CONSTRUCTION
1ST APP'D 9/26/13
[Signature]
LAS VEGAS VALLEY WATER DISTRICT ENGINEERING SERVICES MANAGER
PROJECT NO. 121623 DATE: 11/26/14

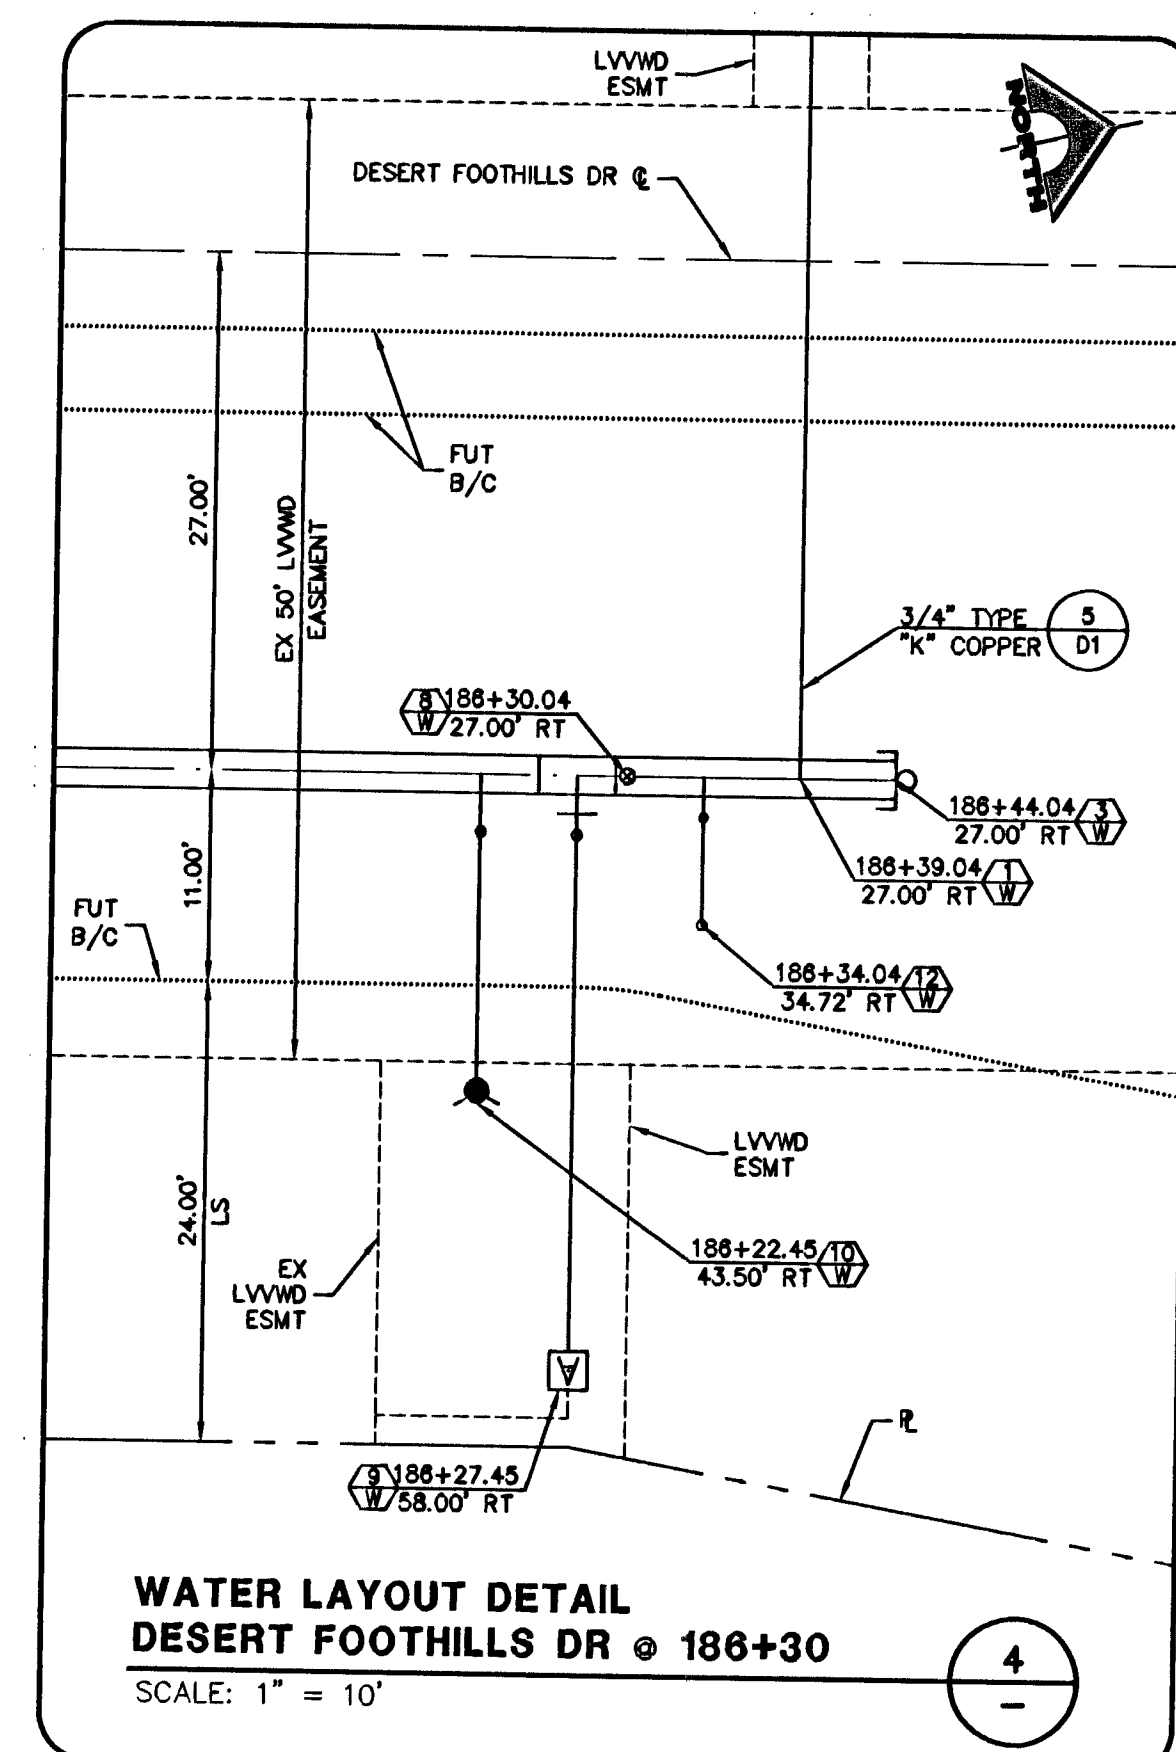

G.C. WALLACE COMPANIES
ENGINEERS | PLANNERS | SURVEYORS
3555 RAINBOW BOULEVARD - LAS VEGAS, NV 89146
TEL: 702.886.2000 • FAX: 702.886.2299 • GCWALLACE.COM

THE HOWARD HUGHES COMPANY, LLC
VILLAGE 238 24' 3550 ZONE WATERLINE IMPROVEMENTS
WATERLINE DETAILS 2