


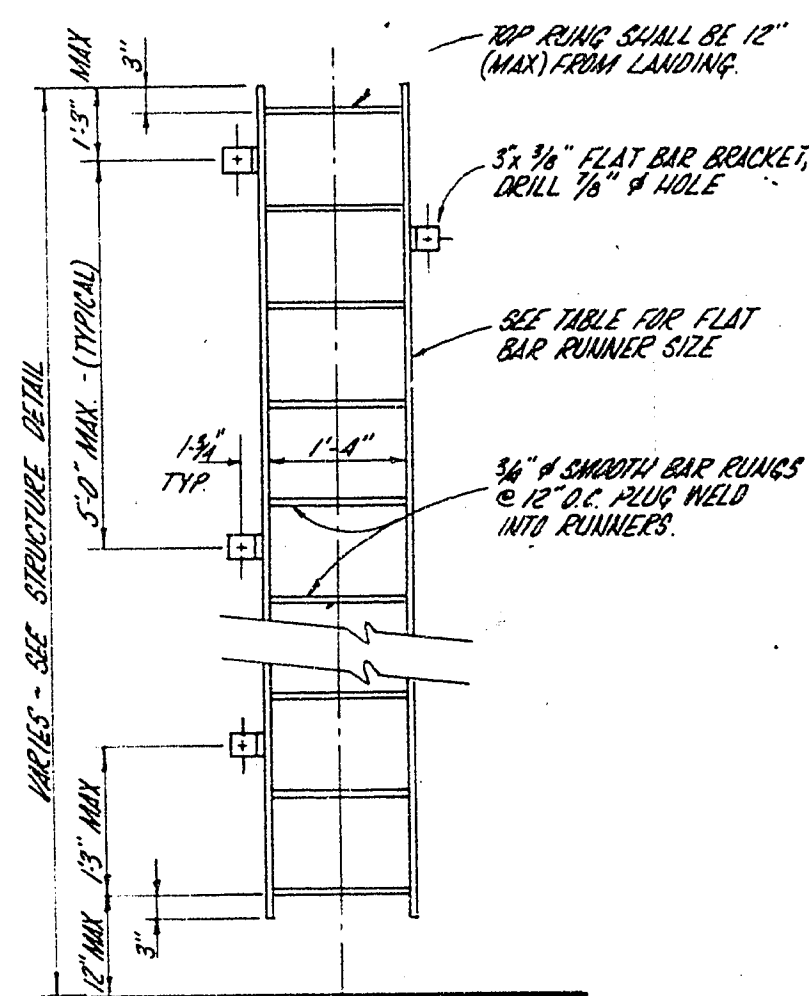


Bracket Spacing	Flat Bar Size
5'-0" O.C. MAX	2" x 3/8"
5'-0" TO 10'-0"	3" x 3/8"
10'-0" TO 20'-0"	3" x 1/2"
OVER 20'-0"	4" x 1/2"

* APPROVAL OF THE ENGINEER REQUIRED FOR ANY BRACKET SPACING OVER 5'-0\"/>

3/4\"/>

RECESS ANCHORS 3/4\"/>

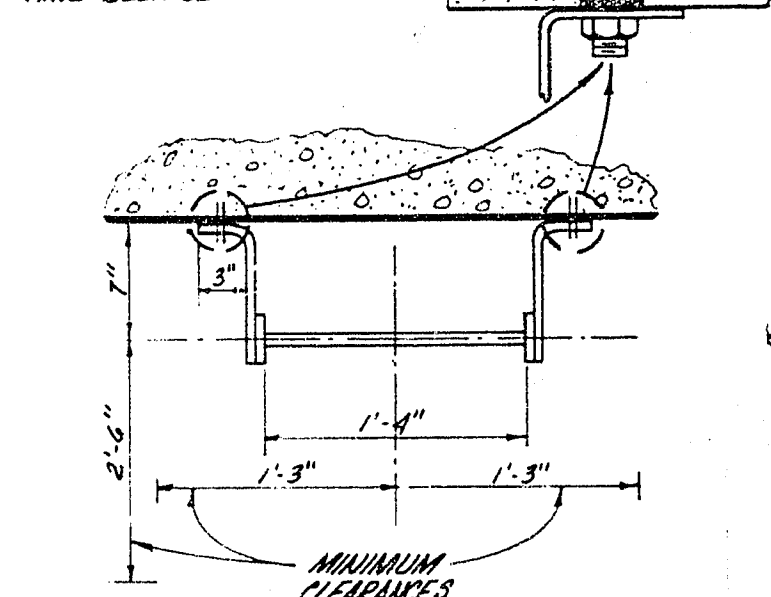


GENERAL NOTES:

1. WHERE LADDER IS LOCATED SUCH THAT IT WILL BE SUBMERGED IN WATER, ALL MATERIALS (INCLUDING ANCHOR BOLTS) SHALL BE STAINLESS STEEL (TYPE 304).
2. UNLESS OTHERWISE SHOWN, ALL LADDERS SHALL BE FABRICATED OF CARBON STEEL & GALVANIZED AFTER FABRICATION. BOLTS SHALL BE CADMIUM PLATED.
3. LANDING PLATFORM REQUIRED EVERY 20'-0\"/>


LADDER DETAIL
(No Scale)

3
15

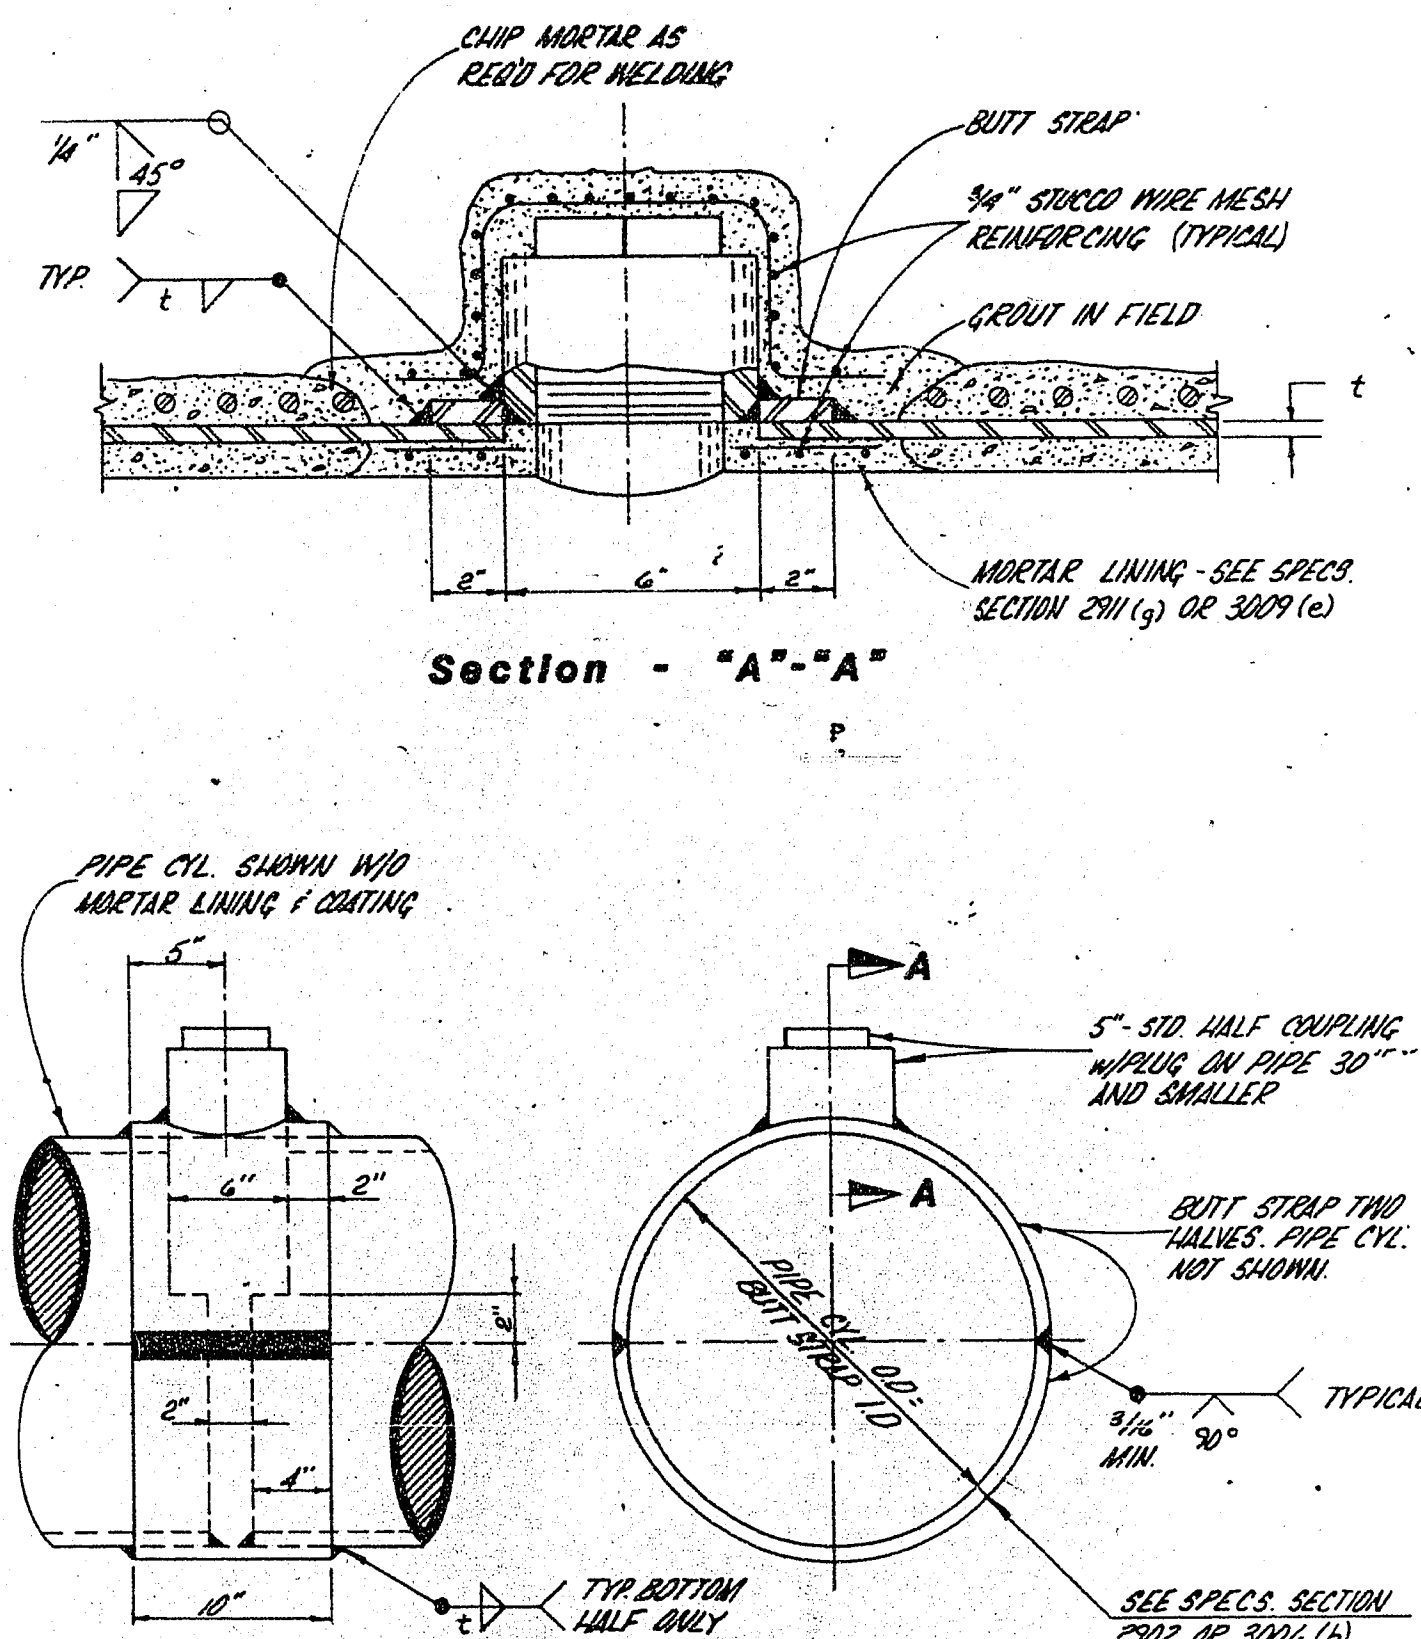


24\"/>

2
15

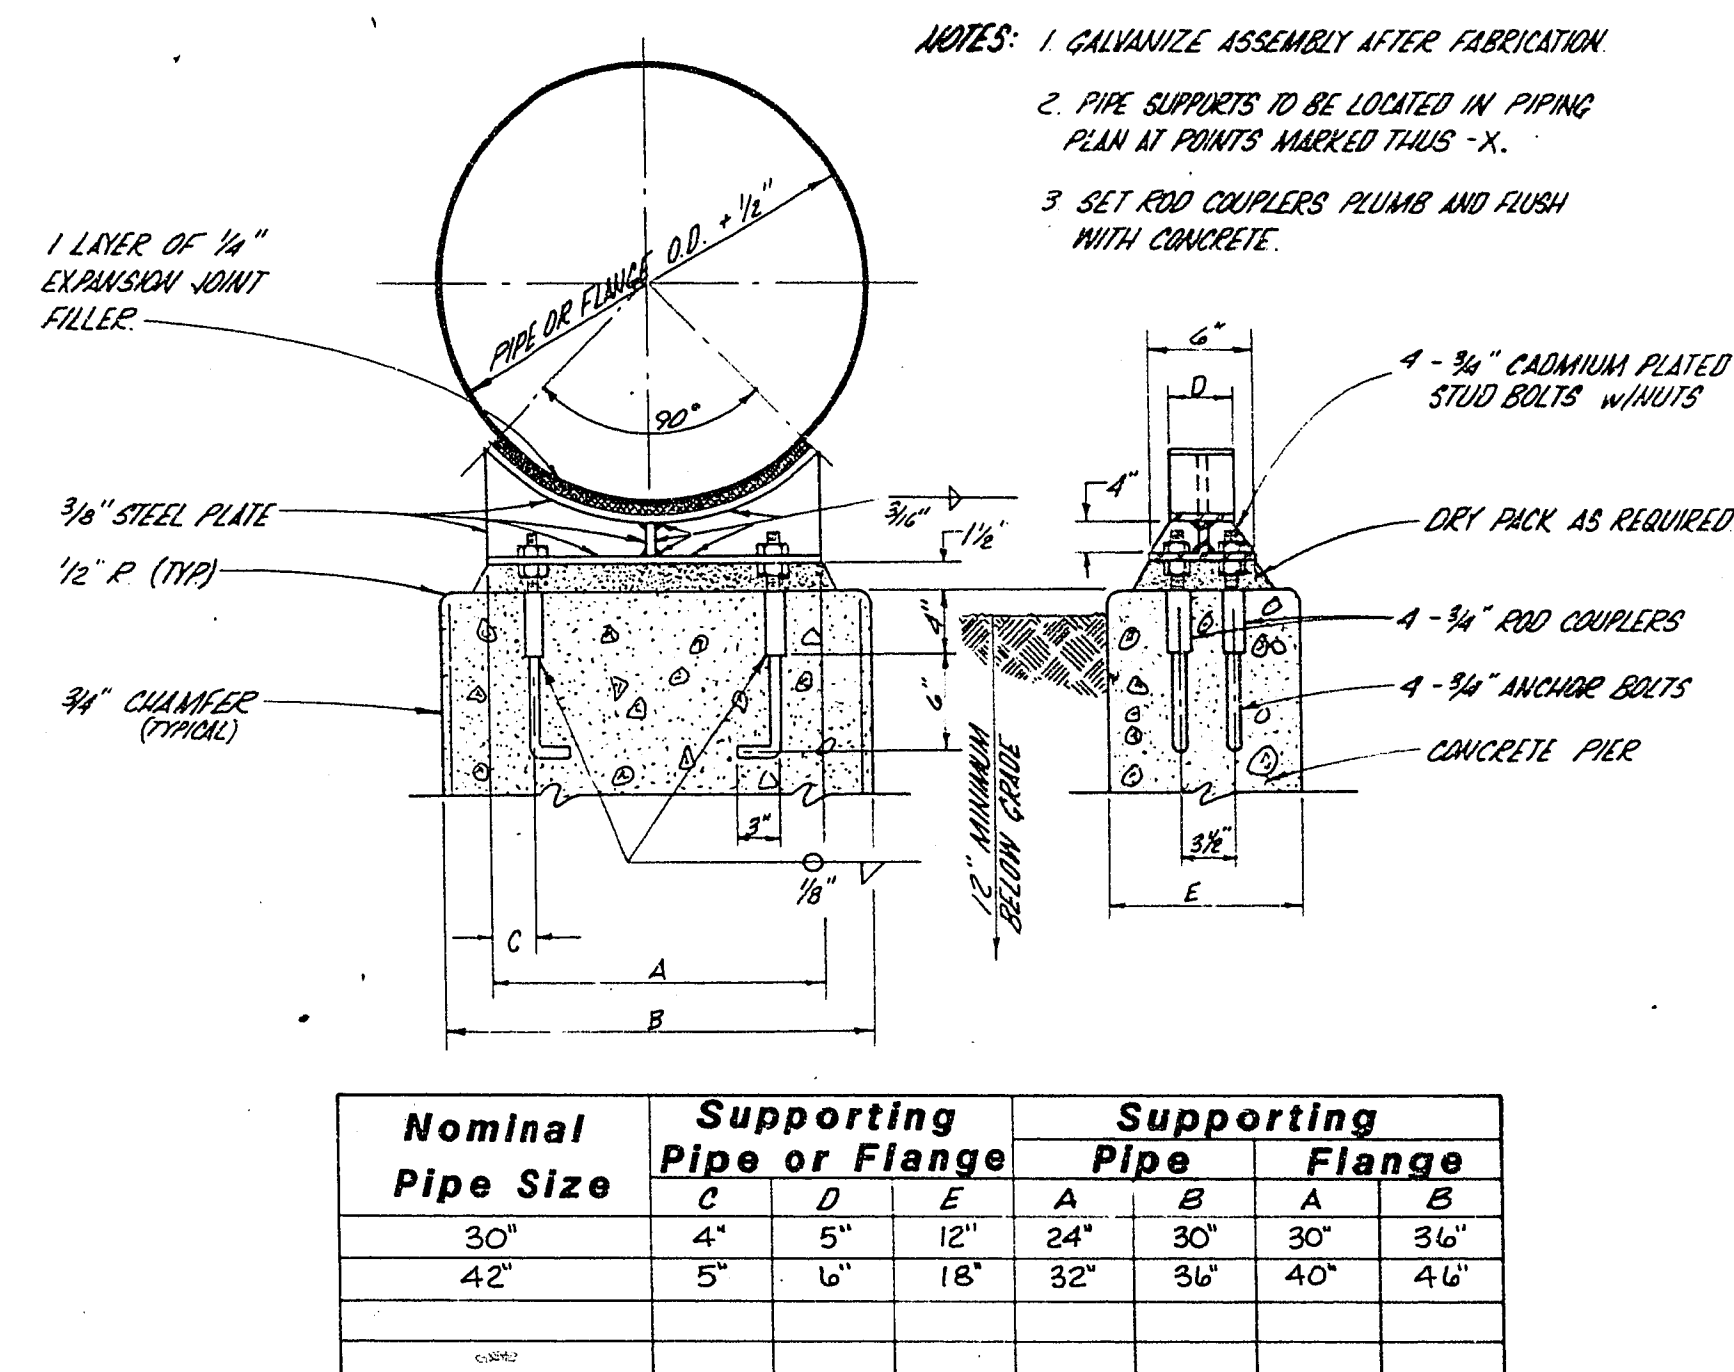


PIPE SUPPORT DETAIL
(No Scale)

1
15

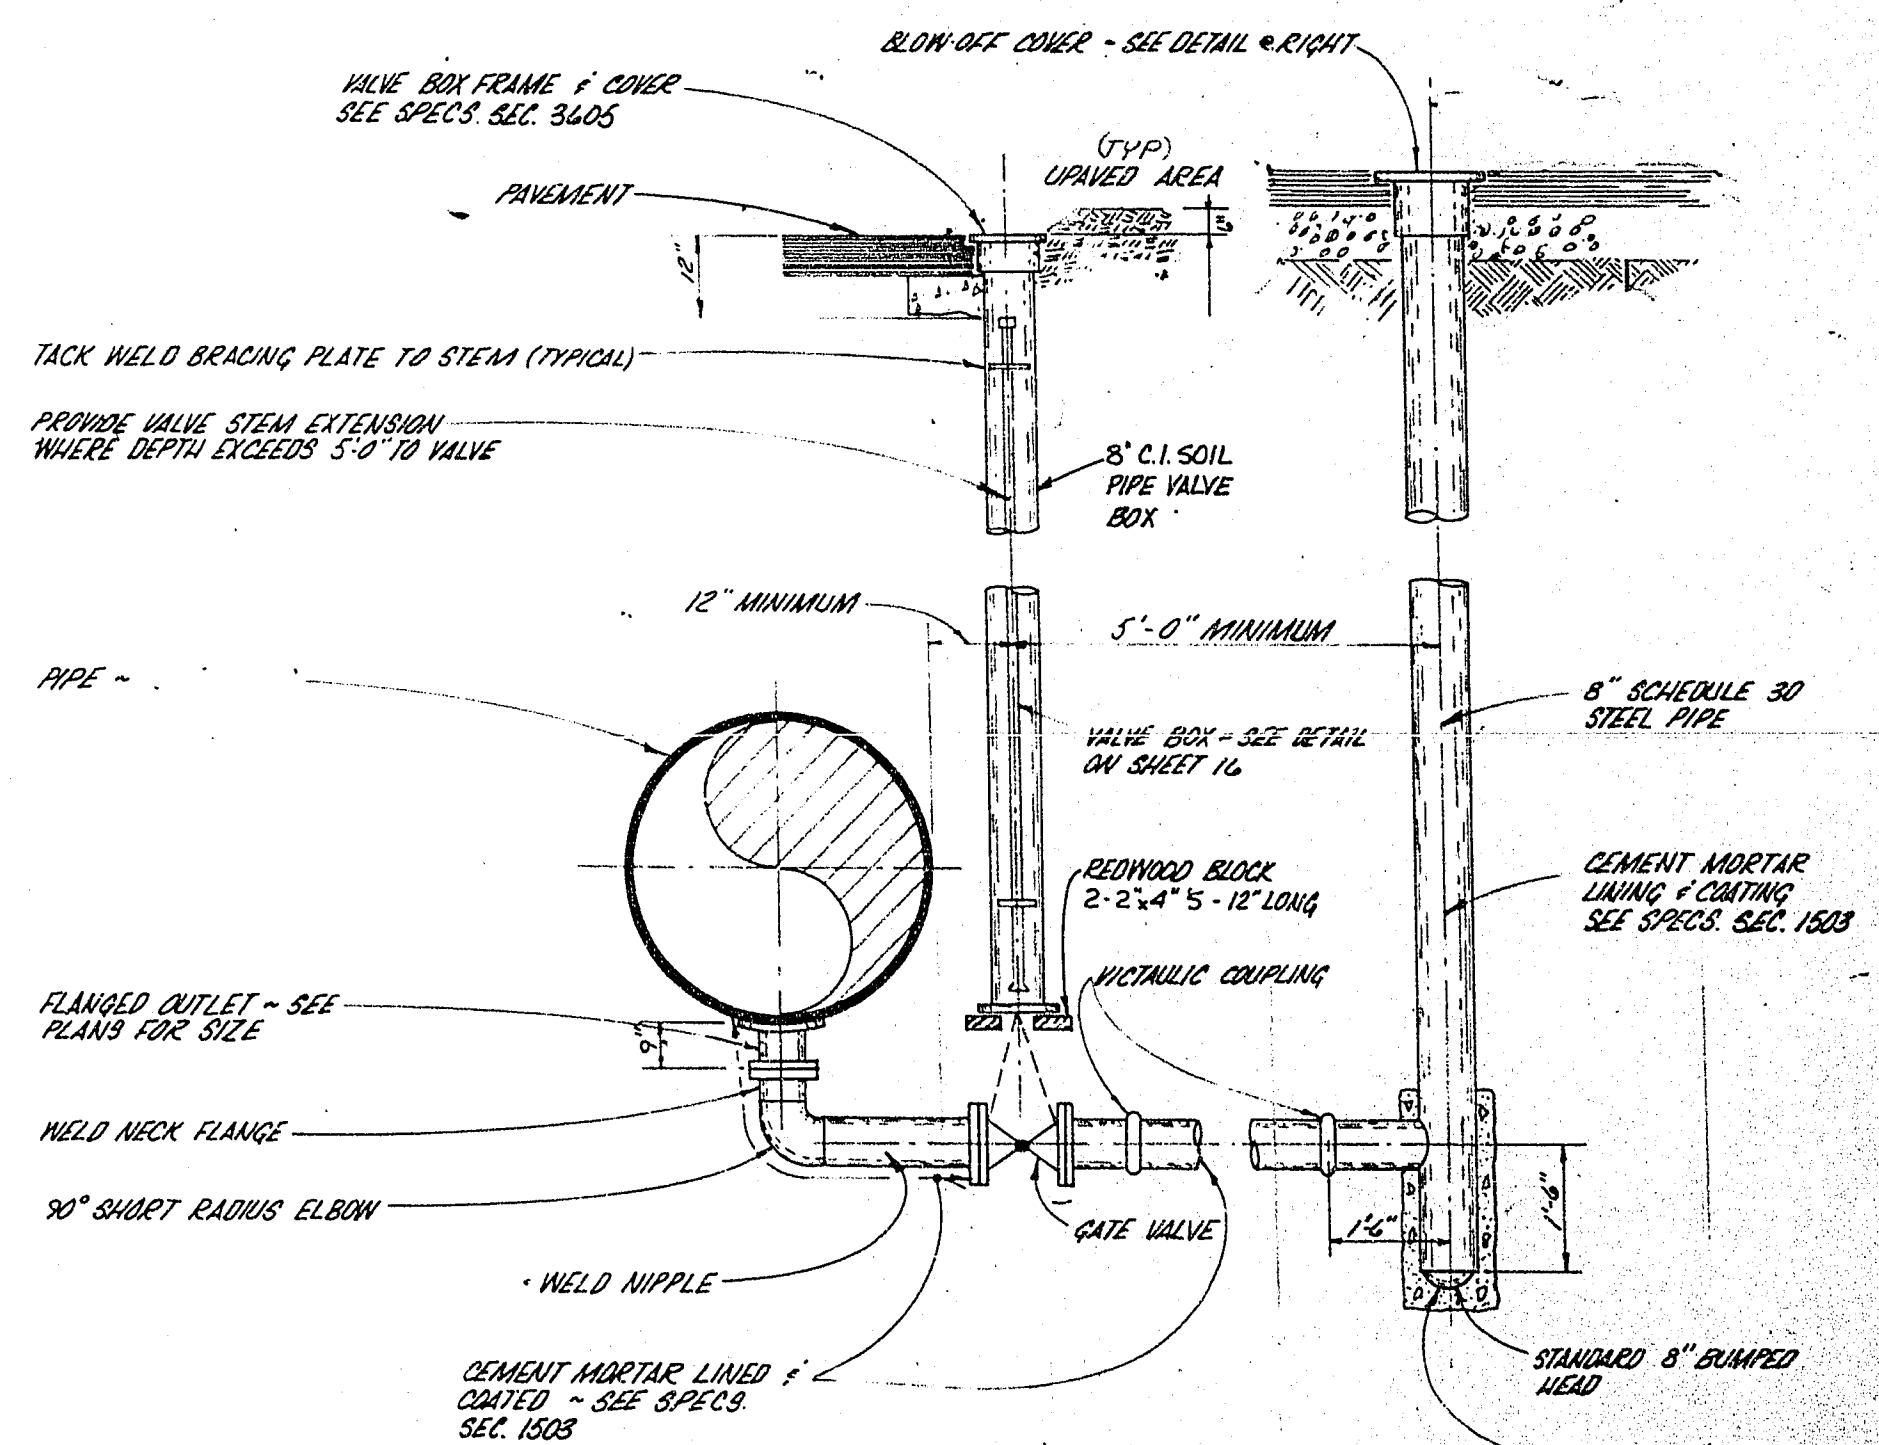

BLOW-OFF DETAIL
(No Scale)


5
15

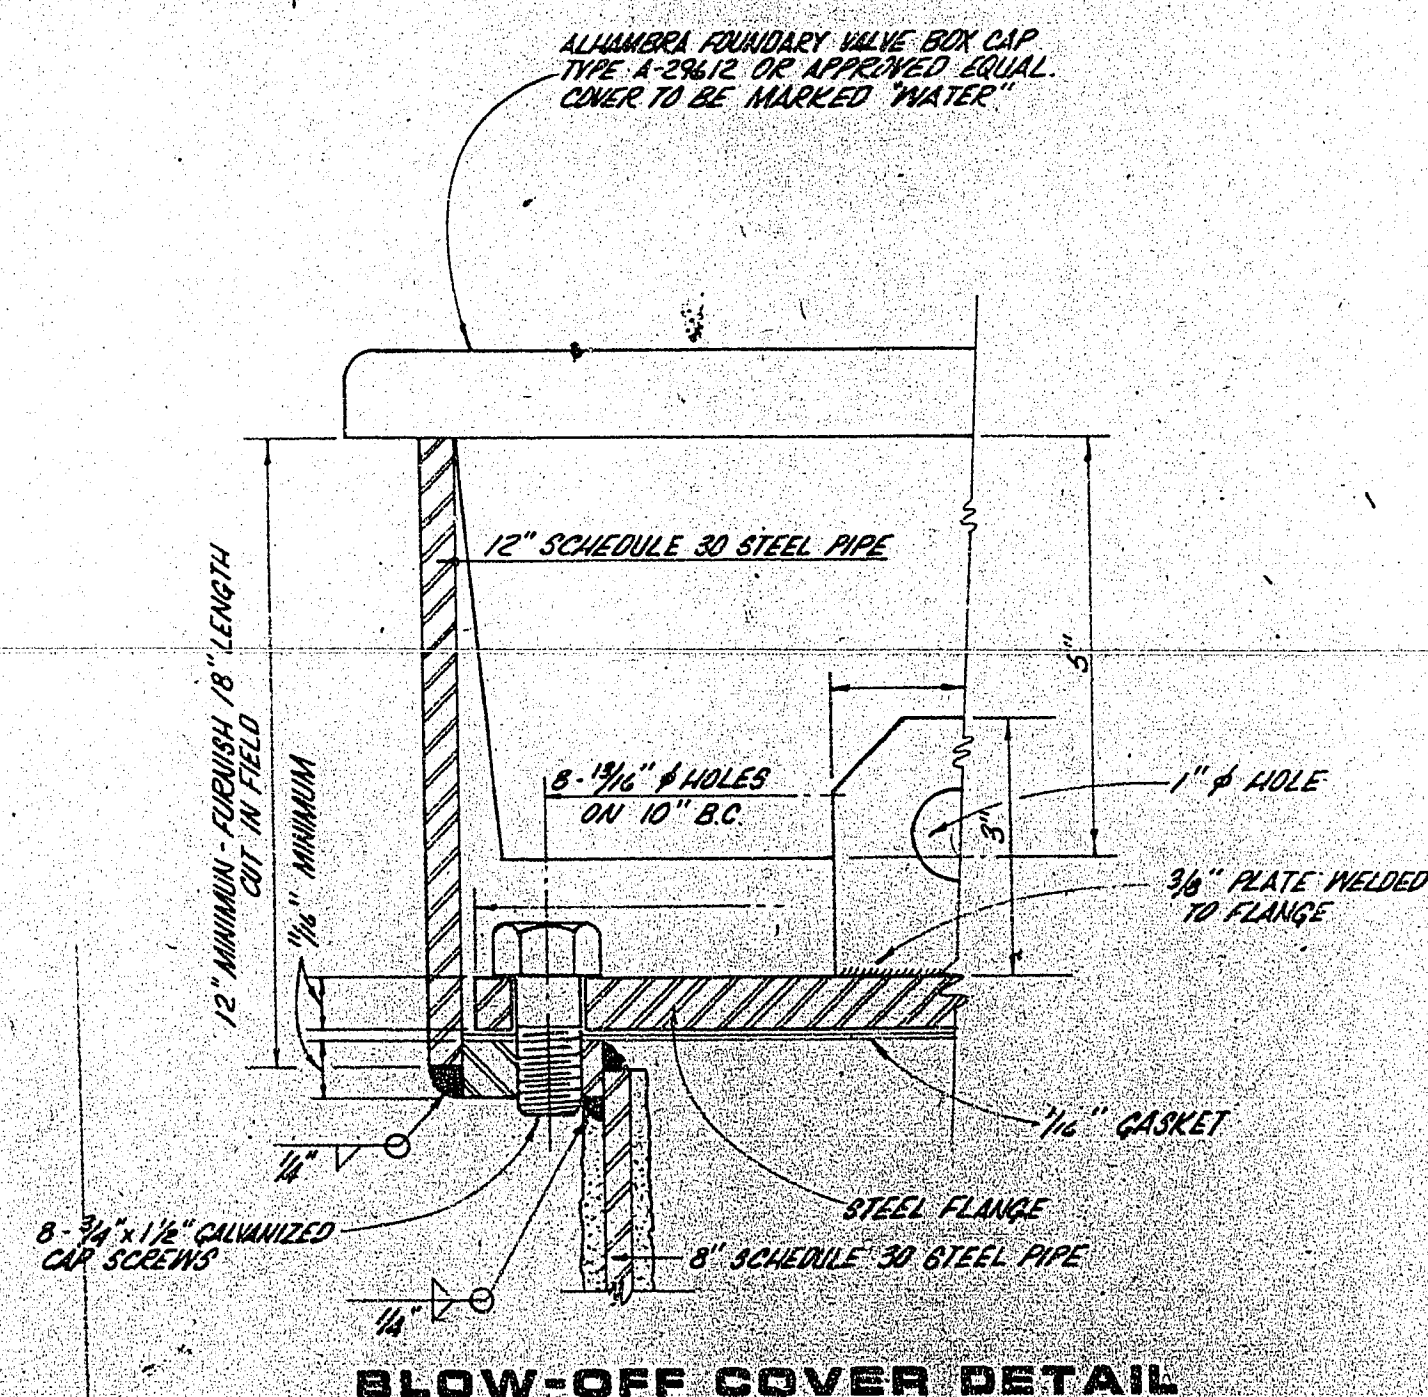

BLOW-OFF COVER DETAIL

APPROVAL

Oliver F. Walter RPE 4412 6-2-81
LAS VEGAS VALLEY WATER DISTRICT Date

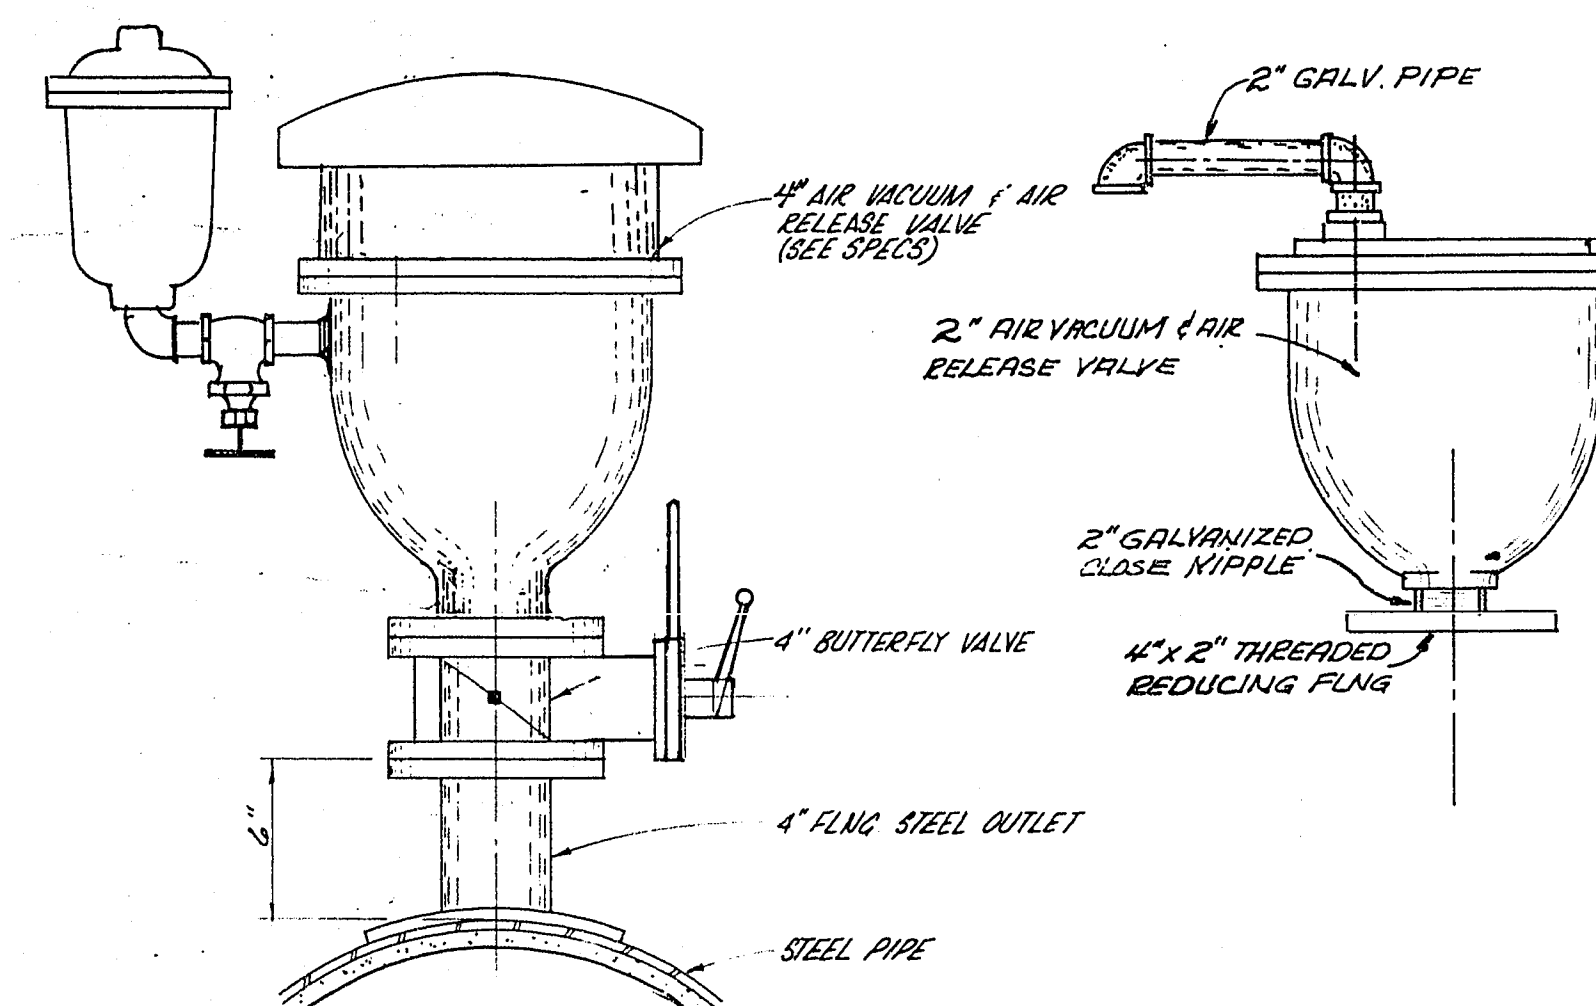

2\"/>

4
15

DETAIL SHEET

WEST CHARLESTON BOULEVARD
FEEDER MAIN
CONTRACT NO. 362

WO NO. 2580
BY COSPITZE
DATE 5/14/81
SCALE No Scale

SHEET
15
OF 19 SHEETS

565-157

REVISION
DATE
BY
REV
DATE
BY

5/14/81
DATE
CHARLEY H. JOHNSON
Rev. 001- No. 3005

CONSULTING ENGINEERS • PLANNERS
2800 WEST SAHARA AVENUE
LAS VEGAS, NEVADA 89102
PHONE (702) 873-7550

vtm nevada