



AHU	AIR HANDLING UNIT
CC	COOLING COIL
CDU	CONDENSING UNIT
CV	CONTROL VALVE
CWS	CHILLED WATER SUPPLY
CWR	CHILLED WATER RETURN
CVB	CONSTANT VOLUME BOX
D	DRAIN
DF	DUCT FURNACE
EA	EXHAUST AIR
EC	EVAPORATIVE COOLER
F	FAN
FDC	FLEXIBLE DUCT CONNECTOR
FLT	FILTER
HC	HEATING COIL
HEX	HEAT EXCHANGER
HP	HEAT PUMP
HPL	HEAT RECOVERY COIL
HPWS	HEAT RECOVERY WATER SUPPLY
HPWR	HEAT RECOVERY WATER RETURN
HPs	HEAT RECOVERY SUPPLY
HPR	HEAT RECOVERY RETURN
LV	LOUVER
MA	MIXED AIR
NG	NATURAL GAS
NFW	NONFRESH WATER
OSA	OUTSIDE AIR
PW	POTABLE WATER
RA	RETURN AIR
SA	SUPPLY AIR
SD	SMOKE DETECTOR
SPW	SORTED POTABLE WATER
T	TANK
TS	TEMPERATURE SENSOR
TST	THERMOSTAT
UH	UNIT HEATER
VVB	VARIABLE VOLUME BOX

	ELECTRIC WIRING
	PNEUMATIC TUBING
	PNEUMATIC ELECTRIC RELAY
	ELECTRIC PNEUMATIC RELAY
	PNEUMATIC RELAY
	NORMAL, OPEN PORT
	NORMAL, CLOSED PORT
	COMMON PORT
	SIGNAL
	MOTOR STARTER
	THERMOSTAT
	HAND-OFF-AUTO
	HAND-OFF
	TEMPERATURE INDICATOR
	PRESSURE INDICATOR
	TEMPERATURE SENSOR
	STEAM VALVE
	FREESTAT
	TIME DELAY
	INSTRUMENT AIR
	RECEIVER CONTROLLED
	SMOKE DETECTOR
	LEVEL INDICATOR


	FIRST DIMENSION: DUCT SIDE SHOWN. SECOND DIMENSION SIDE NOT SHOWN. INSULATION LING OR INTERNAL INSULATION
	SUPPLY OR OUTSIDE AIR GRILLE (FIRST DIMENSION DUCT WIDTH)
	EXHAUST OR RETURN AIR GRILLE
	AIR TURNING VANES IN DUCT
	OPPOSED BLADE VOLUME DAMPER
	SINGLE BLADE VOLUME DAMPER
	FIRE DAMPER
	FLEXIBLE DUCT CONNECTION
	DUCT RISE UP
	DUCT DROP/DOWN
	SPLITTER DAMPER W/5" THROAT
	EXTRACTOR
	WALL LOUVER
	EXHAUST OR RETURN AIR GRILLE OR REGISTER (WIDTH x HEIGHT, INCHES)
	SUPPLY GRILLE OR REGISTER
	CEILING SUPPLY OR DIFFUSER
	CEILING RETURN OR EXHAUST AIR GRILLE OR REGISTER
	DOOR GRILLE
	UNDERCUT DOOR 3/4"
	PRESSURE RELIEF DAMPER IN WALL WITH GRILLE ON BOTH OR ONE SIDE
	AIR DUCT
	TRANSFER GRILLE

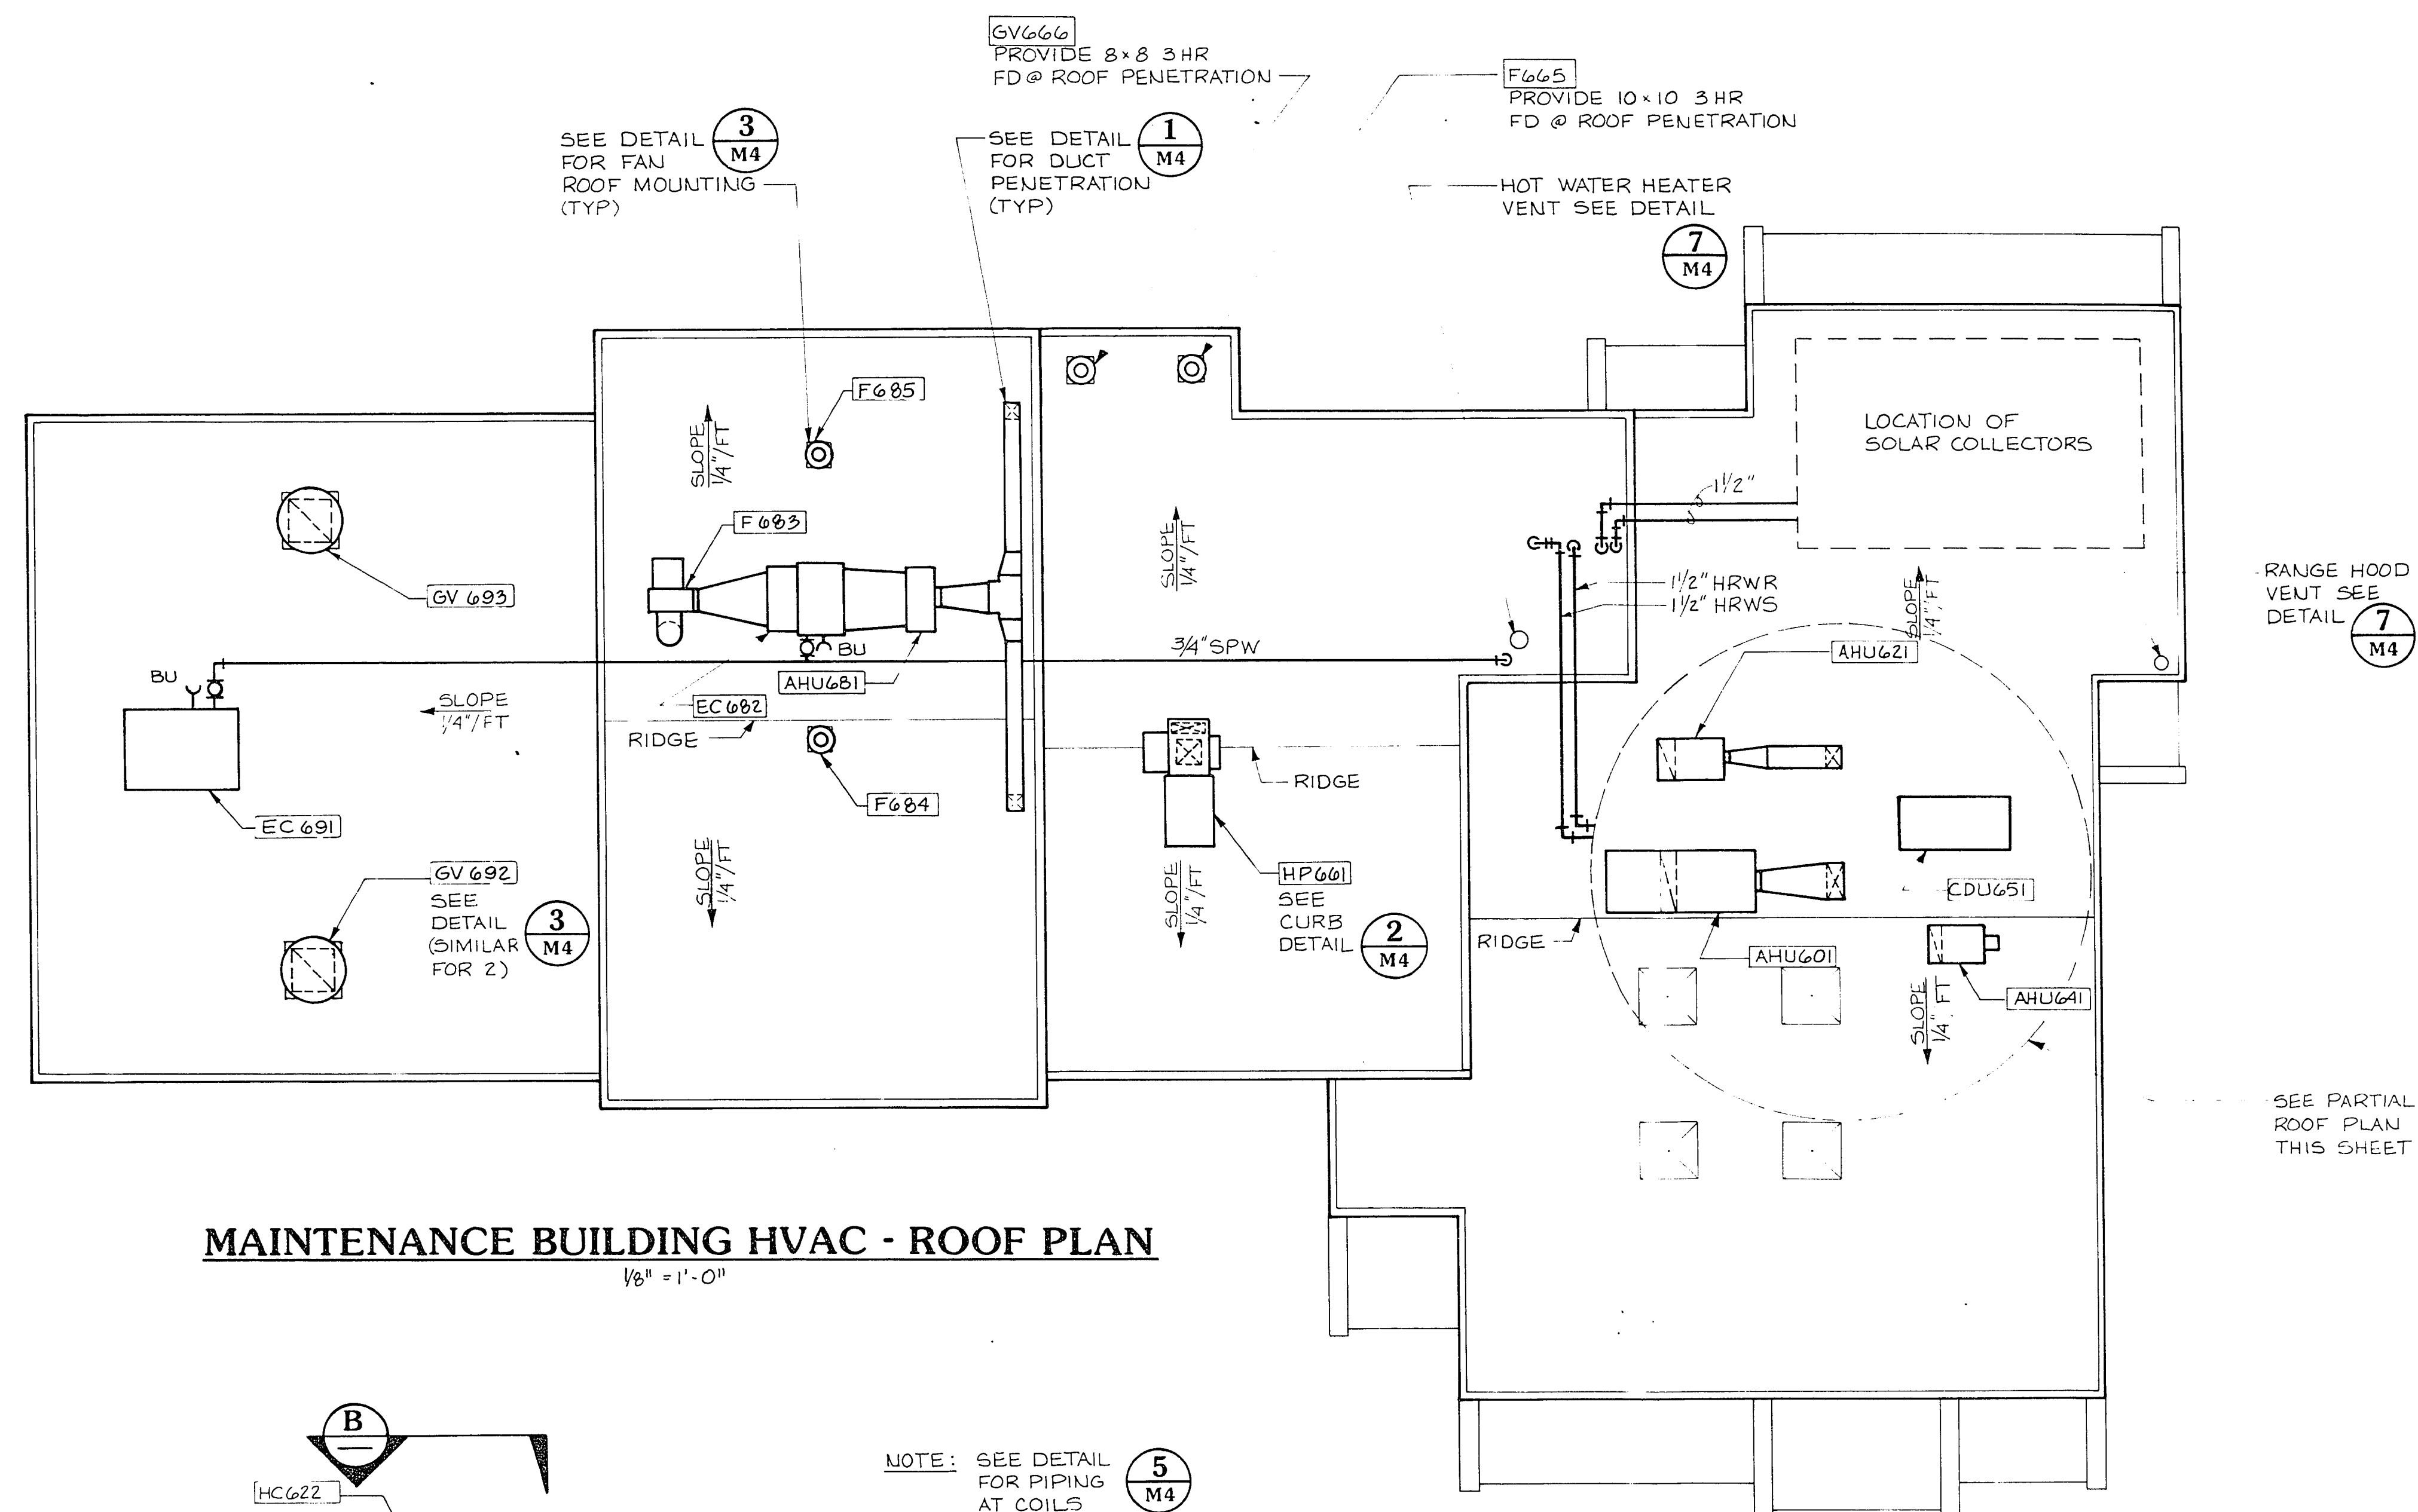

MAINTENANCE BUILDING HVAC - ROOF PLAN
1/8" = 1'-0"

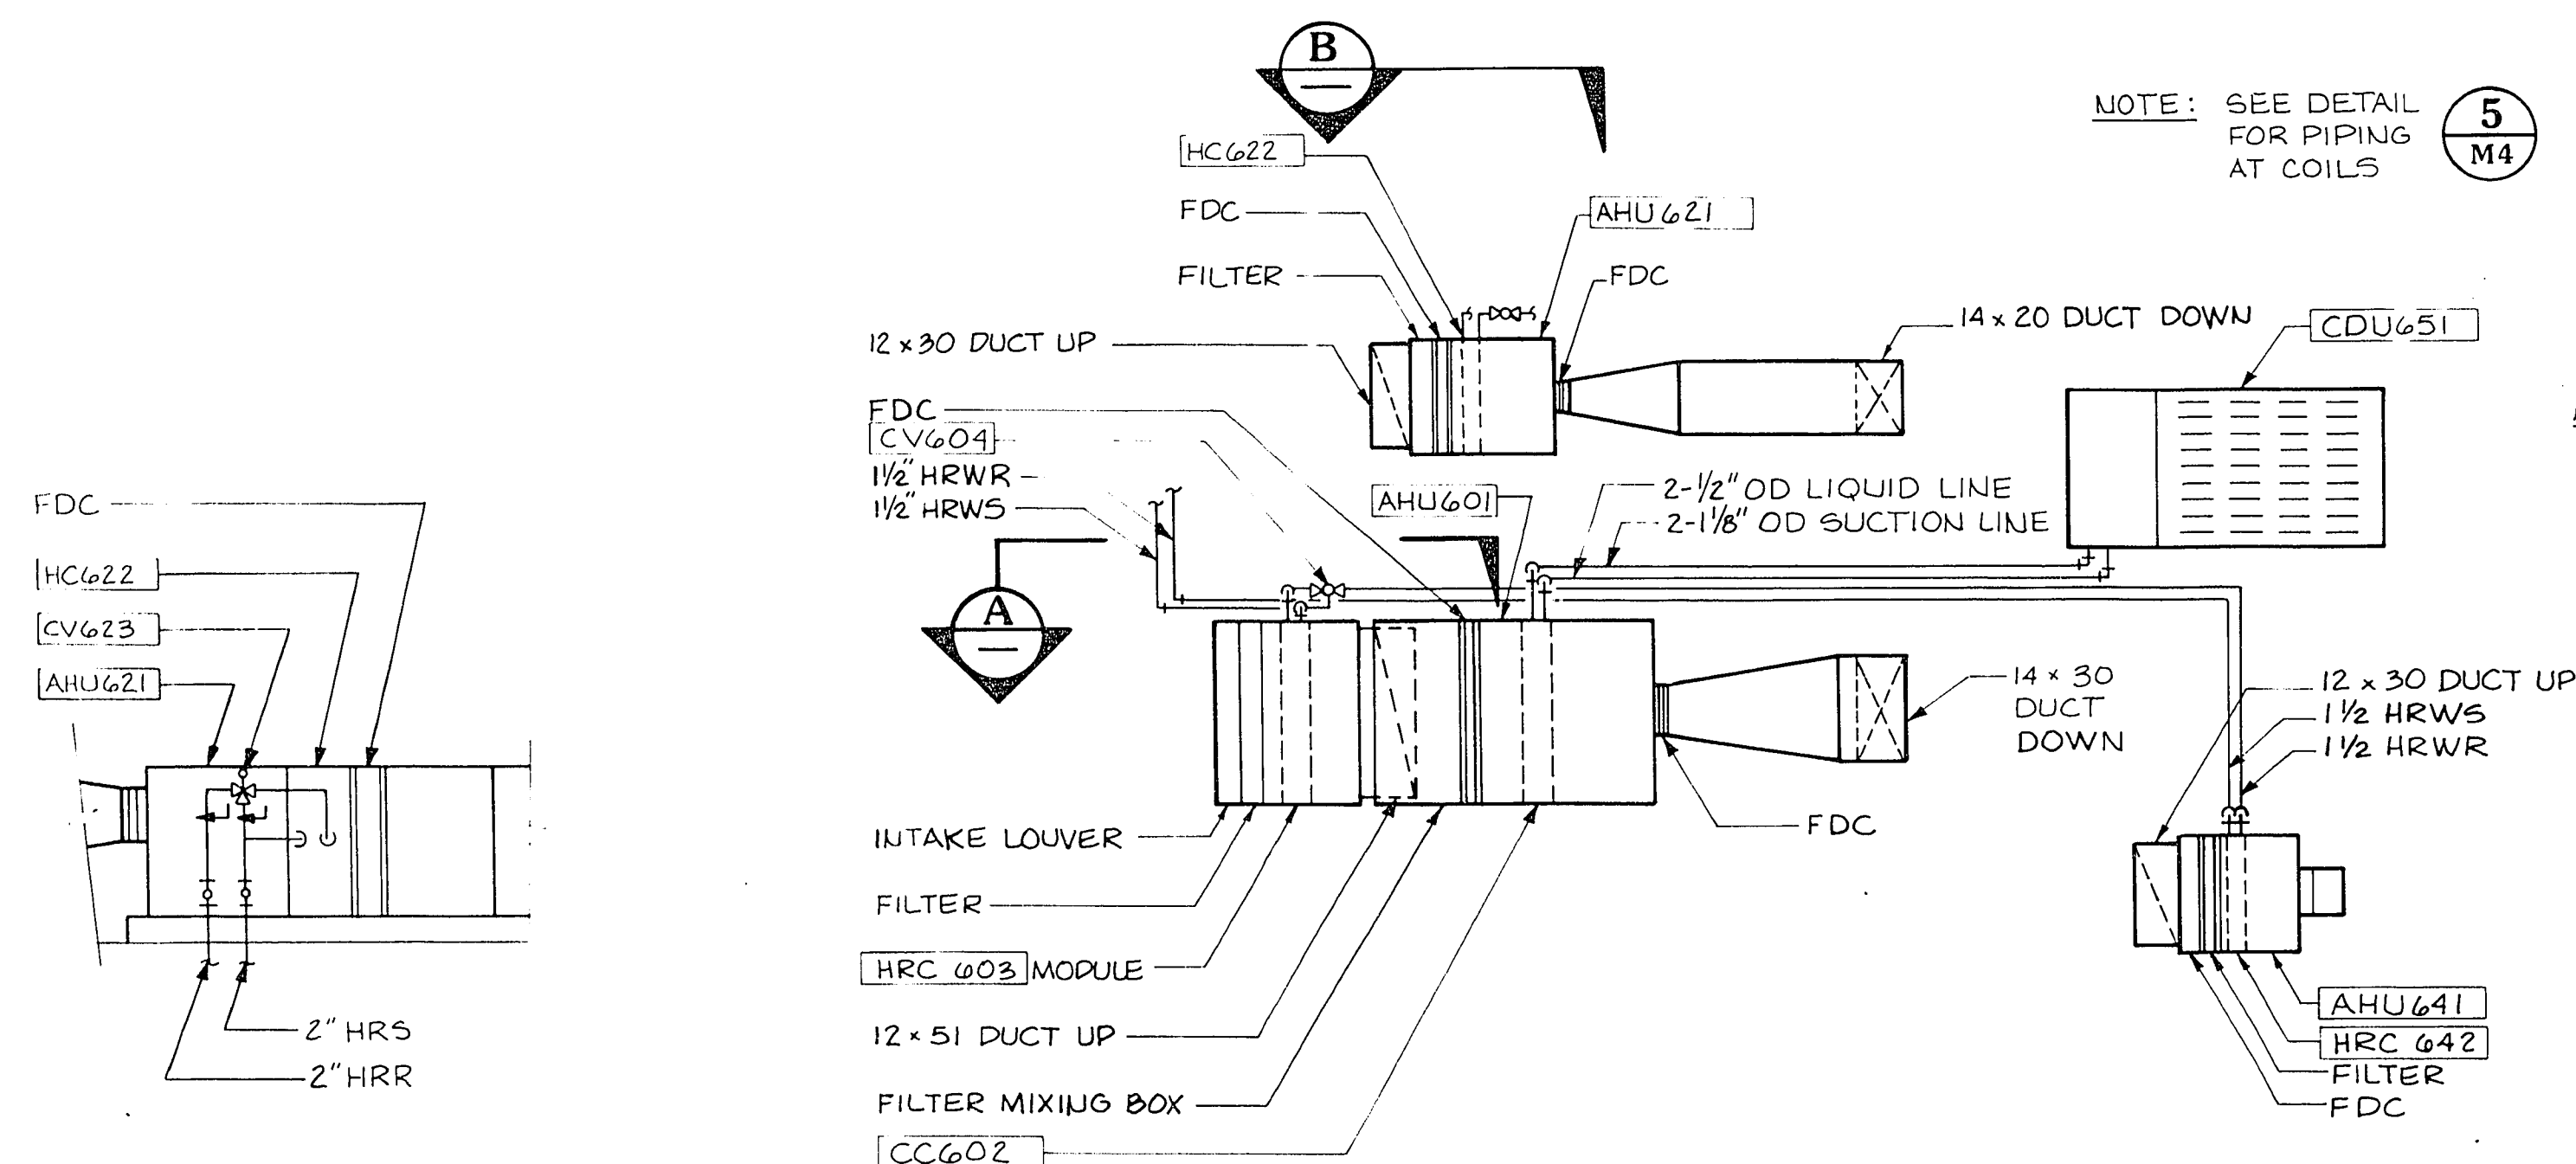

PARTIAL ROOF PLAN
1/4" = 1'-0"

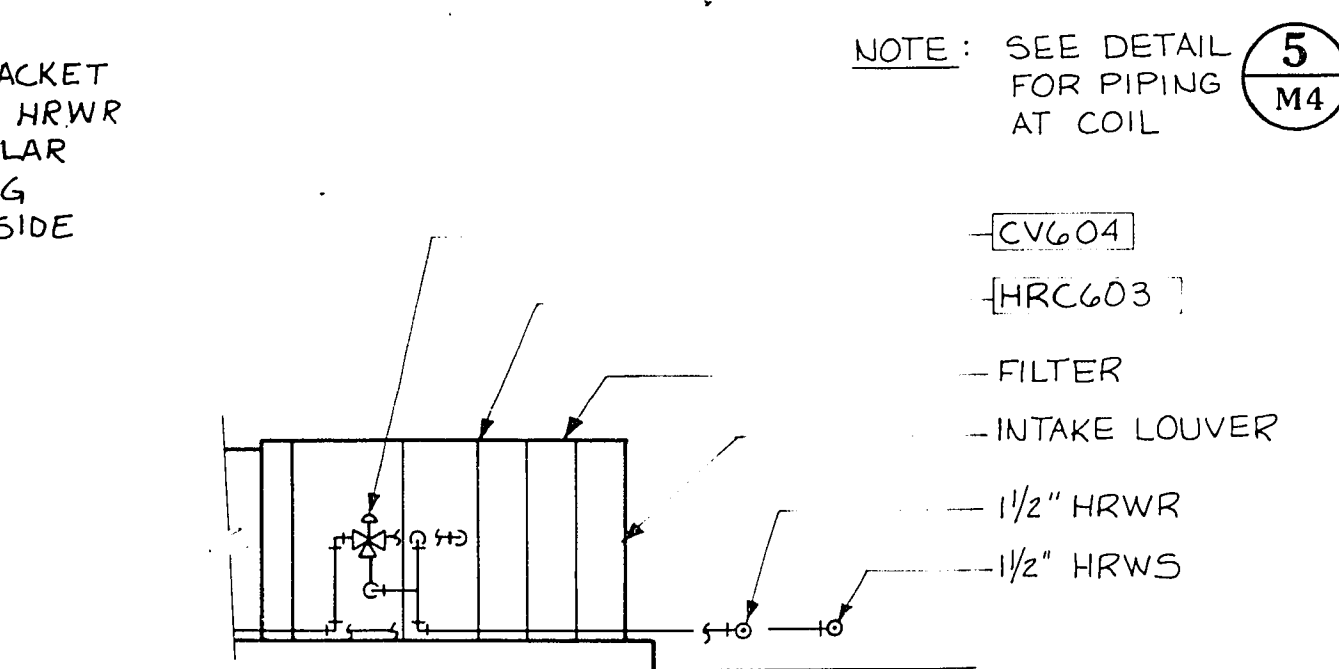

SECTION A
1/2" = 1'-0"