



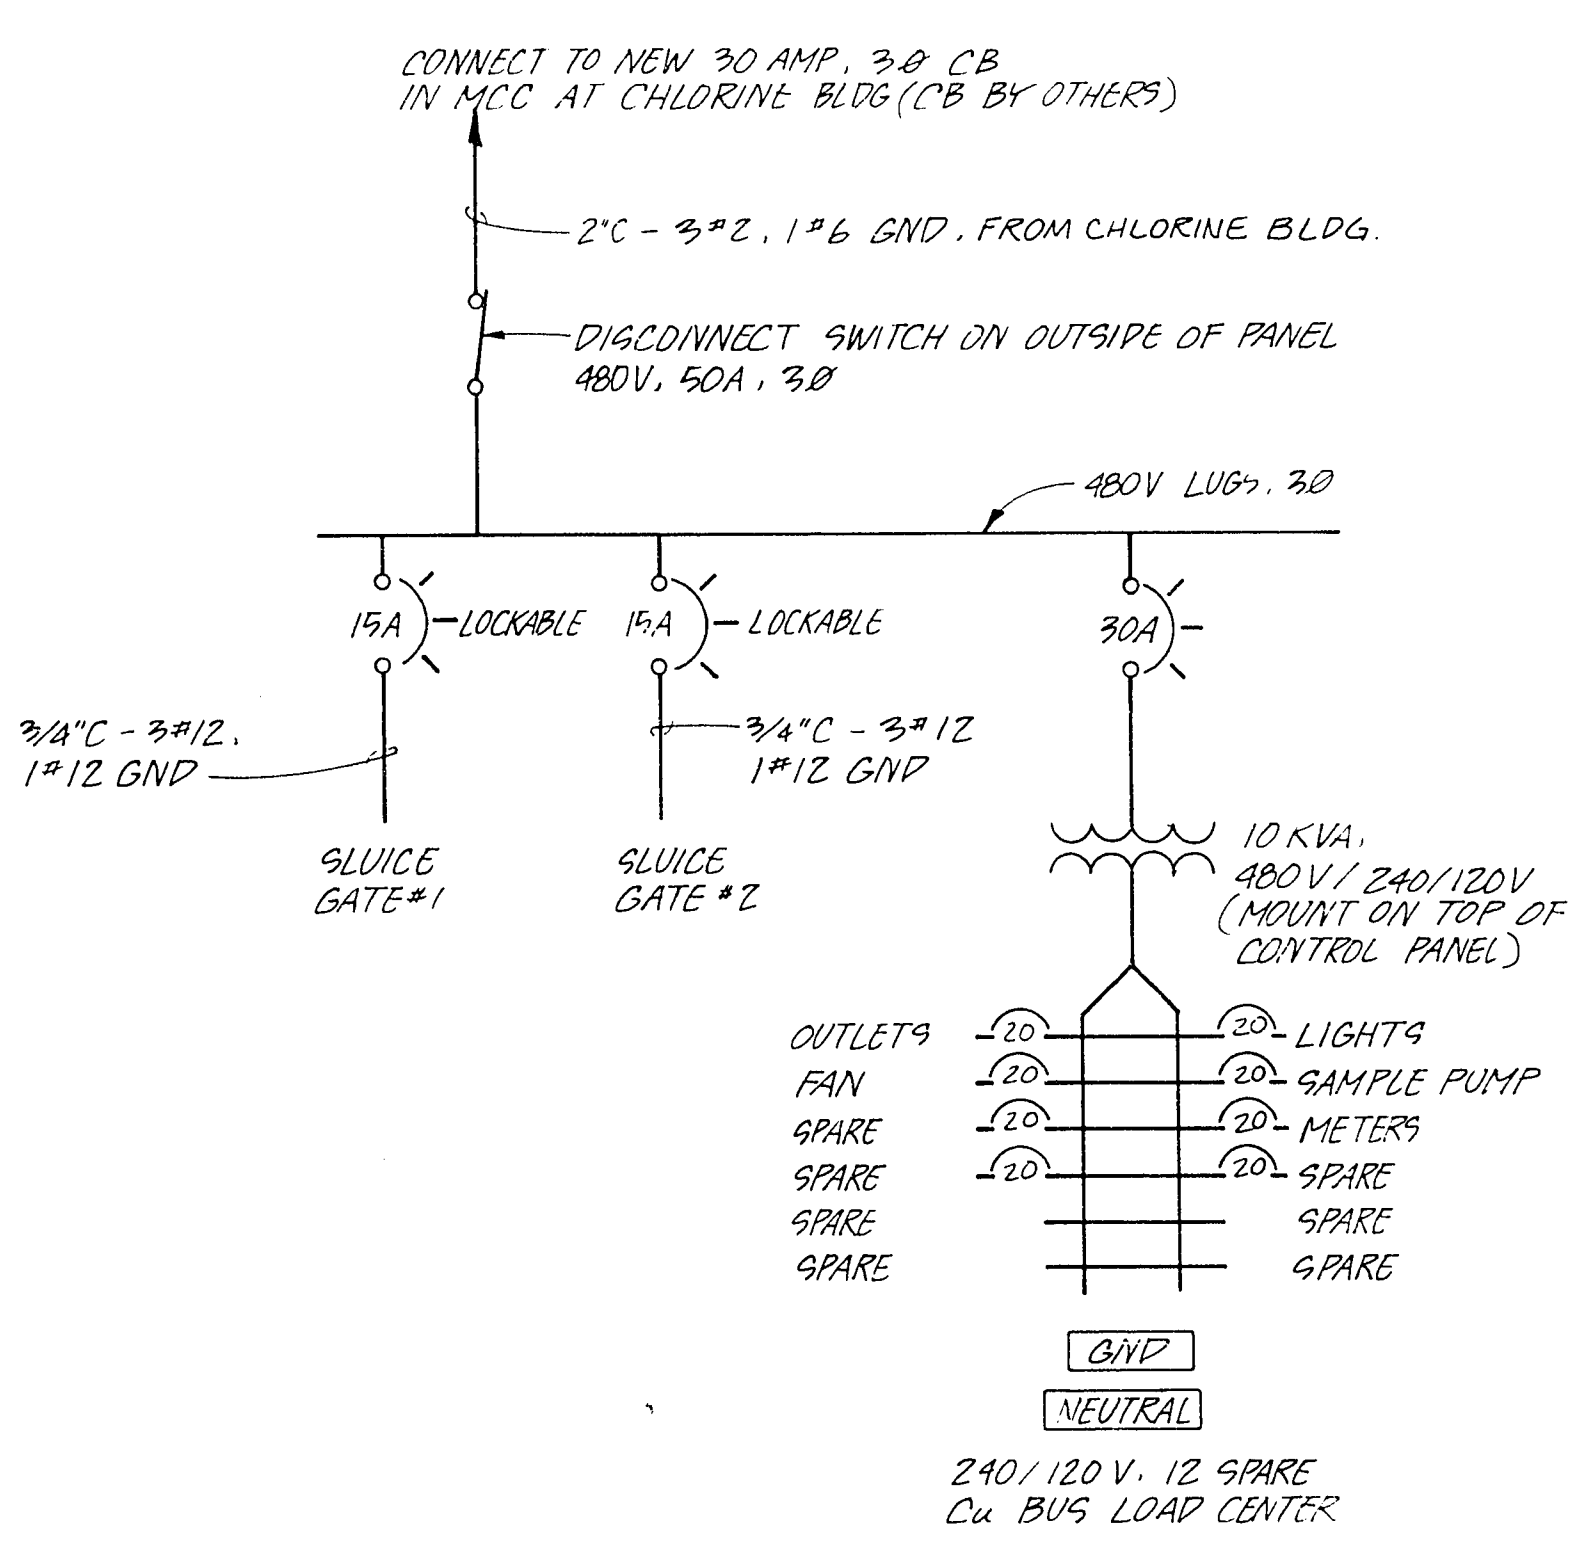


POWER PANEL, EFFLUENT SAMPLING BLDG. (B)
NTS
POWER PANEL, NEMA 3R
MIN SIZE 36" x 36" x 12" D
WALL MOUNTED, HINGED DOOR

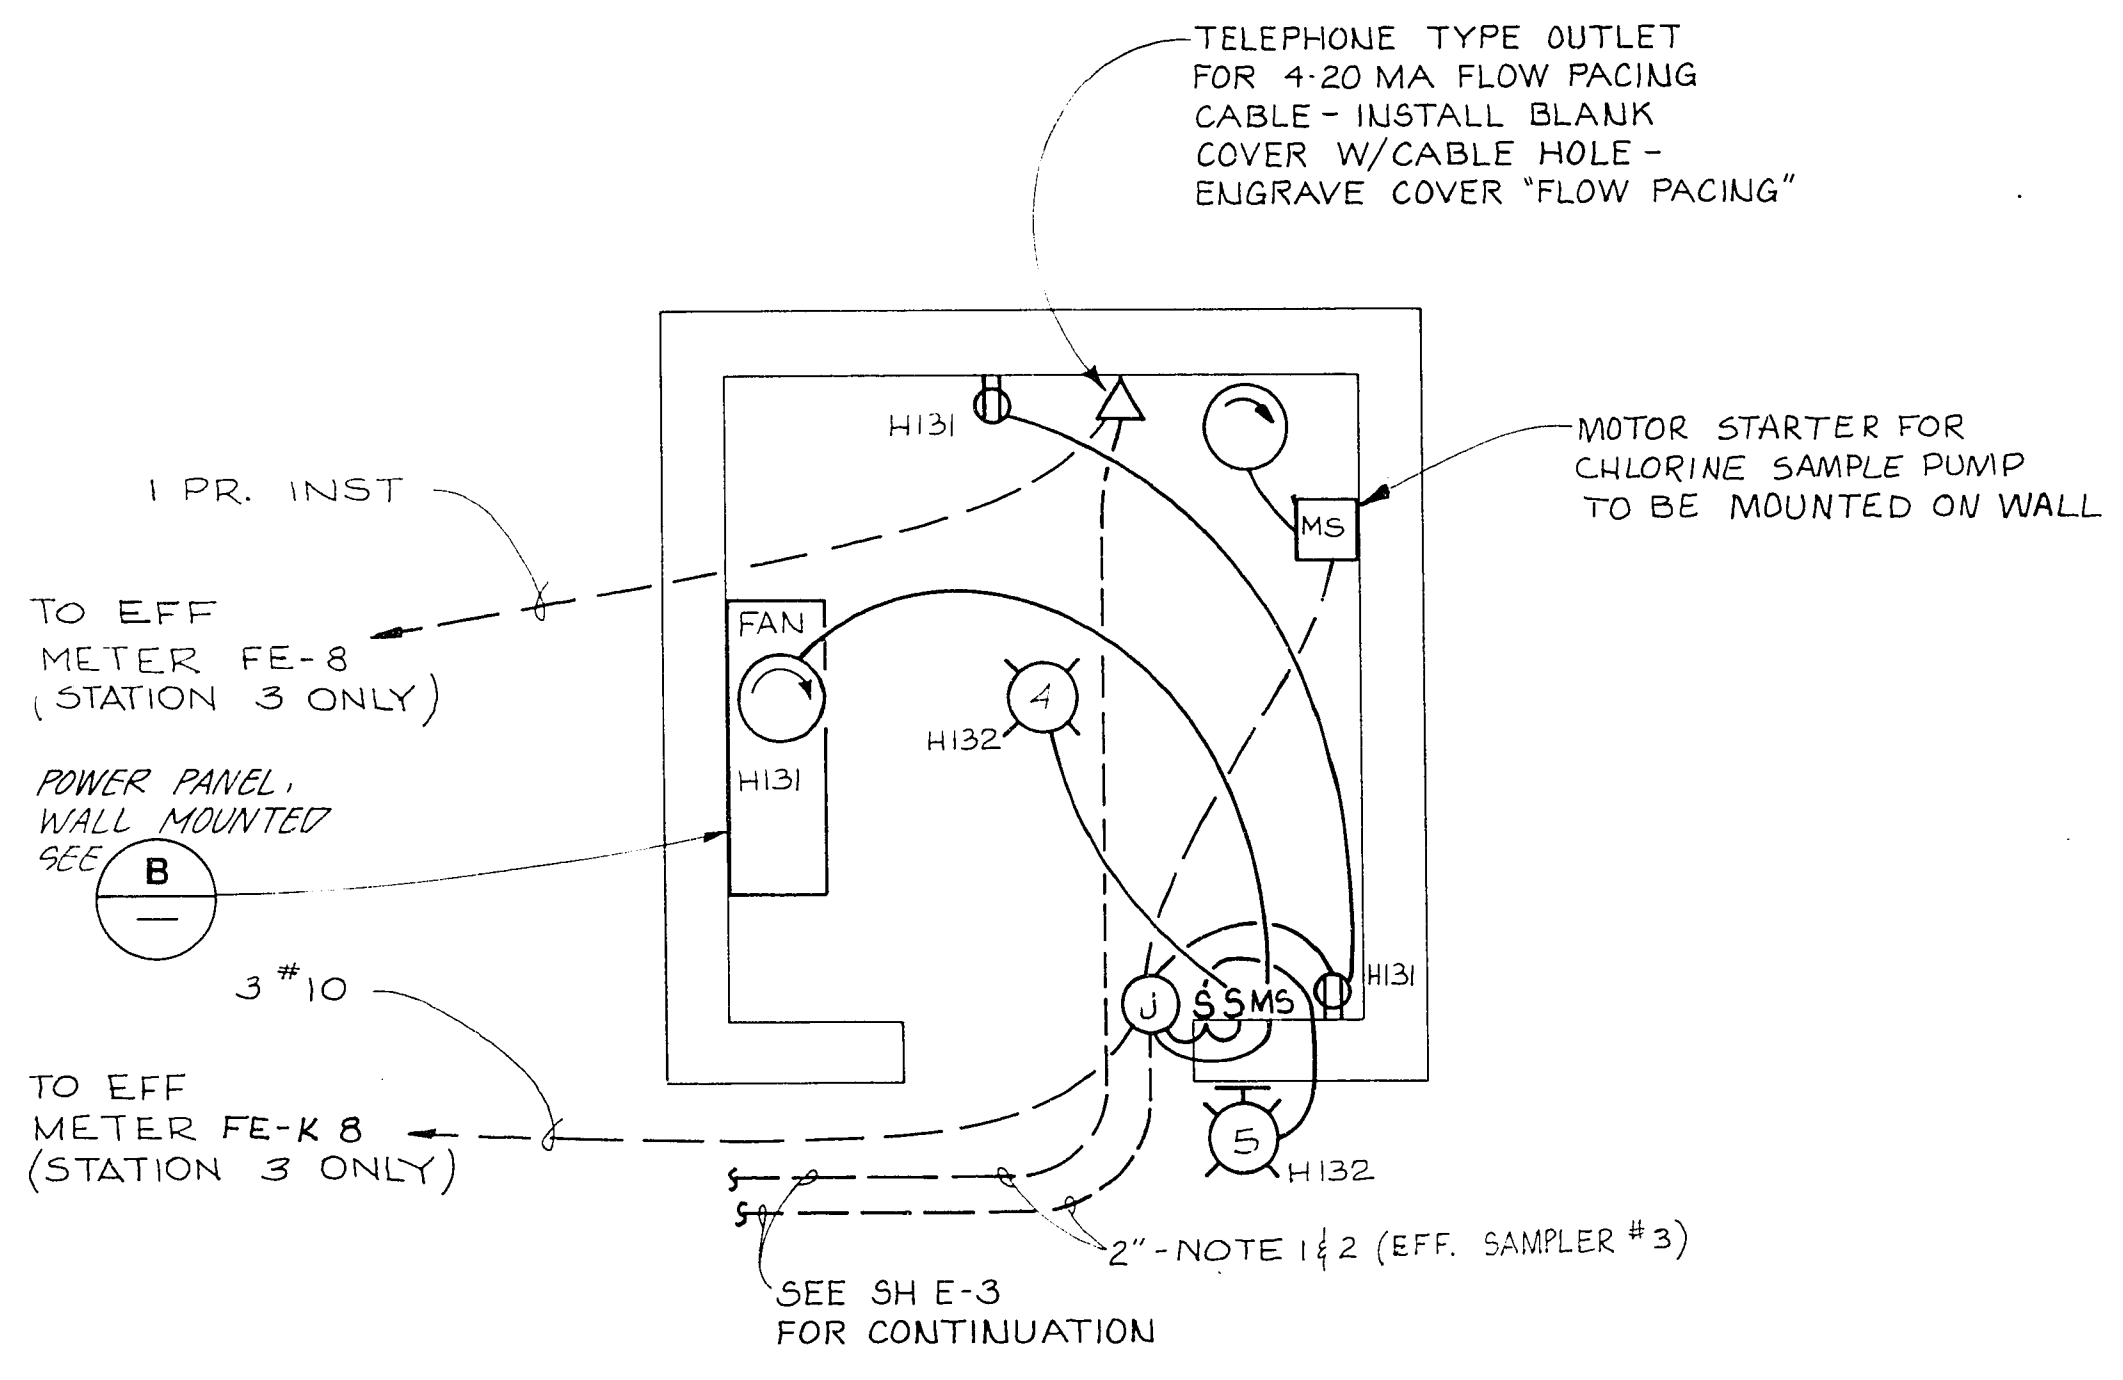


EFFLUENT SAMPLING BUILDING
(TYP OF 2)
1/2" = 1'-0"

NOTES: 1. 1-2" C WITH 3-1 PR INSTRUMENTATION. PULL WIRE TO RTU-1 IN CHLORINE BUILDING & CONNECT 1 PR TO RTU-1 ANALOG OUTPUT TERMINAL. 1-2" C (TYP FOR STA NO. 1) WITH POWER CIRCUITS FROM PANEL H IN CHLORINE BLDG. CONNECT WIRES TO PROPER CIRCUIT BREAKERS IN PANEL H.
2. 1-2" C WITH 3-1 PR INSTRUMENTATION. PULL WIRE TO RTU-1 IN CHLORINE BUILDING & CONNECT 1 PR TO RTU-1 ANALOG OUTPUT TERMINAL. CONNECT POWER CIRCUITS TO PANEL IN EXISTING CHLORINE BUILDING (120V). TYP FOR STA NO. 3

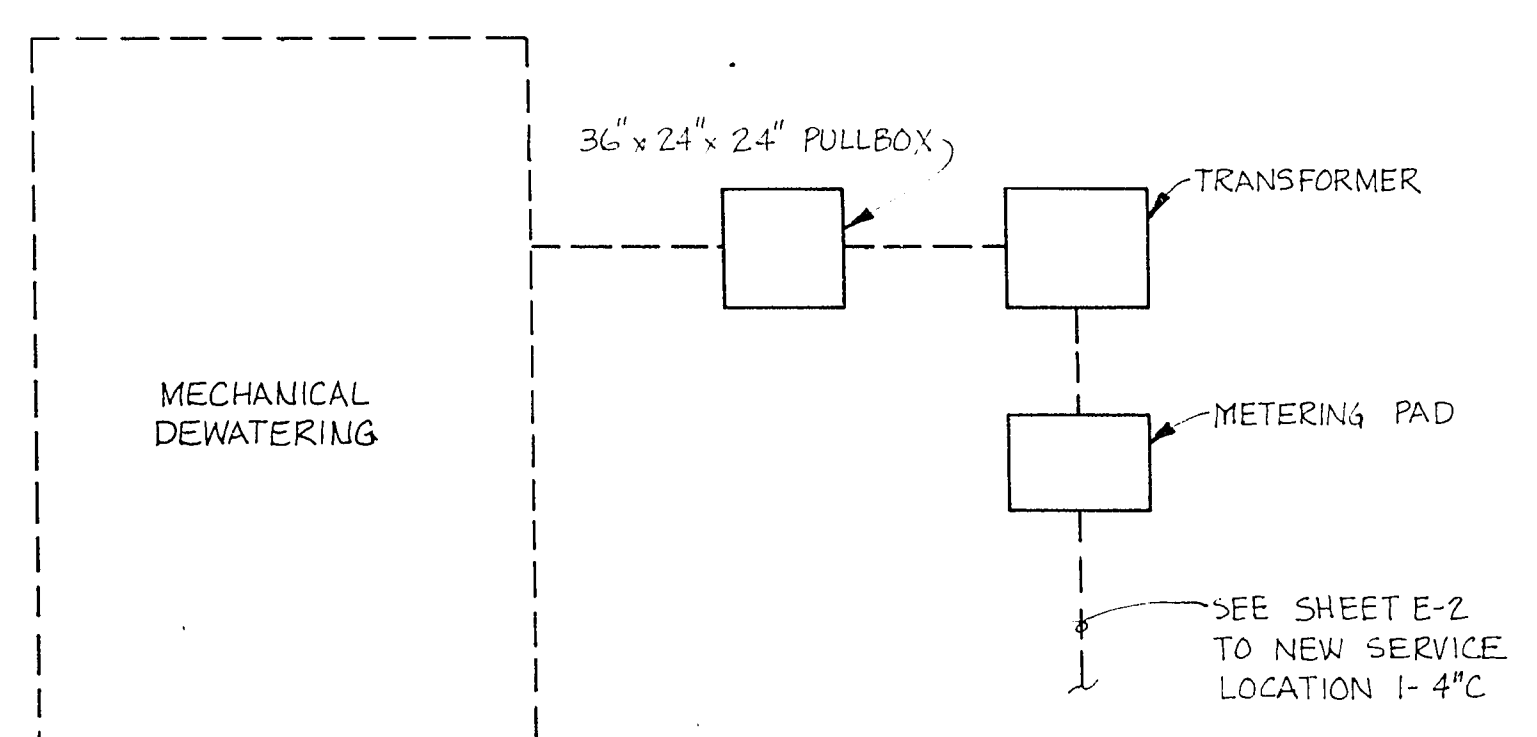

MECHANICAL DEWATERING BUILDING ELECTRICAL SERVICE

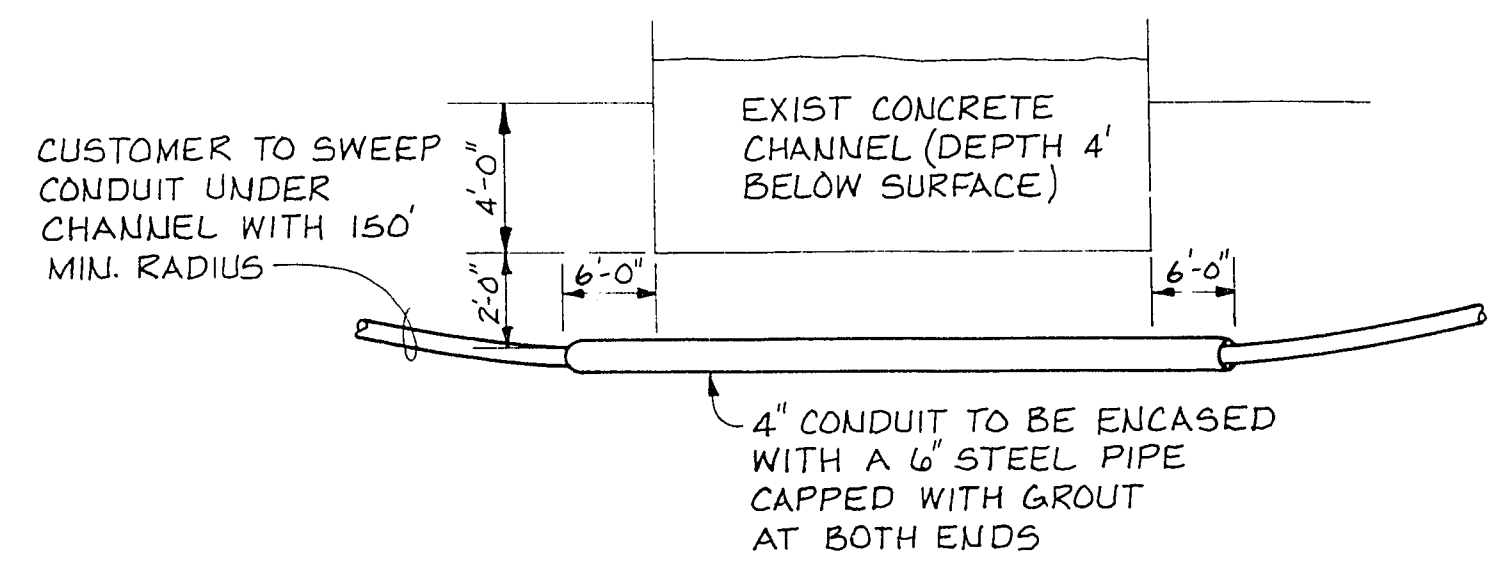

SECTION A
E2
NTS

CULP/WESNER/CULP
CAMERON PARK, CALIFORNIA
SANTA ANA, CALIFORNIA
DENVER, COLORADO

H P R
Professional Engineer
No. 557

STATE OF CALIFORNIA
DIVISION OF INDUSTRIAL RELATIONS
No. 557

Job No. 740.11
Designed WFE
Drawn DGC
Checked DJR
Approved DAP
Date 12/19/80

No.	By	Revision	Description	Date
1				
2				
3				
4				
5				
6				
7				
8				
9				
10				

City of Las Vegas
WASTEWATER TREATMENT PLANT
Main Plant Expansion
Contract No. 1

ELECTRICAL
SITE DETAILS

Sheet **152**
E-6
of 164

6-1-150 311.21