



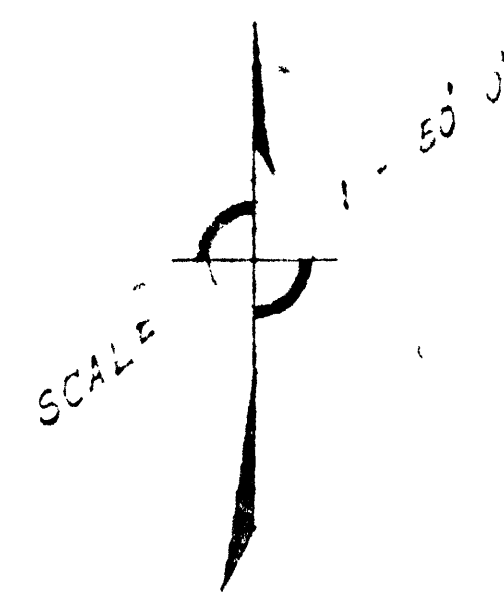

21-43

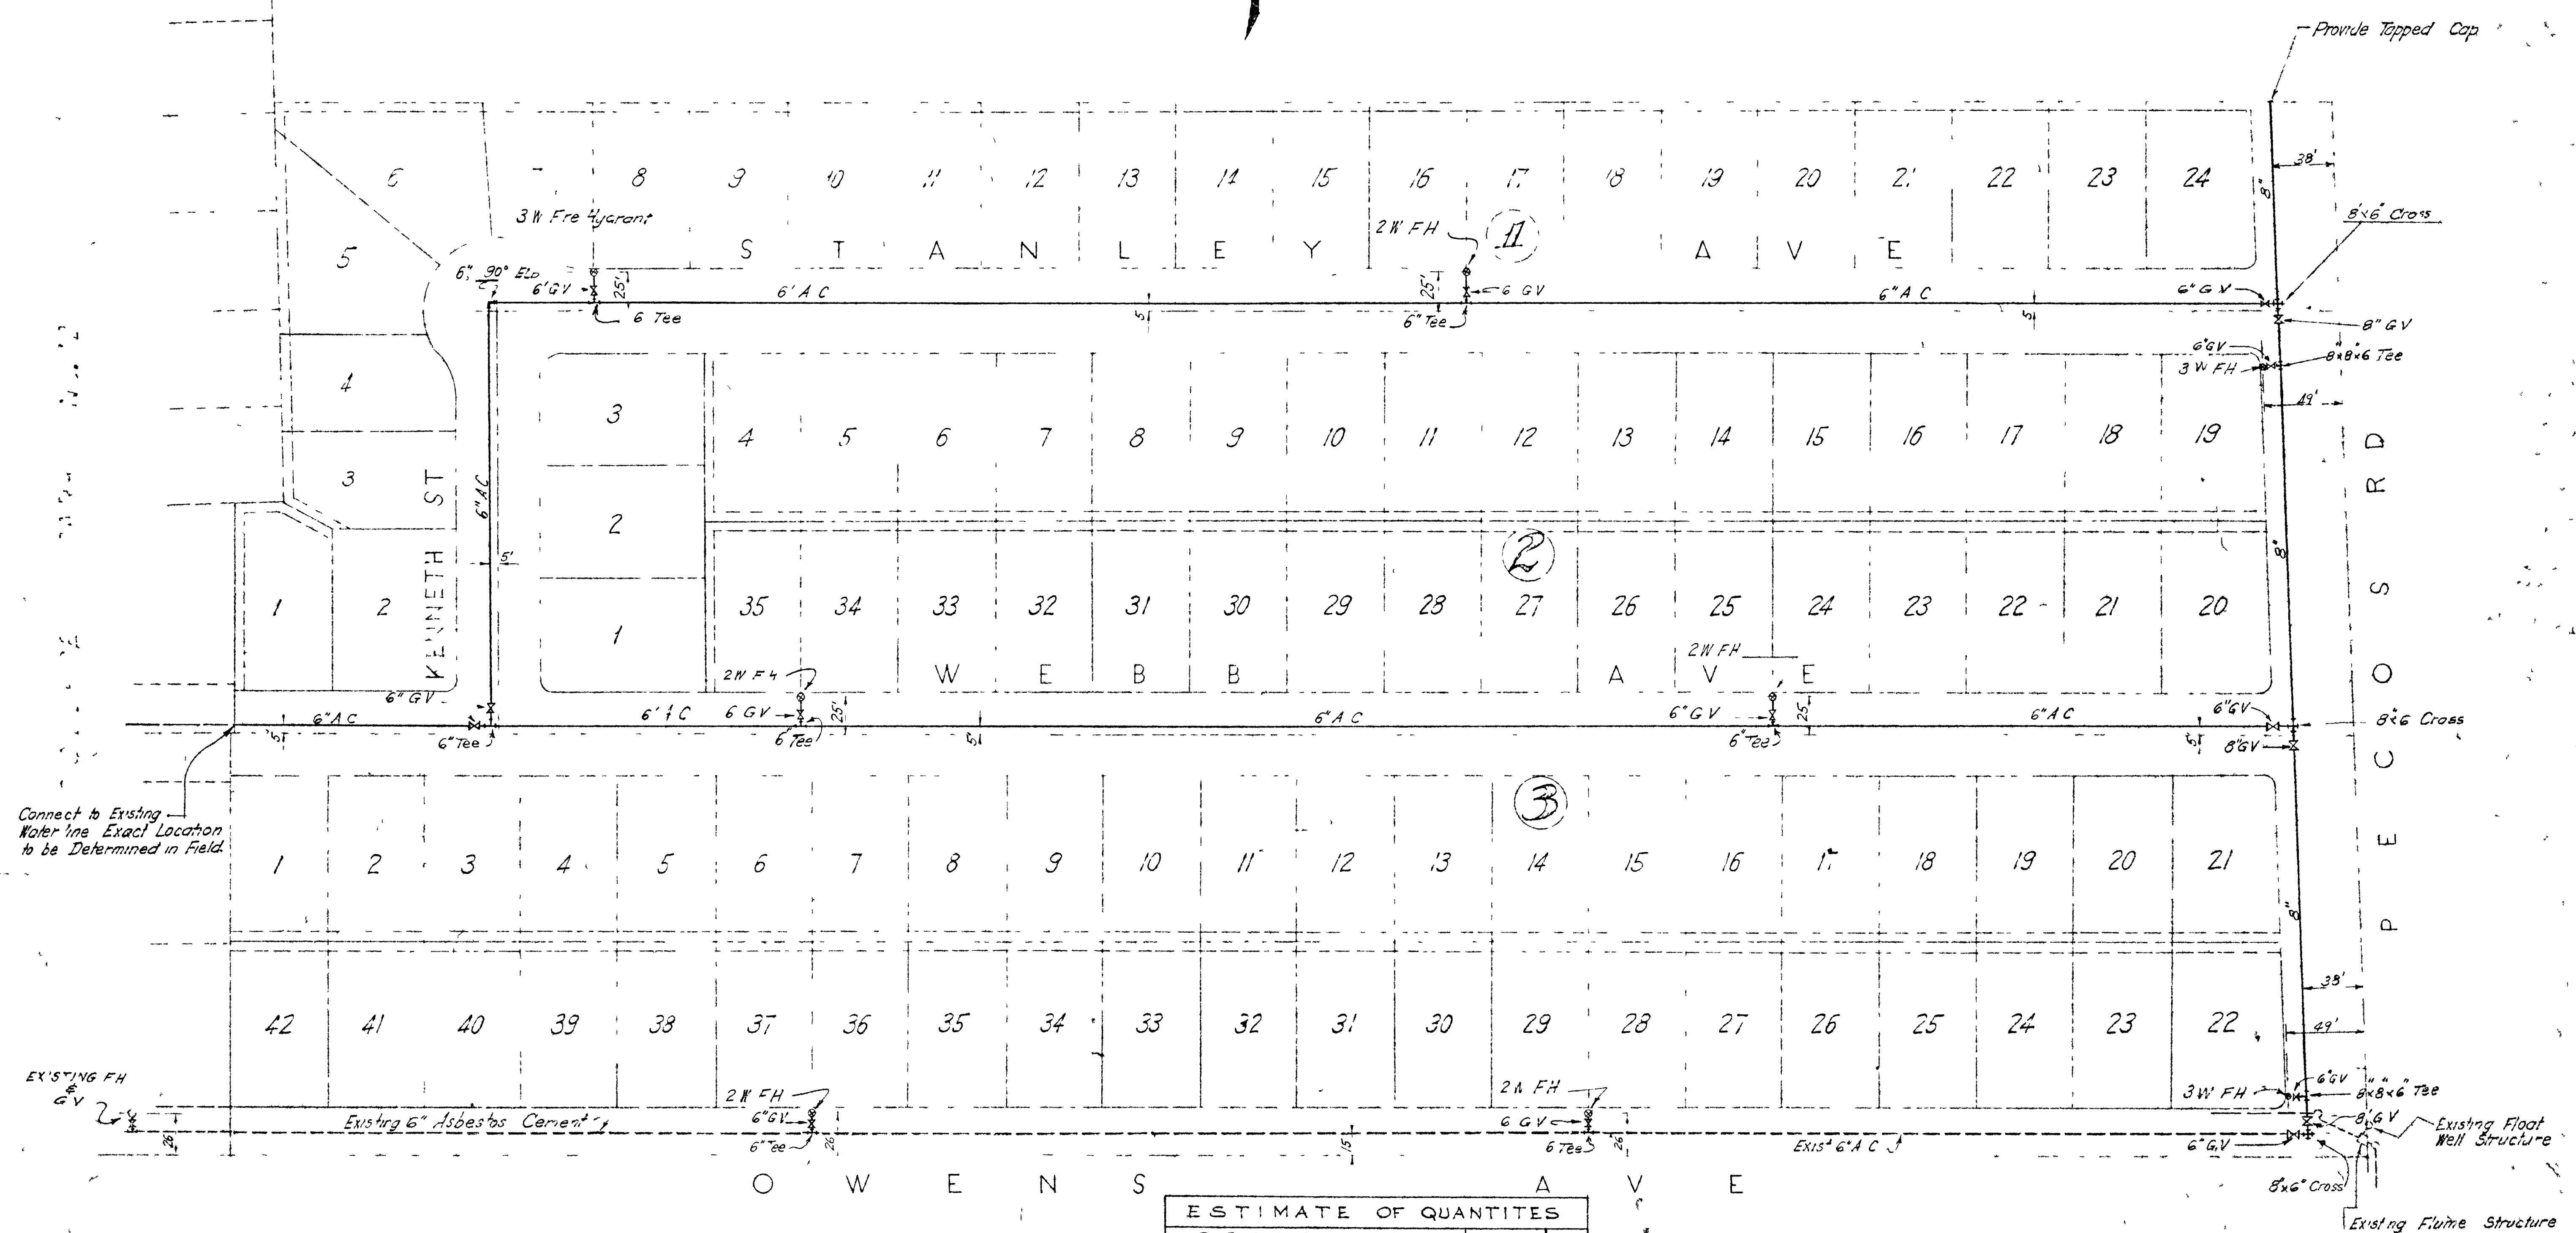

23-48

GENERAL NOTES

- 1 Construction Details Shall Conform to City of North Las Vegas Standard Drawings and Specifications
- 2 Fittings Shall be Cast Iron, Conforming to A.W.W.A Standard C-100 or C-110.

LEGEND

- 6" Existing Water Lines, Size as Shown
- 6" A.C. New Asbestos-Cement Pressure Pipe Class 150 Size as Shown
- Gate Valve, Hub End, Size as Shown
- Fire Hydrant, Mueller or Equal, With North Las Vegas Hose Thread
- 2 Way F.H. = 2-2 1/2" Nozzles & 6" Inlet
- 3 Way F.H. = 2-2 1/2" Nozzles, 1 pumper & 6" Inlet.


ESTIMATE OF QUANTITIES		
DESCRIPTION	QUANTITY	UNIT
6" Asbestos Cement Pipe	2644 ±	FT
6" Gate Valve	13	Each
6" Tee	7	Each
8" C.I. Valve Box and Cover	16	Each
2 Way F.H. Including Riser and 6" C.I. Lateral	5	Each
3 Way F.H. Including Riser and 6" C.I. Lateral	3	Each
8" C.I. Cap Including Archa Block	1	Each
8" x 6" Cross	3	Each
8" Asbestos Cement Pipe	636 ±	FT
8" x 6" Tee	2	Each
8" Gate Valve	3	Each
6" 90° Elbow	1	Each
Front Footage @ Property Line	6110	FT

APPROVAL	
DATE	
BY	
DATE	
BY	
CITY ENGINEER, NORTH LAS VEGAS	

PLAN	
WATER DISTRIBUTION	
COLLEGE PARK NO. 16	
CITY OF NORTH LAS VEGAS • NEVADA	
SCALE	1" = 50'
DATE	
PERLITER & SORING	ENGINEERS
LOS ANGELES	OF

777.1-36 (F.P.)

21-43

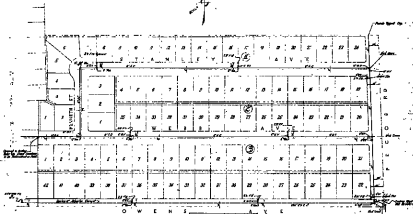

GENERAL NOTES

- 1. ALL WORK SHALL BE IN ACCORDANCE WITH THE LATEST EDITIONS OF THE STANDARD SPECIFICATIONS FOR HIGHWAYS, BRIDGES AND STRUCTURES, AND THE STANDARD SPECIFICATIONS FOR WATER SUPPLY SYSTEMS, PUBLISHED BY THE NORTH CAROLINA DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS.
- 2. ALL MATERIALS AND WORKMANSHIP SHALL BE SUBJECT TO INSPECTION AND APPROVAL BY THE DISTRICT ENGINEER.
- 3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND RIGHTS-OF-WAY.
- 4. THE CONTRACTOR SHALL MAINTAIN ACCESS TO ALL ADJACENT PROPERTIES AT ALL TIMES.
- 5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING UTILITIES AND STRUCTURES.
- 6. THE CONTRACTOR SHALL MAINTAIN ADEQUATE DRAINAGE DURING CONSTRUCTION.
- 7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL DEBRIS AND EXCESS MATERIAL.
- 8. THE CONTRACTOR SHALL MAINTAIN ADEQUATE EROSION CONTROL MEASURES.
- 9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL TREES AND PLANTS.
- 10. THE CONTRACTOR SHALL MAINTAIN ADEQUATE SAFETY MEASURES DURING CONSTRUCTION.
- 11. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL ADJACENT PROPERTIES.
- 12. THE CONTRACTOR SHALL MAINTAIN ADEQUATE RECORDS OF ALL WORK.
- 13. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING UTILITIES AND STRUCTURES.
- 14. THE CONTRACTOR SHALL MAINTAIN ADEQUATE DRAINAGE DURING CONSTRUCTION.
- 15. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL DEBRIS AND EXCESS MATERIAL.
- 16. THE CONTRACTOR SHALL MAINTAIN ADEQUATE EROSION CONTROL MEASURES.
- 17. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL TREES AND PLANTS.
- 18. THE CONTRACTOR SHALL MAINTAIN ADEQUATE SAFETY MEASURES DURING CONSTRUCTION.
- 19. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL ADJACENT PROPERTIES.
- 20. THE CONTRACTOR SHALL MAINTAIN ADEQUATE RECORDS OF ALL WORK.

- 1. ALL WORK SHALL BE IN ACCORDANCE WITH THE LATEST EDITIONS OF THE STANDARD SPECIFICATIONS FOR HIGHWAYS, BRIDGES AND STRUCTURES, AND THE STANDARD SPECIFICATIONS FOR WATER SUPPLY SYSTEMS, PUBLISHED BY THE NORTH CAROLINA DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS.
- 2. ALL MATERIALS AND WORKMANSHIP SHALL BE SUBJECT TO INSPECTION AND APPROVAL BY THE DISTRICT ENGINEER.
- 3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND RIGHTS-OF-WAY.
- 4. THE CONTRACTOR SHALL MAINTAIN ACCESS TO ALL ADJACENT PROPERTIES AT ALL TIMES.
- 5. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING UTILITIES AND STRUCTURES.
- 6. THE CONTRACTOR SHALL MAINTAIN ADEQUATE DRAINAGE DURING CONSTRUCTION.
- 7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL DEBRIS AND EXCESS MATERIAL.
- 8. THE CONTRACTOR SHALL MAINTAIN ADEQUATE EROSION CONTROL MEASURES.
- 9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL TREES AND PLANTS.
- 10. THE CONTRACTOR SHALL MAINTAIN ADEQUATE SAFETY MEASURES DURING CONSTRUCTION.
- 11. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL ADJACENT PROPERTIES.
- 12. THE CONTRACTOR SHALL MAINTAIN ADEQUATE RECORDS OF ALL WORK.
- 13. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING UTILITIES AND STRUCTURES.
- 14. THE CONTRACTOR SHALL MAINTAIN ADEQUATE DRAINAGE DURING CONSTRUCTION.
- 15. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL OF ALL DEBRIS AND EXCESS MATERIAL.
- 16. THE CONTRACTOR SHALL MAINTAIN ADEQUATE EROSION CONTROL MEASURES.
- 17. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL TREES AND PLANTS.
- 18. THE CONTRACTOR SHALL MAINTAIN ADEQUATE SAFETY MEASURES DURING CONSTRUCTION.
- 19. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL ADJACENT PROPERTIES.
- 20. THE CONTRACTOR SHALL MAINTAIN ADEQUATE RECORDS OF ALL WORK.

ESTIMATE OF MATERIALS	
ITEM	QUANTITY
1. GRAVEL	1000
2. SAND	500
3. CEMENT	100
4. IRON	50
5. STEEL	100
6. BRICK	1000
7. CONCRETE	1000
8. ASPHALT	1000
9. PAINT	100
10. LUMBER	1000
11. GLASS	100
12. ROOFING	100
13. INSULATION	100
14. PLASTER	100
15. GYPSUM	100
16. PUTTY	100
17. ADHESIVE	100
18. SEALANT	100
19. FINISH	100
20. TOTAL	10000

APPROVAL	
DATE	
BY	
FOR	
BY	
FOR	
BY	
FOR	
BY	
FOR	
BY	
FOR	

PLAN	
DATE	
BY	
FOR	
BY	
FOR	
BY	
FOR	
BY	
FOR	
BY	
FOR	