

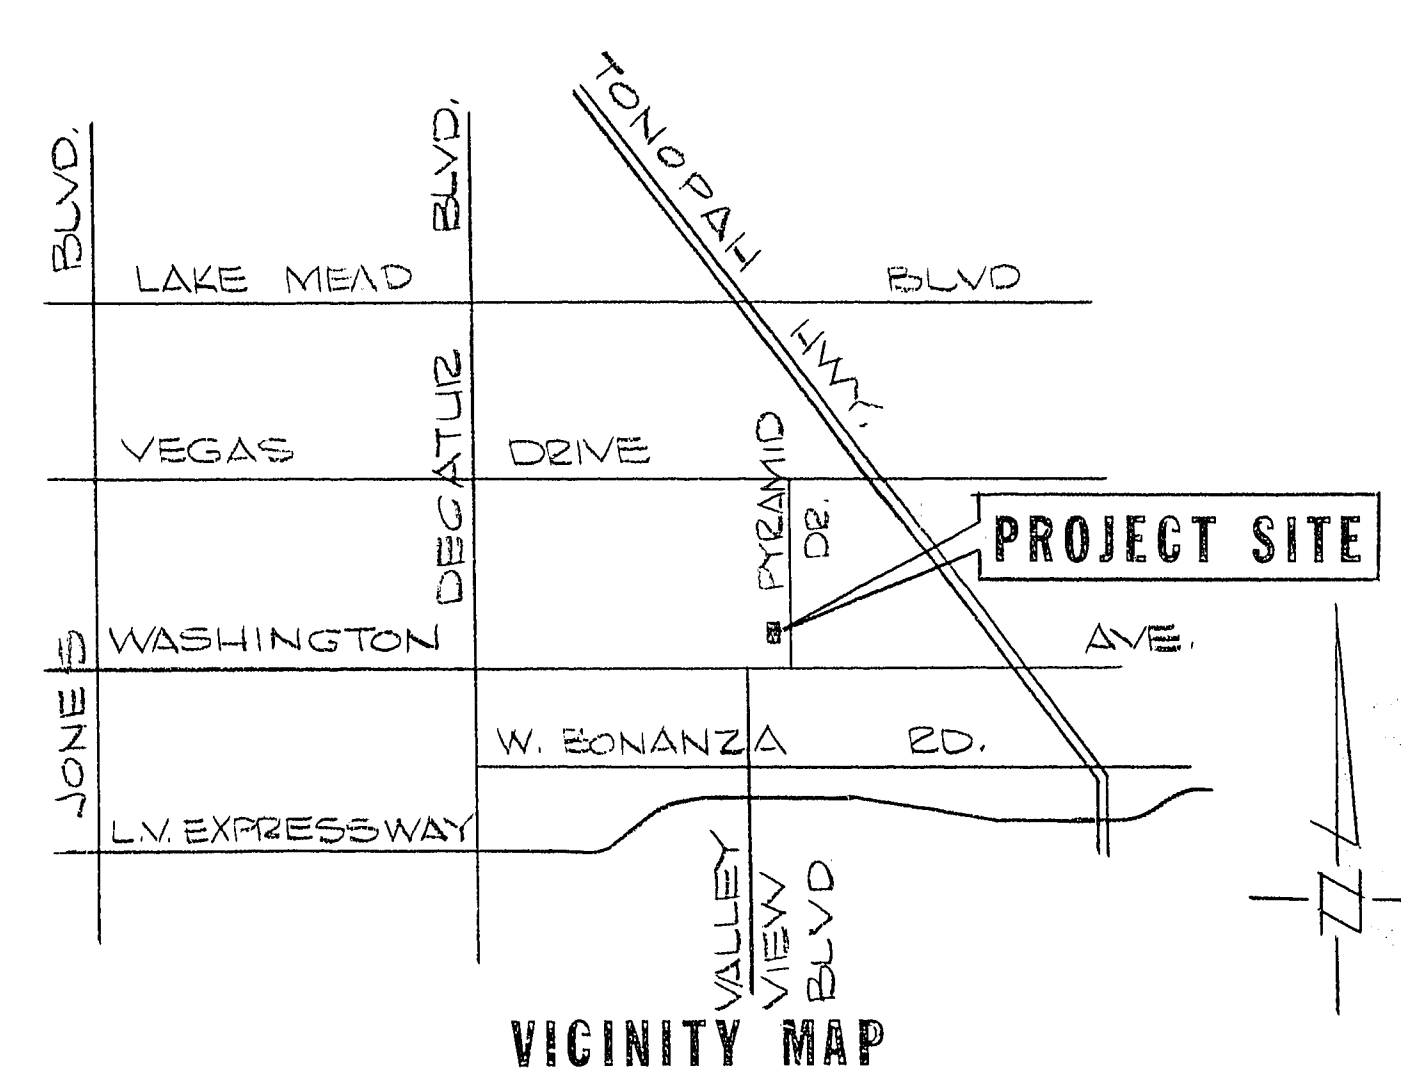



405.020

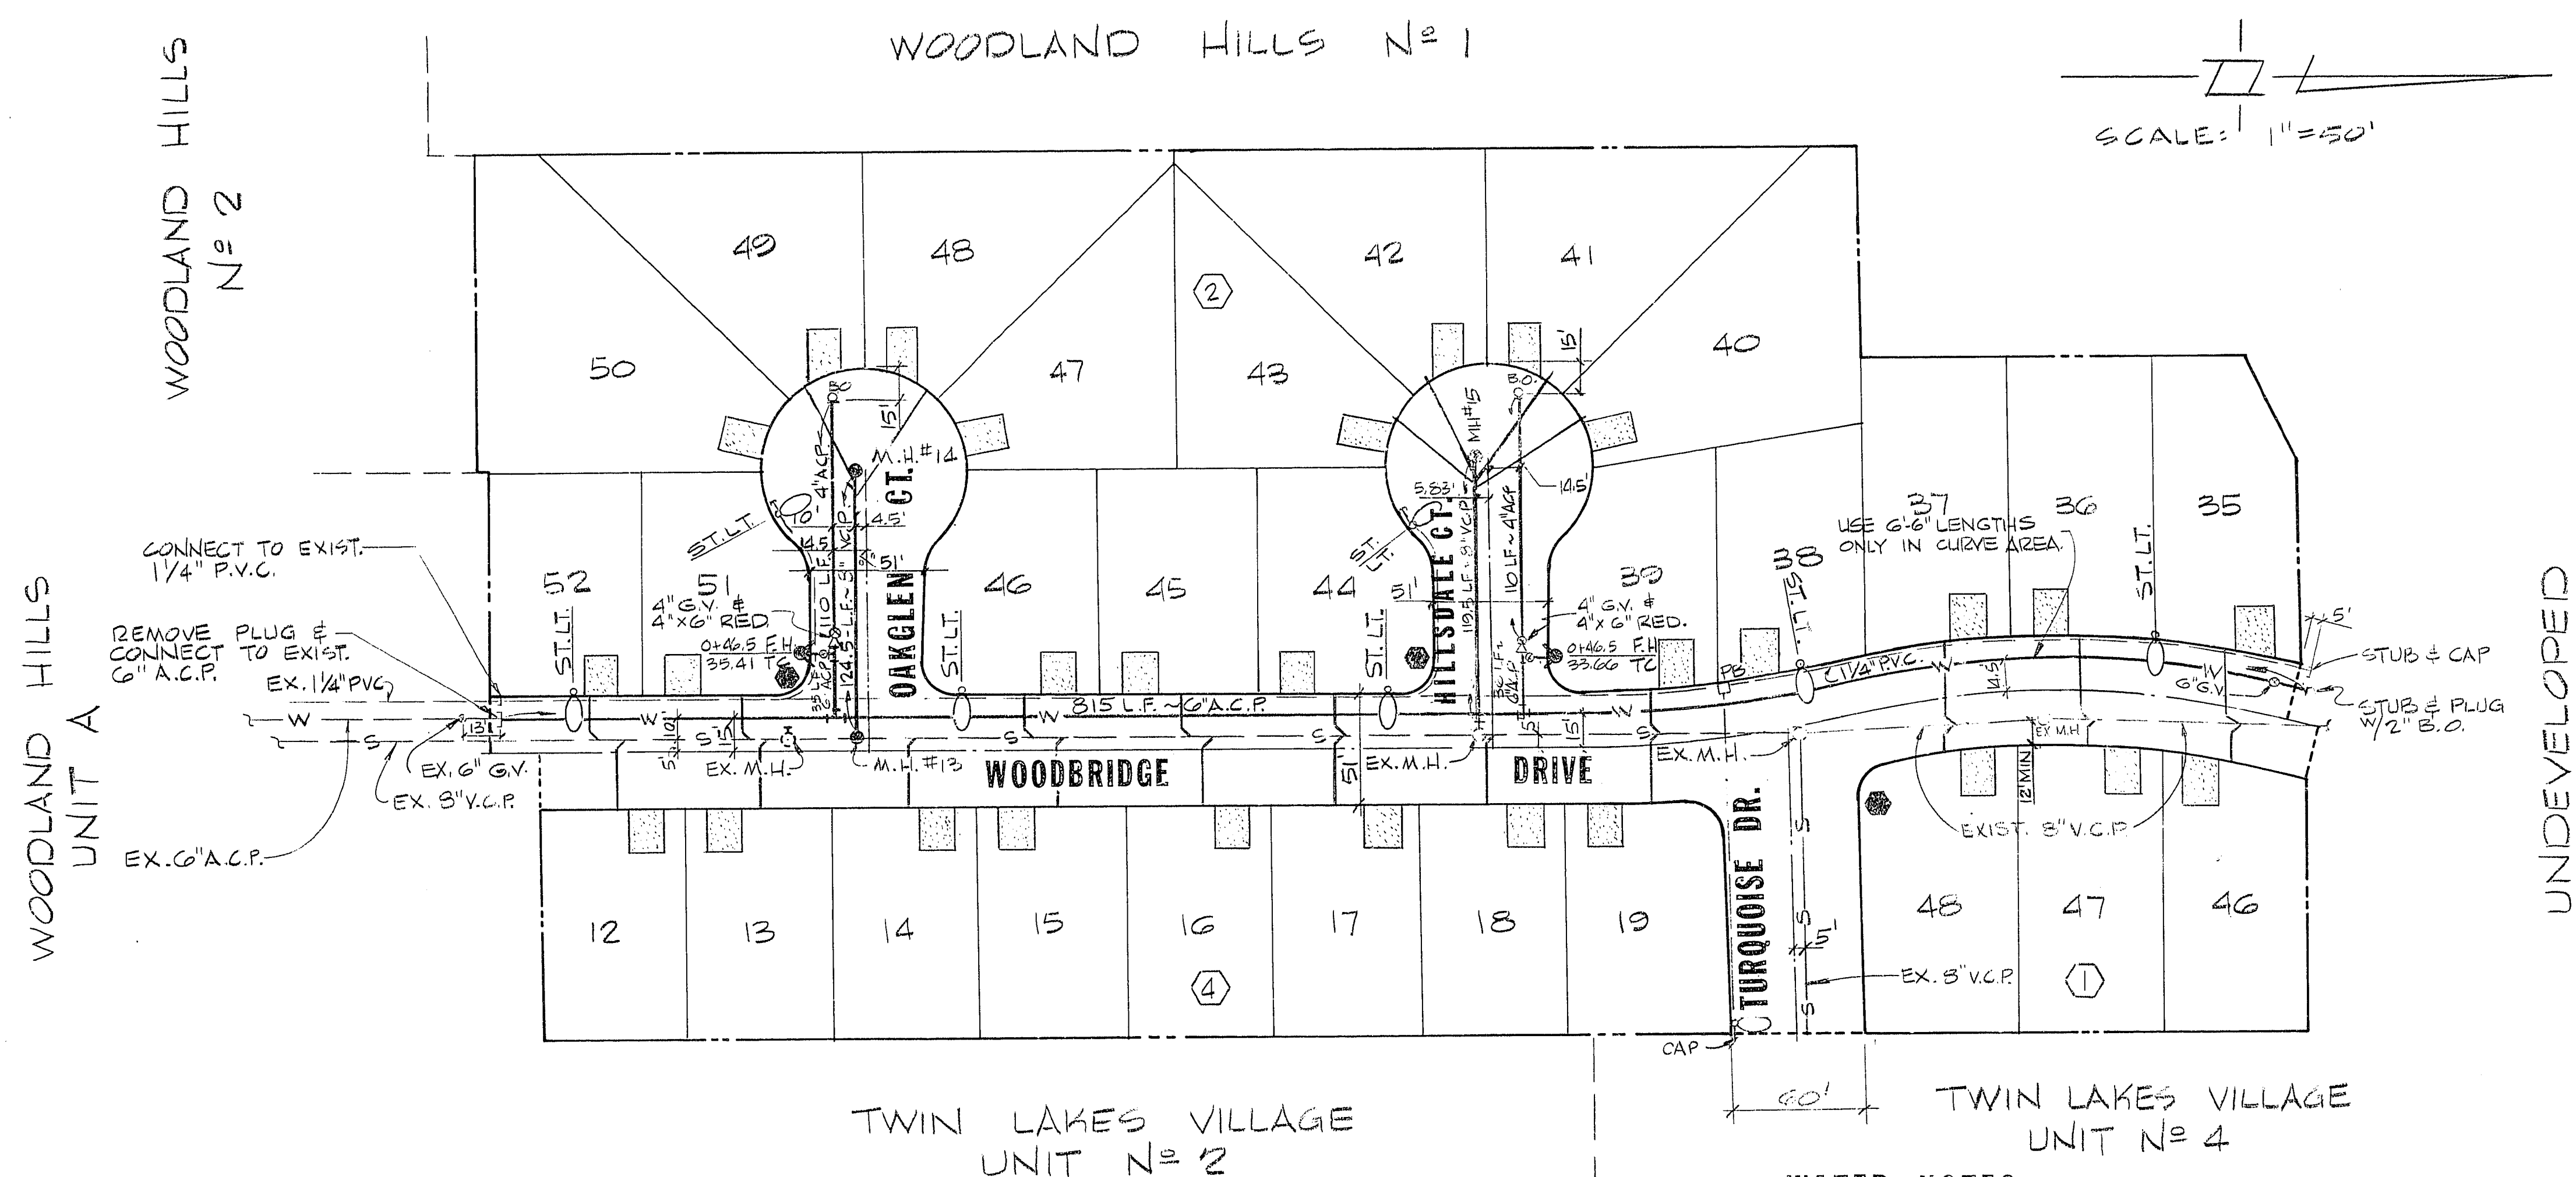

- LEGEND**
- FIRE HYDRANT w/GATE VALVE
 - EXIST. SEWER MANHOLE & SEWER
 - 250 W. LUMINAIRE w/11 GA. POLE
 - 100 W. LUMINAIRE w/11 GA. POLE (SEE ST. LIGHT NOTES, SHT. 4)
 - 1/4" PVC ST. LT. CONDUIT
 - GATE VALVE
 - WATER LINE
 - SEWER LINE
 - STREET & STOP SIGN
 - SEWER LATERAL
 - DRIVEWAY
 - PULL BOX
- NOTES:**
- STREET LIGHTS SERVICE WIRE TO BE 2-2's & 1-#6.
 - ALL FIELD WIRE TO BE 2-#4's (THW)
 - INSTALL SEWER MANHOLE COLLAR PER STD. DWG.

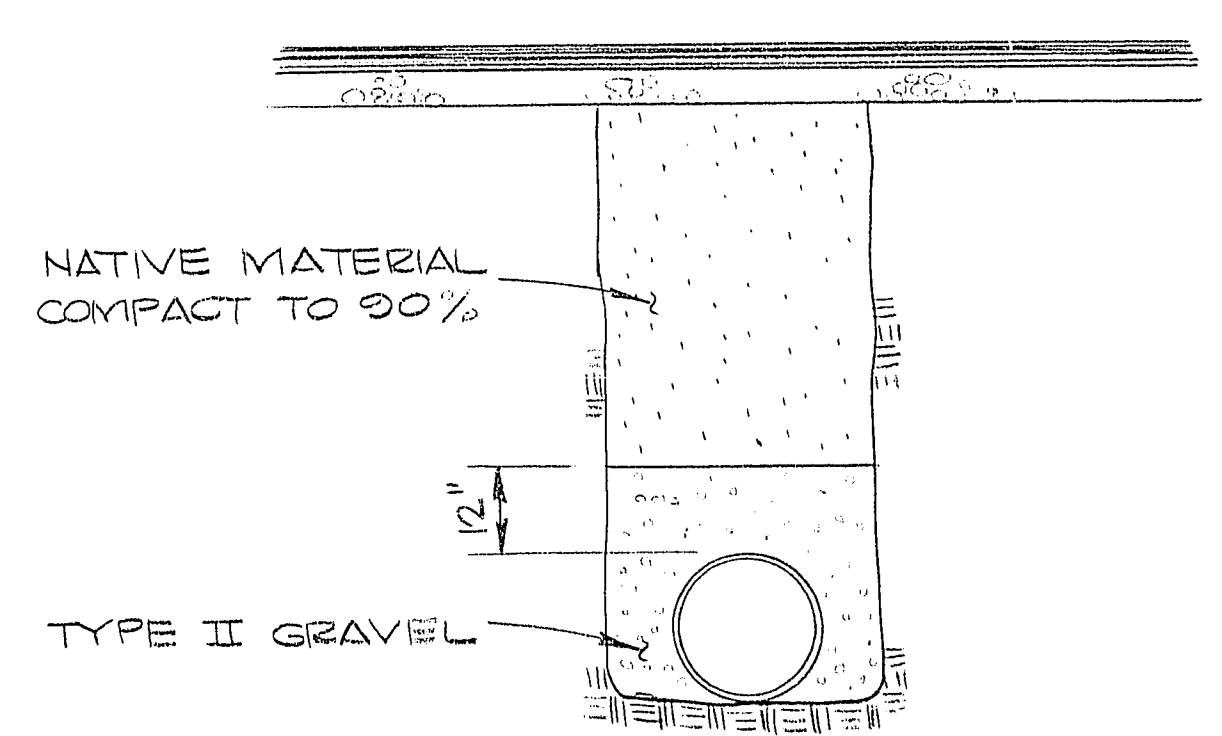

TYP. TRENCH SECTION
FOR SEWER ONLY

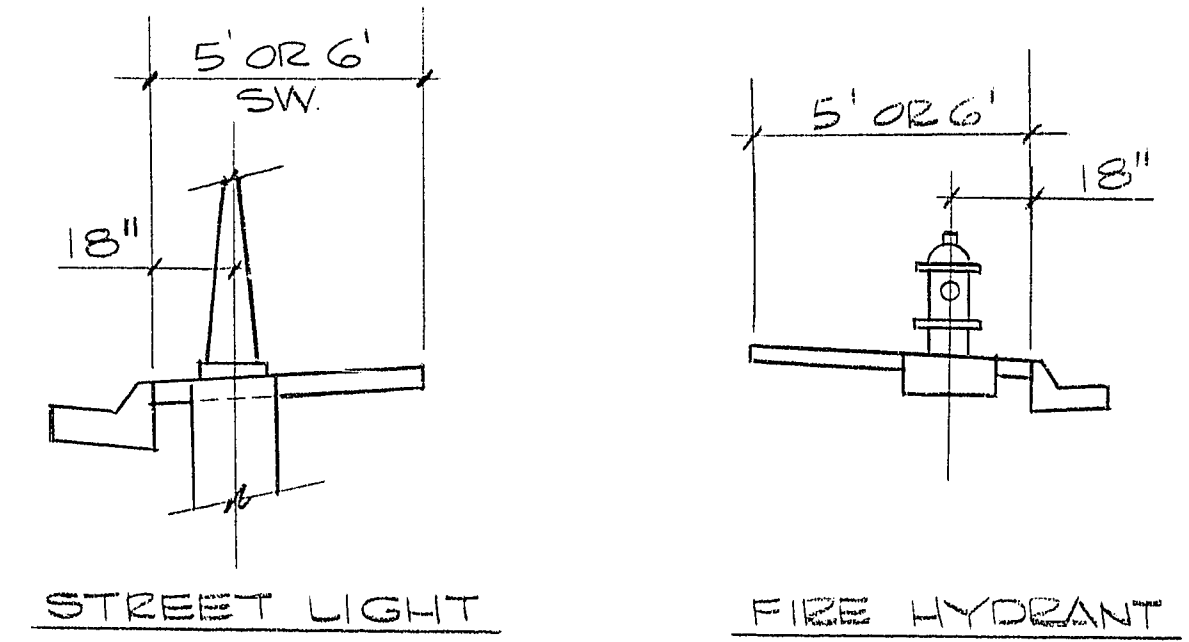

ST. LIGHT & FIRE HYDRANT LOCATION DETAIL

ESTIMATE OF WATER QUANTITIES

STD. F.H. w/6" G.V. & 6" A.C.P. LATERAL	2 EA.
6" A.C.P.	800 L.F.
6" GATE VALVE w/VALVE BOX & COVER	1 EA.
4" A.C.P.	220 L.F.
4" GATE VALVE w/VALVE BOX & COVER	2 EA.
METER BOX	20 EA.
3/4" SERVICE	20 EA.
2" BLOW-OFF	3 EA.

Nevada Power Company approves the point of service to the street light system. This shall not be deemed to constitute the placement of the light poles which may be in conflict with Nevada Power Company's prior rights and/or facilities.

Michael B. Coleman
NEVADA POWER COMPANY

APPROVALS

[Signature] 1/27/79
LAS VEGAS CITY ENGINEER DATE

[Signature] 1-29-79
CITY OF LAS VEGAS FIELD ENGINEER DATE

[Signature] 1-19-79
CITY OF LAS VEGAS ELECTRICIAN DATE

[Signature] 1/18/79
CITY OF LAS VEGAS ELECTRICAL COORDINATOR DATE

[Signature] 1-27-79
CITY OF LAS VEGAS SANITATION SUPT. DATE

[Signature] 7-24-79
NEVADA POWER COMPANY DATE

[Signature] 2-13-79
LAS VEGAS VALLEY WATER DISTRICT DATE

[Signature] 1-27-79
CITY OF LAS VEGAS FIRE DEPARTMENT DATE

[Signature] 1-27-79
QUALITY CONTROL ENGINEER DATE

RECOMMENDED BY G.C. WALLACE	DATE 1/27/79	DESCRIPTION SECURITY HOUSING WOODLAND HILLS UNIT B UTILITY PLAN
G.C. WALLACE Consulting Engineers, Inc.		SHEET 5 OF 2 SHEETS
1100 East Sahara Ave. • Las Vegas, Nevada 89104 • 732-3330		

17.9-57 307.3358 0