


**IMPROVED INLET - RCB @ STA 62+21.00**

SCALE: HORIZ. 1/4" = 1'-0"  
VERT. 1/4" = 1'-0"


**NOTES**

1. PROVIDE REINFORCEMENT PER NDOT STANDARD B-20.1.3(502) FOR A DOUBLE 12' X 10' RCB WITH 20' OF EARTH COVER FOR BOTH THE DOUBLE 12' X 10' RCB AND THE 50'-0" IMPROVED INLET.
2. THIS DRAWING IS INTENDED TO SHOW ONLY THE BASIC BOX DIMENSIONS AND CONCRETE THICKNESS OF THE 12' X 10' DOUBLE RCB AND THE 50'-0" IMPROVED INLET TRANSITION. **IMPORTANT NOTICE: CONCRETE THICKNESS OF THE EXTERIOR WALLS HAVE BEEN ADJUSTED TO 1'-1 1/2" THICK FOR AN EARTH COVER GREATER THAN 20 FEET AT THIS LOCATION. CONCRETE SHALL ATTAIN A MINIMUM COMPRESSIVE STRESS OF 4000 PSI AT 28 DAYS. CEMENT FOR ALL CONCRETE SHALL BE TYPE V, HIGH SULFATE RESISTANT. SEE CIVIL DRAWINGS FOR INFORMATION NOT SHOWN.**

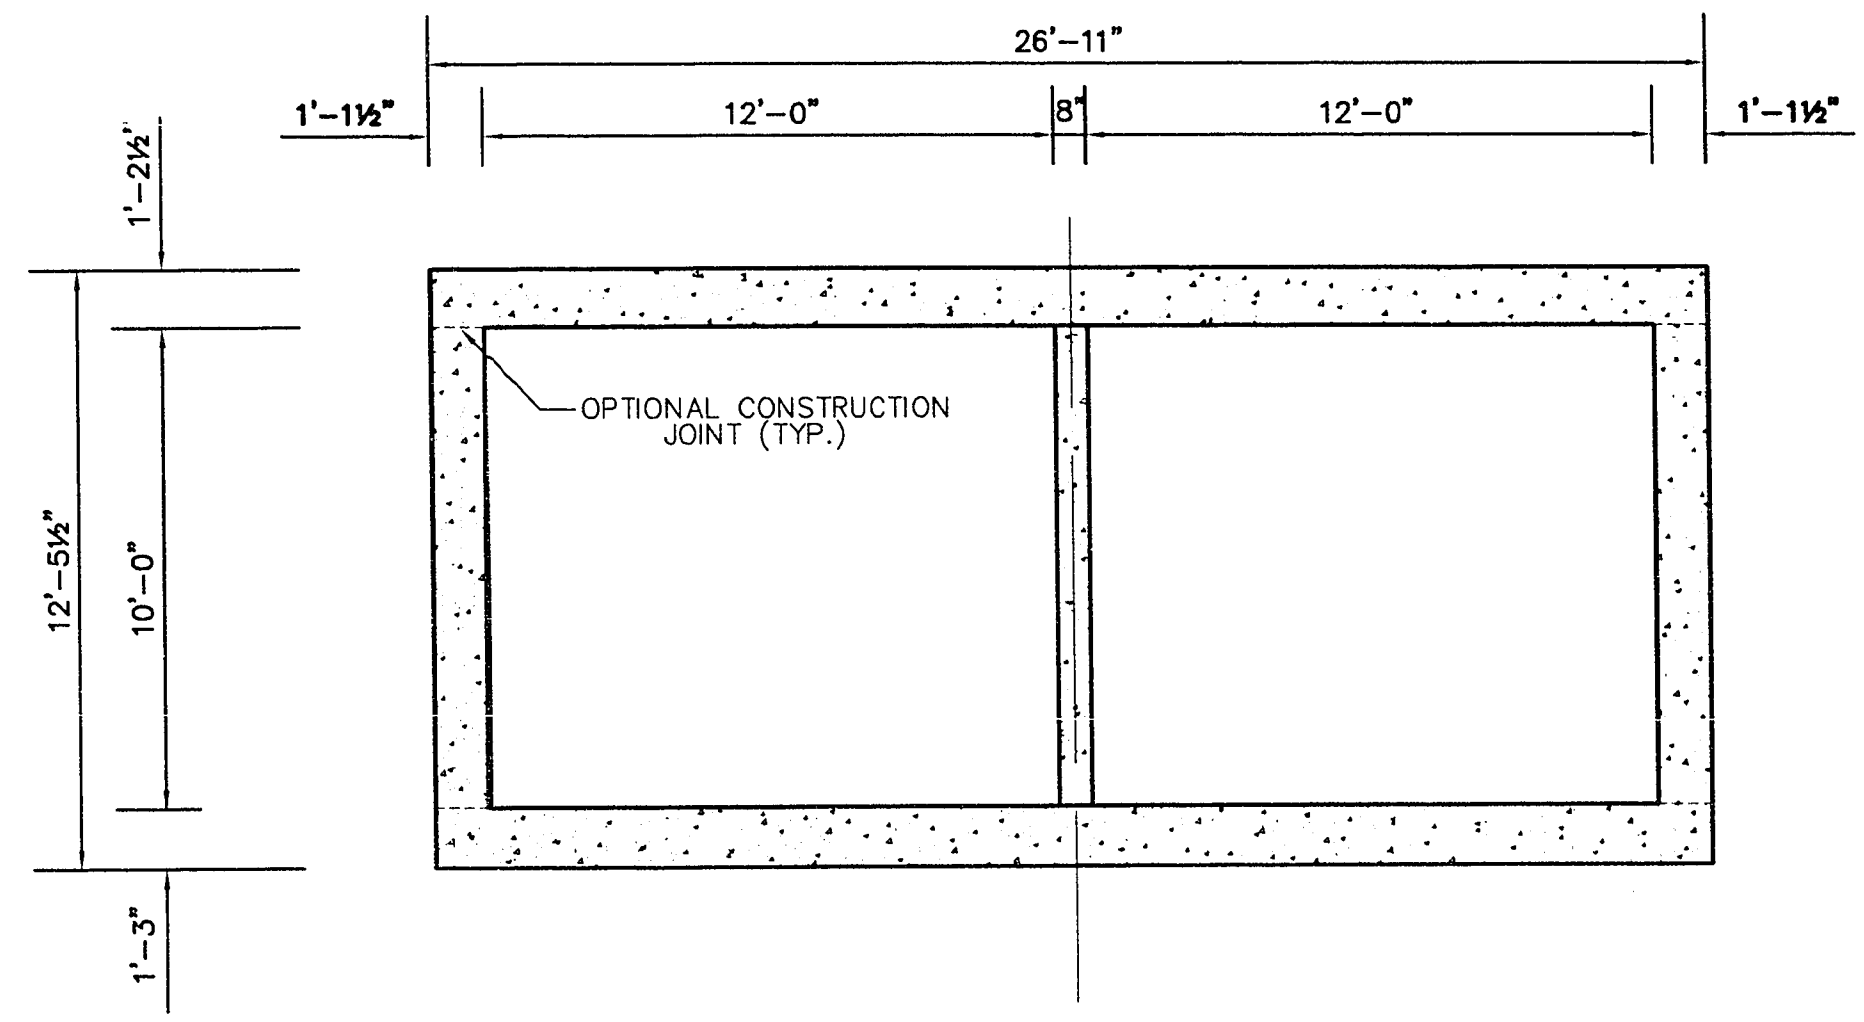


**SECTION B**

SCALE: HORIZ. 1/4" = 1'-0"  
VERT. 1/4" = 1'-0"

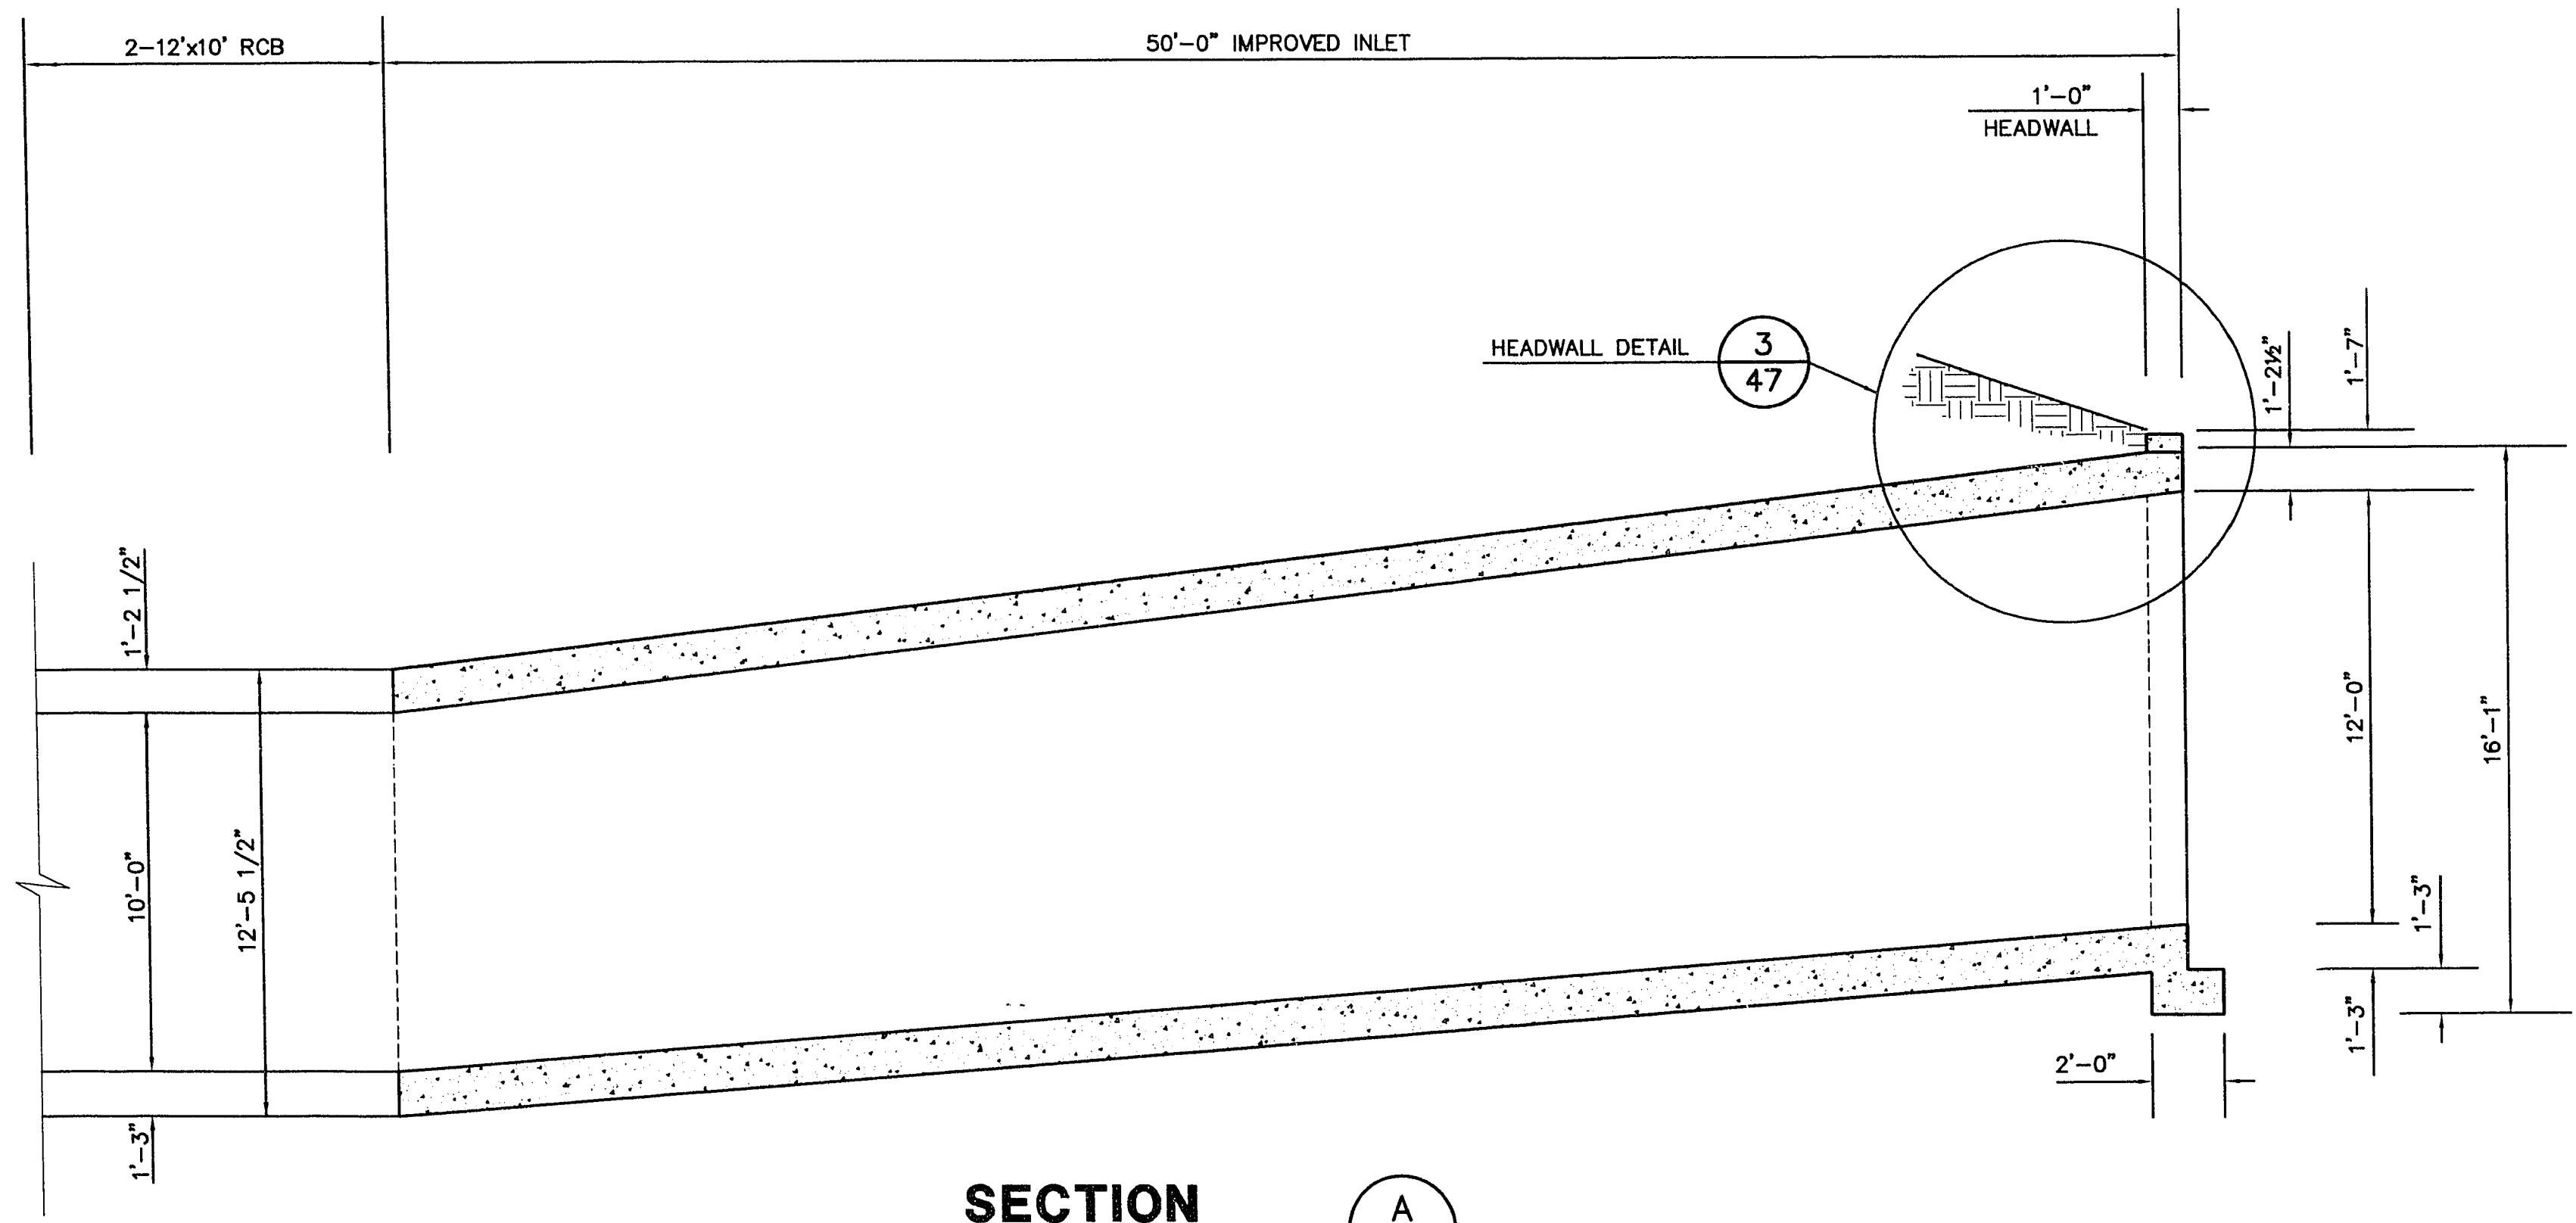

**SECTION A**

SCALE: HORIZ. 1/4" = 1'-0"  
VERT. 1/4" = 1'-0"

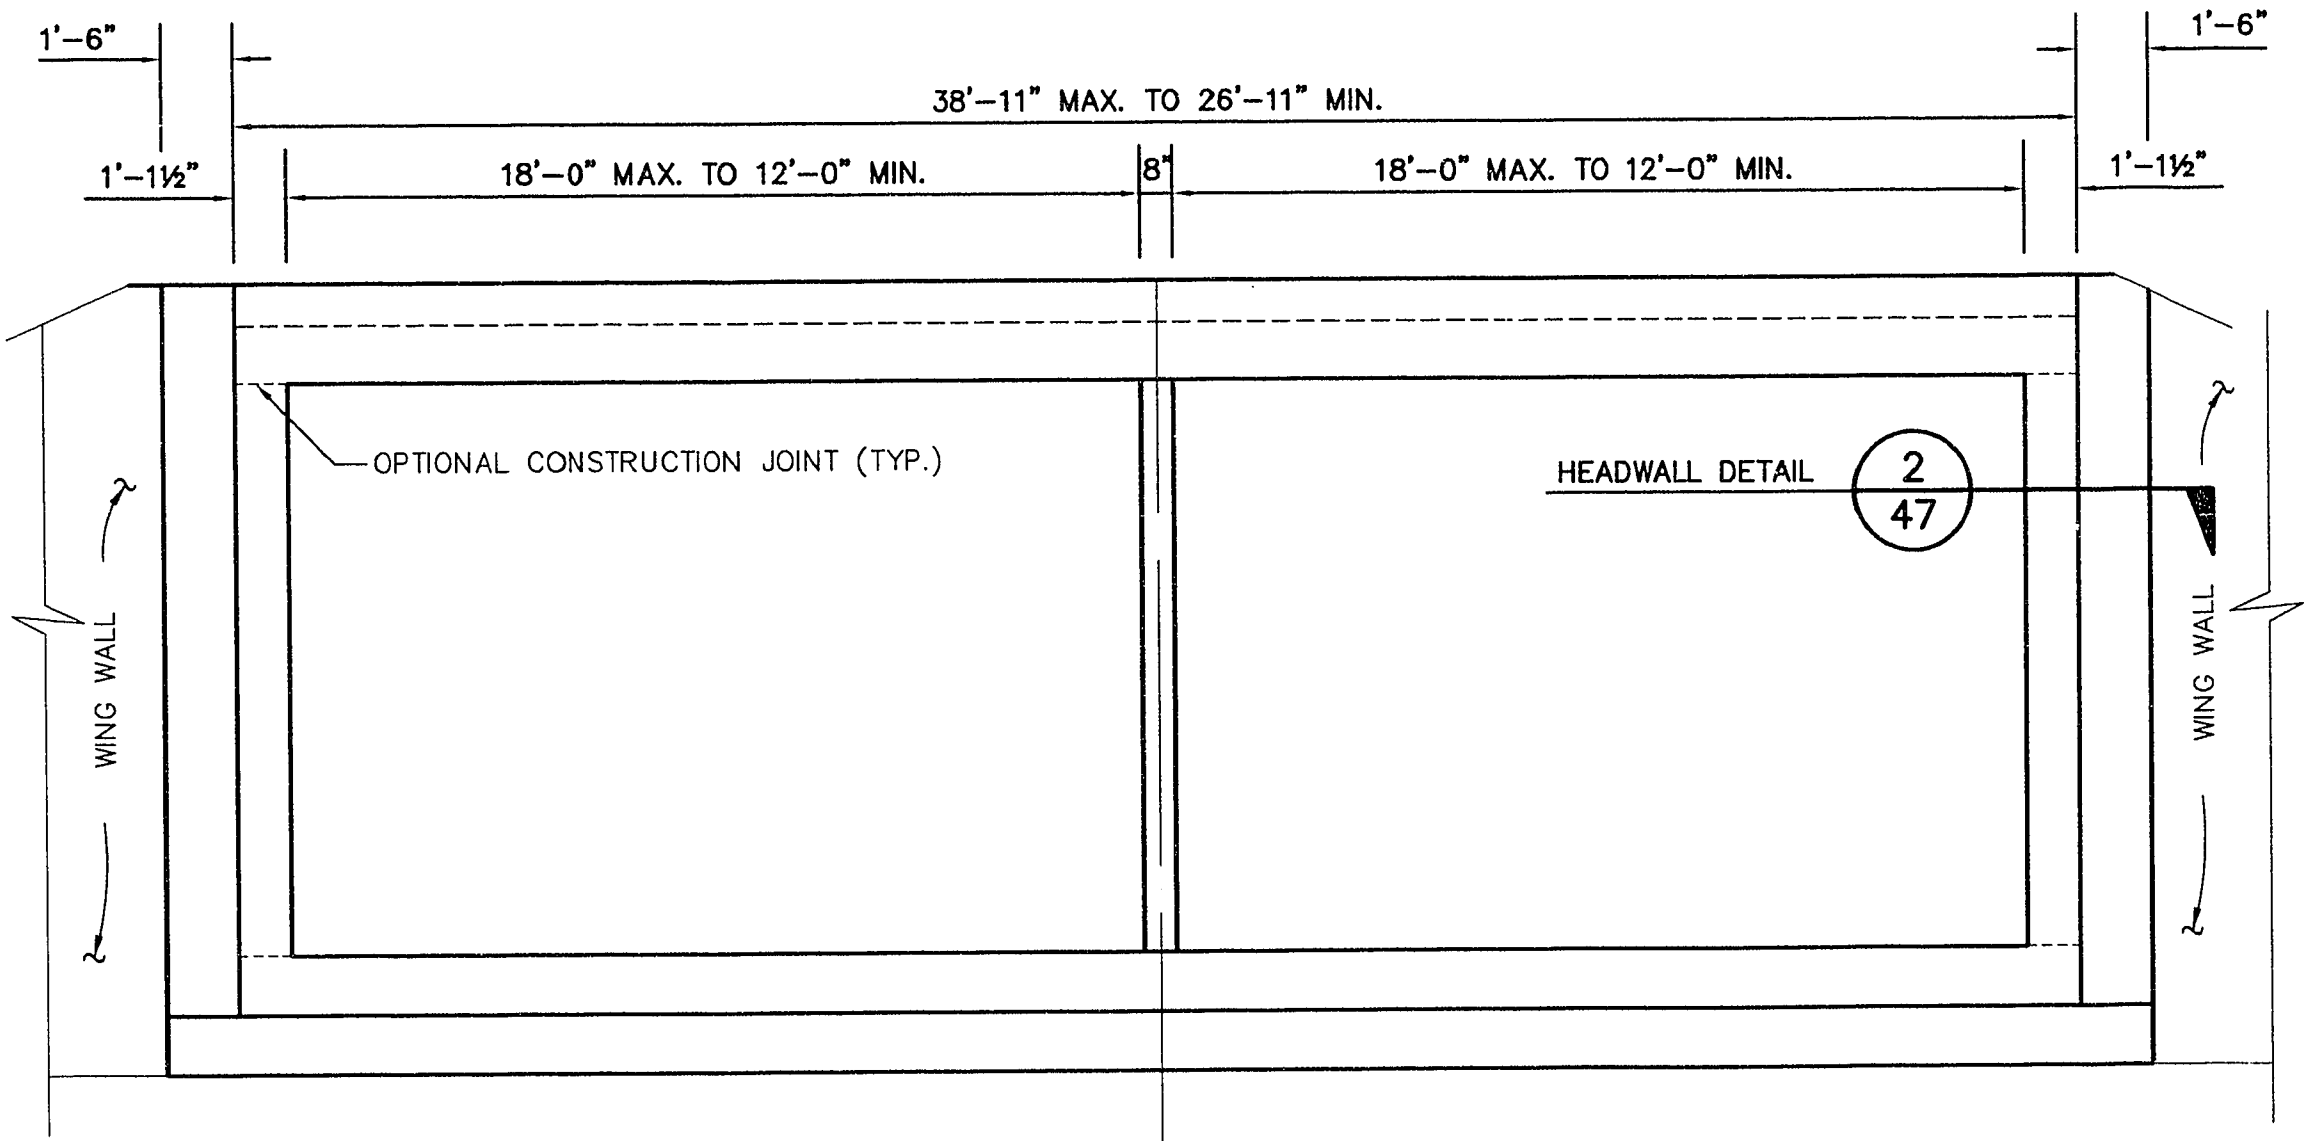

**ELEVATION C**

SCALE: HORIZ. 1/4" = 1'-0"  
VERT. 1/4" = 1'-0"

RECOMMENDED	DATE	DESCRIPTION
DANA A. JAMES	6-12-95	
<p><b>REVISIONS</b></p> <p>REV. DATE DESCRIPTION</p>		
<p>RECOMMENDED <i>[Signature]</i> DATE</p> <p>DANA A. JAMES R.P.E., N.D. 6-12-95</p>		
<p><b>G.C. WALLACE, INC.</b> Engineering/Architecture 1555 SOUTH RANNEY BLVD./LAS VEGAS, NEVADA 89108</p>		
<p><b>SUMMERLIN</b> VILLAGE 3 ROUGH GRADING IMPROVED INLET - RCB @ STA 62+21.00 STRUCTURAL DETAILS</p>		
SHEET		DATE
<b>46</b>		
SHT 46 OF 47		

JOB NO. 62003.203

07 V3-RG45 06-12-95

24-9-167

107-V2355