




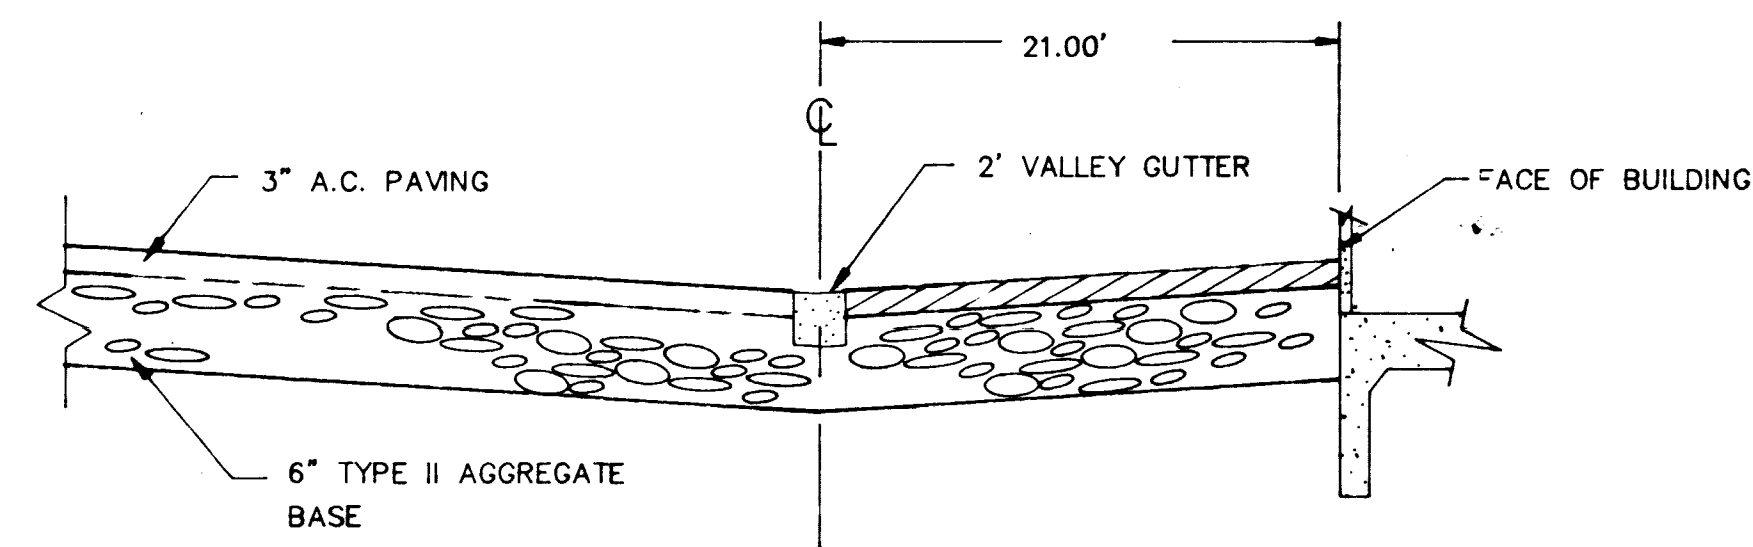

A
4 "ONSITE" PAVEMENT SECTION
NOT TO SCALE

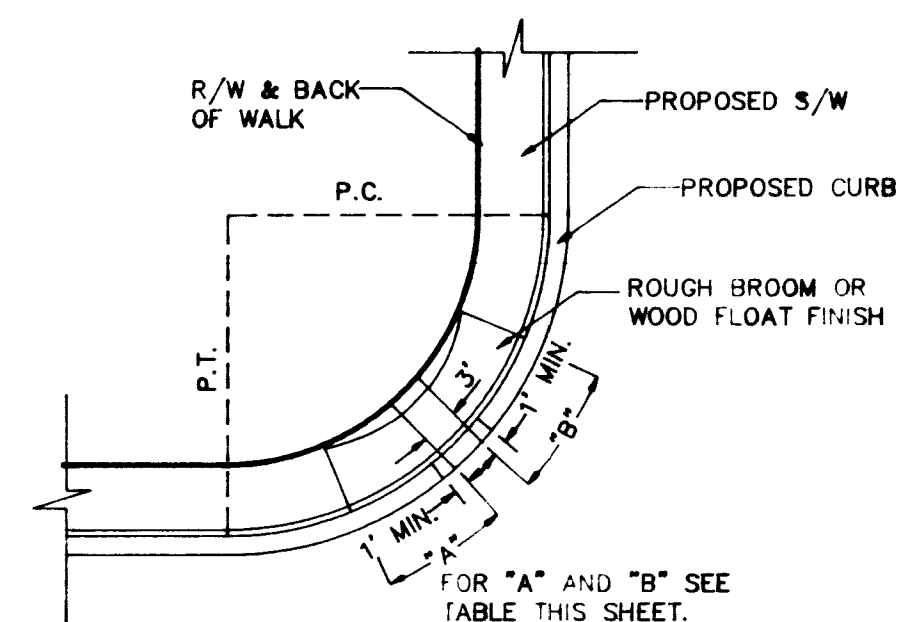

RAMP IN CURB RETURN

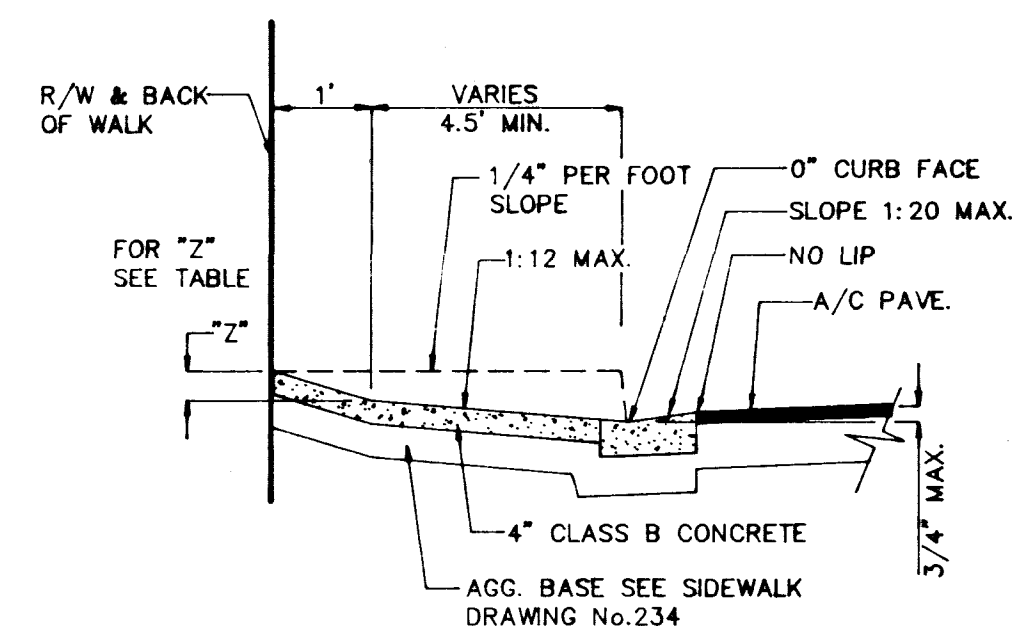

SECTION

TRANS. LENGTHS FOR 1:12 SIDE SLOPES

GRADE (%)	"A" (FT.) MIN.	"B" (FT.) MIN.
-6 TO -5.01	4.5	21.5
-5 TO -4.01	4.5	15.0
-4 TO -3.01	4.5	12.0
-3 TO -2.01	4.5	9.5
-2 TO 2	8.0	8.0
2.01 TO 3	9.5	4.5
3.01 TO 4	12.0	4.5
4.01 TO 5	15.0	4.5
5.01 TO 6	21.5	4.5


DEPTH OF DEPRESSION

SIDEWALK WIDTH (FT.)	"Y" (IN.) MIN.	"X" (IN.) MIN.
4	2.75	3.5
5	2.00	2.75
6	1.25	2.00

NOTE:


1. SIDEWALK WITHIN CURB RETURN SHALL BE LOCATED AT THE MIDPOINT OF CURB RETURN UNLESS OTHERWISE APPROVED.
2. SIDEWALK RAMPS OUTSIDE OF THE CURB RETURN SHALL BE LOCATED ADJACENT TO THE RETURN.
3. RAMPS SHALL BE CONSTRUCTED WITH A ROUGH BROOM OR WOOD FLOAT FINISH TRANSVERSE TO THE SLOPE OF THE RAMP.
4. WHEN CONSTRUCTING RAMP WHERE CURB AND GUTTER EXISTS, COMPLETELY REMOVE INTERFERING PORTIONS OF EXISTING CURB & GUTTER. RAMP, CURB & GUTTER TO BE MONOLITHIC.
5. AN OPTIONAL DETECTABLE WARNING CONSISTING OF RAISED TRUNCATED DOMES WITH A DIAMETER OF NOMINAL 0.9" A HEIGHT OF NOMINAL 0.2" AND A CENTER-TO-CENTER SPACING OF NOMINAL 2.35" AND CONTRASTING VISUALLY WITH ADJOINING SURFACES MAY BE PLACED ON RAMP EXTENDING THE FULL WIDTH AND DEPTH OF THE RAMP.

B
4 SIDEWALK RAMP DETAIL
STD. DWG. No. 235 (CASE 1)
NOT TO SCALE

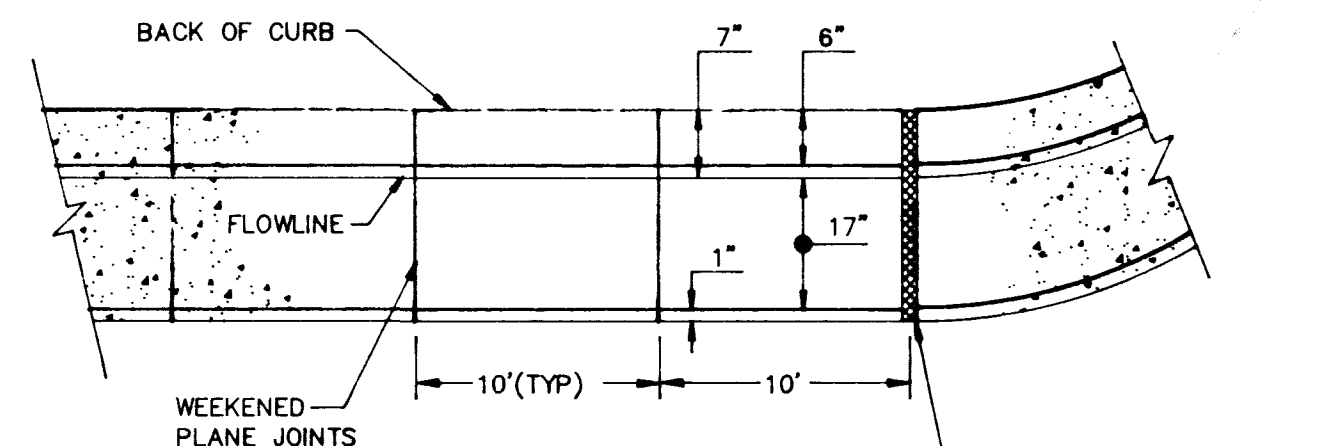


NOTES:

1. 1" BATTER ON GUTTER FACE OPTIONAL.
2. WHERE LONGITUDINAL SLOPE IS LESS THAN 0.4% THE FLOW LINE SHALL BE WATER TESTED.

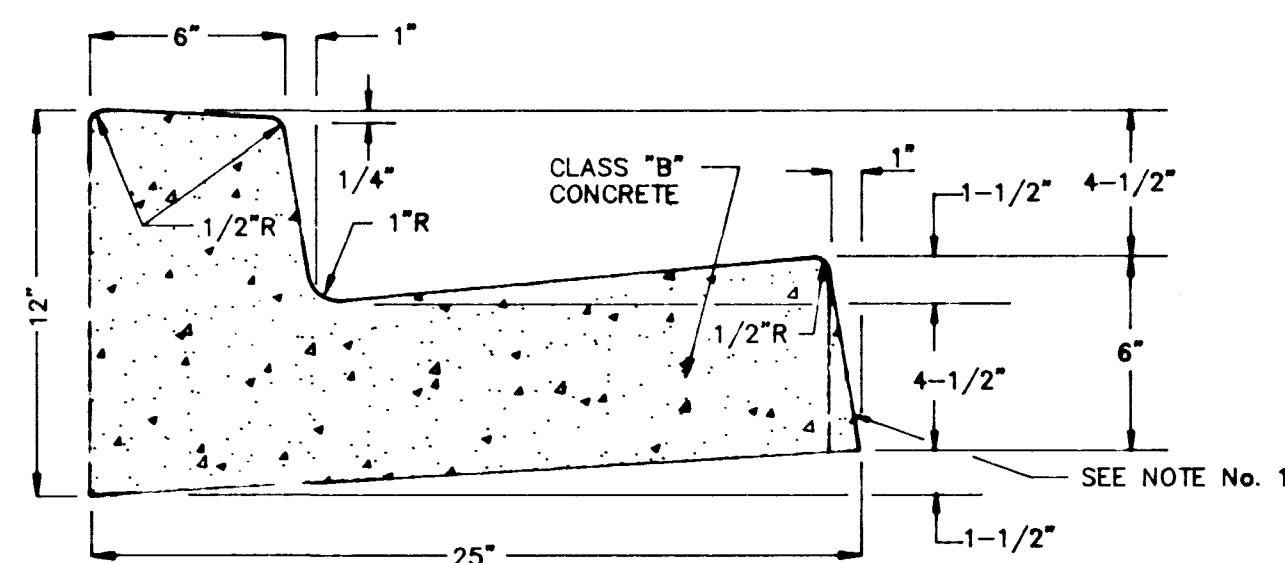


C
4 'L' TYPE CURB & GUTTER
NOT TO SCALE

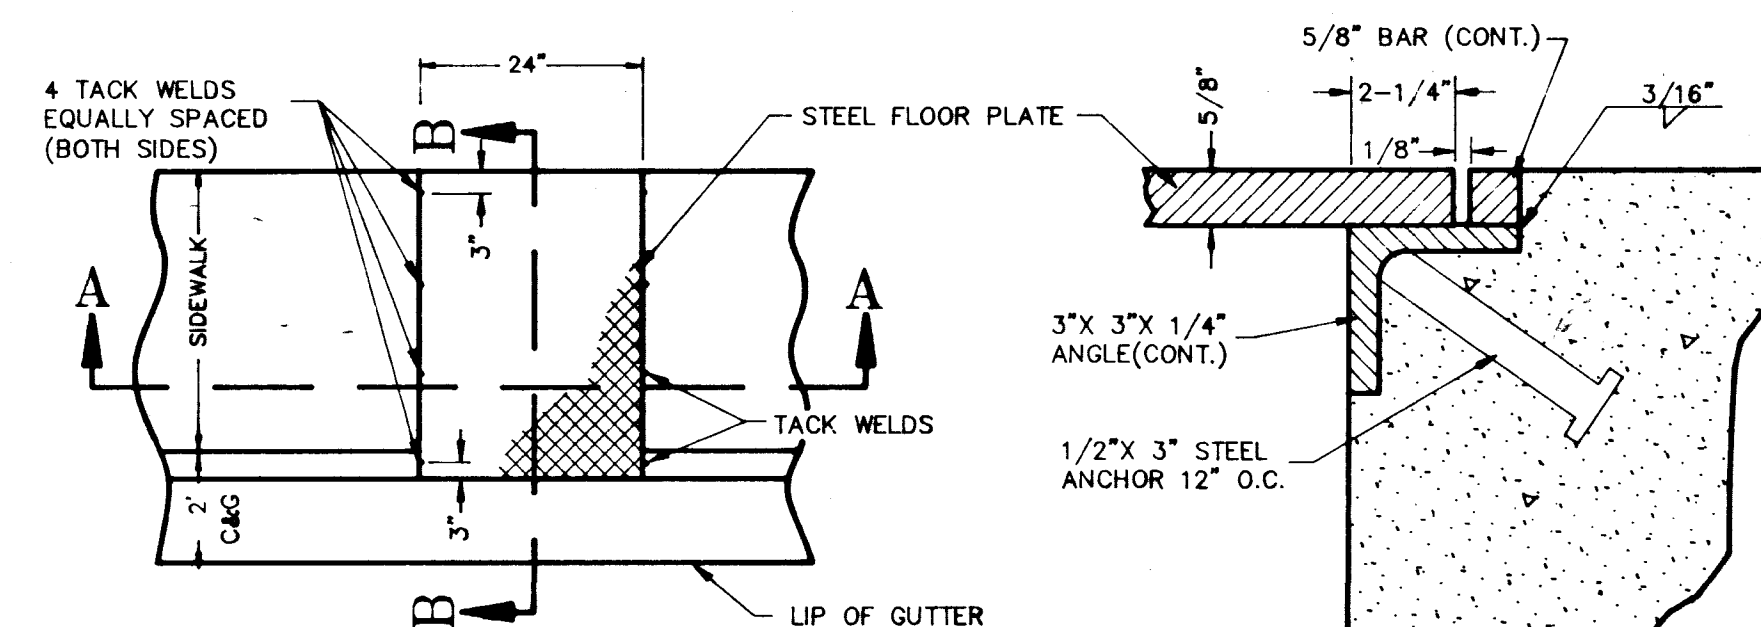


PLAN

DETAIL "1"

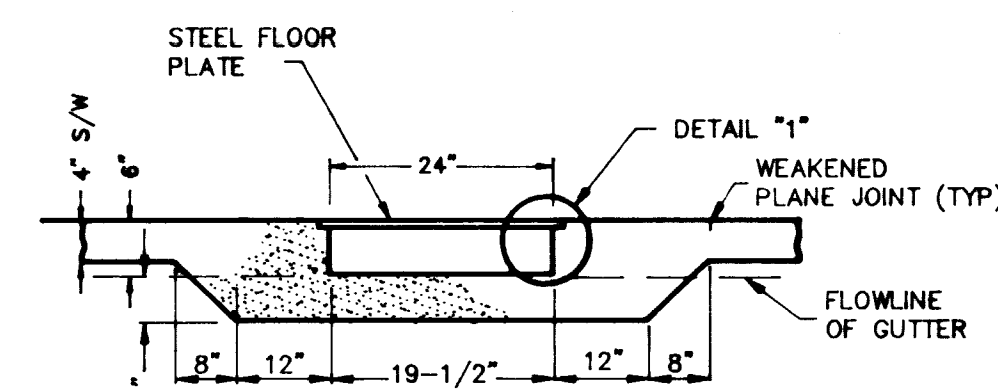

SECTION A-A

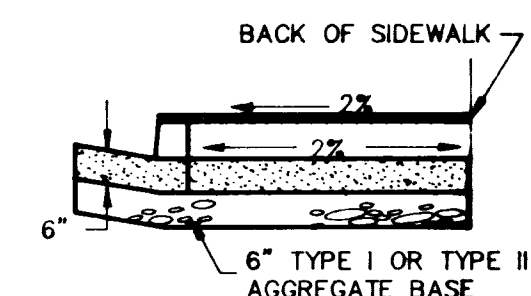

SECTION B-B

B
4 24" SIDEWALK UNDERDRAIN
NOT TO SCALE

REVISIONS	Date	By	Approval



4560 So. VALLEY VIEW BLVD.
SUITE 44
LAS VEGAS, NEVADA 89102
(702) 736-0804



PREPARED FOR:


IMPROVEMENT PLANS
WALGREEN BUILDING
DETAIL SHEET

SHEET
5
OF
57

FILE NAME: WALJ-DTL


30-2-55

107-V2506



"ON-SITE" PAVEMENT SECTION


NOT TO SCALE



SIDEWALK RAMP DETAIL


SEE PLAN, 1/4\"/>

NOT TO SCALE



1' TYPE CURB & GUTTER

NOT TO SCALE



24\"/>

NOT TO SCALE