



NOTE:
 FIRE HYDRANTS TO BE INSTALLED AND OPERABLE PRIOR TO COMBUSTIONABLE CONSTRUCTION.
 FIRE HYDRANTS WITHIN 300' OF ALL CONST. (COMBUSTIONABLE)
 L.V.V.W.D. TO DETERMINE THAT FIRE HYDRANTS ARE CONNECTED TO A WATER SUPPLY CAPABLE OF SUPPLYING THE REQUIRED FIRE FLOW.

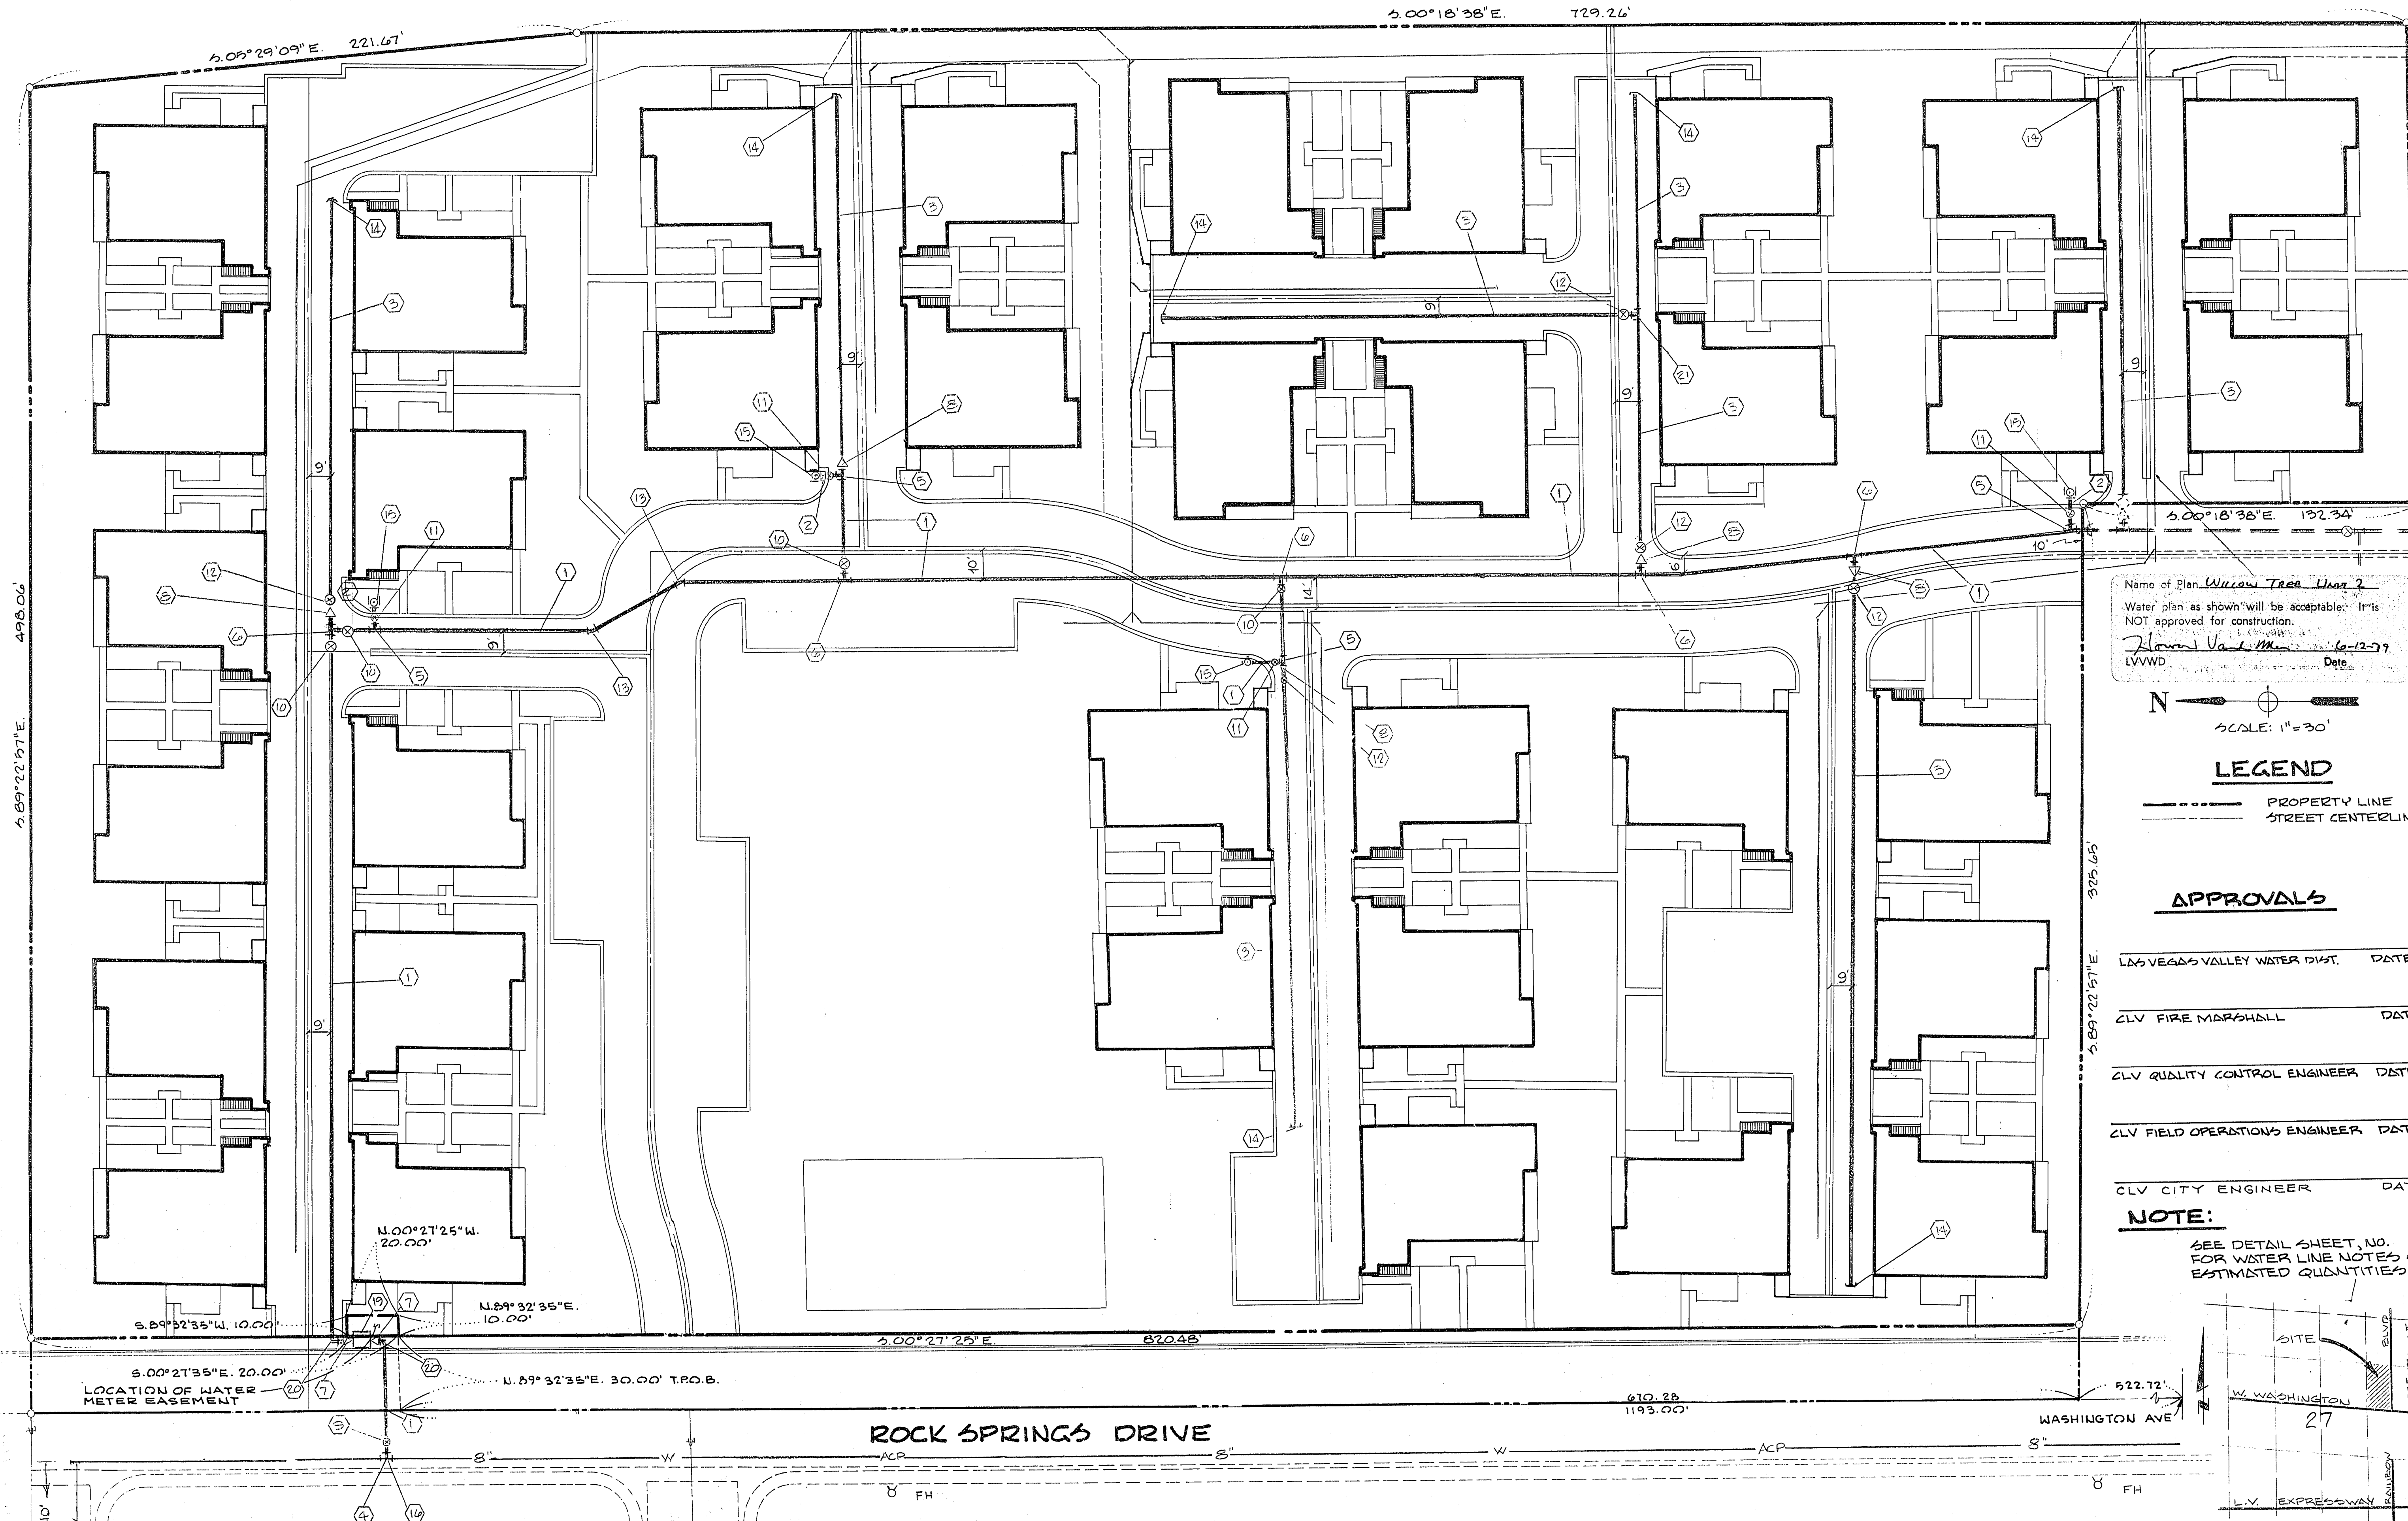

Name of Plan: Willow Tree Unit 2
 Water plan as shown will be acceptable. It is NOT approved for construction.
James Van Meter 6-12-79
 LVWD Date

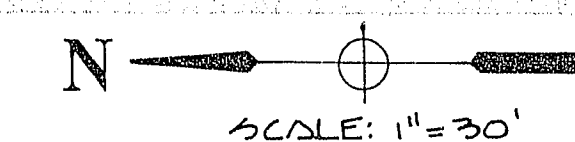


LEGEND

----- PROPERTY LINE
 ----- STREET CENTERLINE

APPROVALS

LAS VEGAS VALLEY WATER DIST. _____ DATE _____
 CLV FIRE MARSHALL _____ DATE _____
 CLV QUALITY CONTROL ENGINEER _____ DATE _____
 CLV FIELD OPERATIONS ENGINEER _____ DATE _____
 CLV CITY ENGINEER _____ DATE _____

NOTE:
 SEE DETAIL SHEET, NO. _____ FOR WATER LINE NOTES & ESTIMATED QUANTITIES

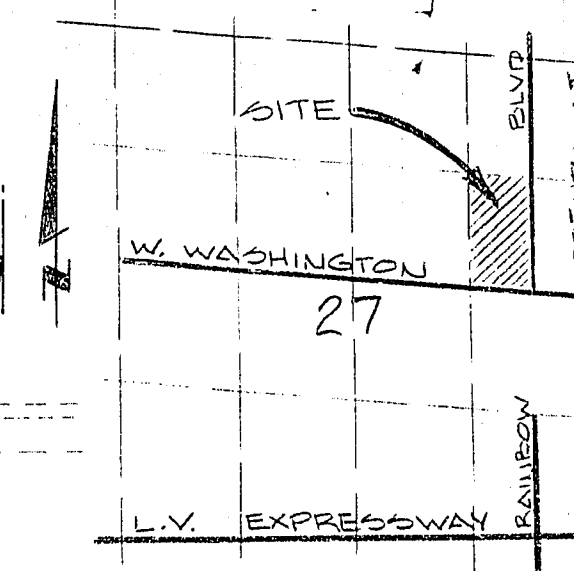

PREPARED FOR: **CONSOLIDATED REALTY**
 DATE: _____
 DESIGN: **BAUGHMAN & TURNER**
 DRAWN: JOHN HENGEY
 CHECK: _____
 SCALE: 1" = 30'
 CIVIL ENGINEERS
 MINING ENGINEERS
 LAND SURVEYORS
 2335 WEST CHARLESTON BOULEVARD
 LAS VEGAS, NEVADA 89102
 702-870-8777

WATER PLAN
WILLOW TREE UNIT NO. 2
 SECTION 27 TOWNSHIP 20 S. RANGE 40 E. DIS. # N.1.
 CITY OF LAS VEGAS, CLARK COUNTY NEVADA

FB. 107
 5-9-4 (Condos)
 5474-3345-2