


BENCHMARK
C.L.V. BM # 2LV01/29NES
RIVET & PLATE IN TOP OF CURB.
WEST CURB OF TONOPAH DRIVE
C.L.V. DATUM
NAVD 88
ELEV = 629.3574 METERS
2064.8146 FEET


BASIS OF BEARING
NORTH 89° 22' 55" EAST
BEING THE SOUTHERLY LINE OF THE
SOUTHEAST QUARTER (SE 1/4) OF THE
SOUTHEAST QUARTER (SE 1/4) OF
SECTION 20, TOWNSHIP 20 SOUTH,
RANGE 61 EAST, M.D.M.
AND ALSO BEING THE CENTERLINE OF
VEGAS DRIVE AS SHOWN PER PARCEL MAP:
FILE 39, PAGE 56, CLARK COUNTY RECORDS.

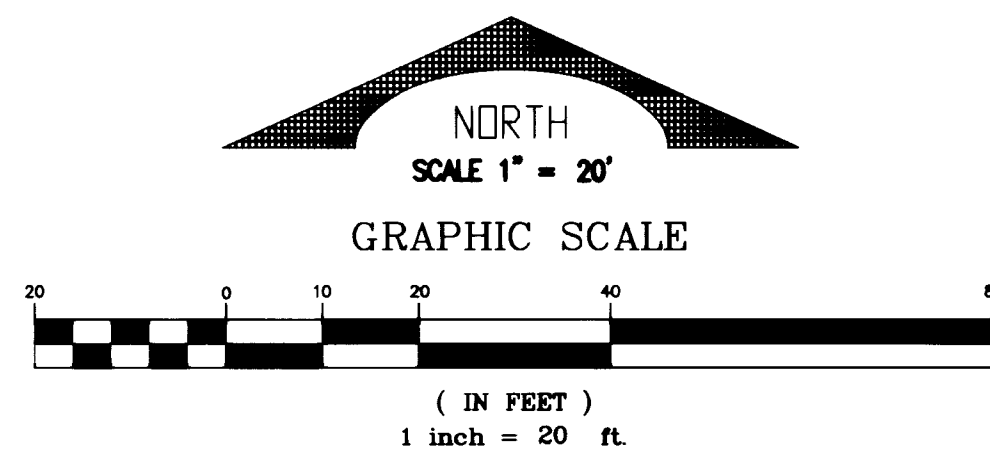

DEVELOPED AREA
FF = 67.60

LEGEND	
	EXIST. WATER VALVE
	EXIST. MANHOLE
	EXIST. FIRE HYDRANT
	EXIST. STREETLIGHT
	PROP. STREETLIGHT
	CENTERLINE STREET
	EXIST. CURBING
	PROP. CURBING
	EXIST. BUILDING
	EXIST. FENCE
	EXIST. BLOCK WALL
	EXIST. EDGE OF PAVEMENT
	PROP. EDGE OF PAVEMENT
	PROPERTY LINE

DEVELOPED AREA
AIDA Z. BRENTS
L.V. HOUSING AUTHORITY
FF = 69.90

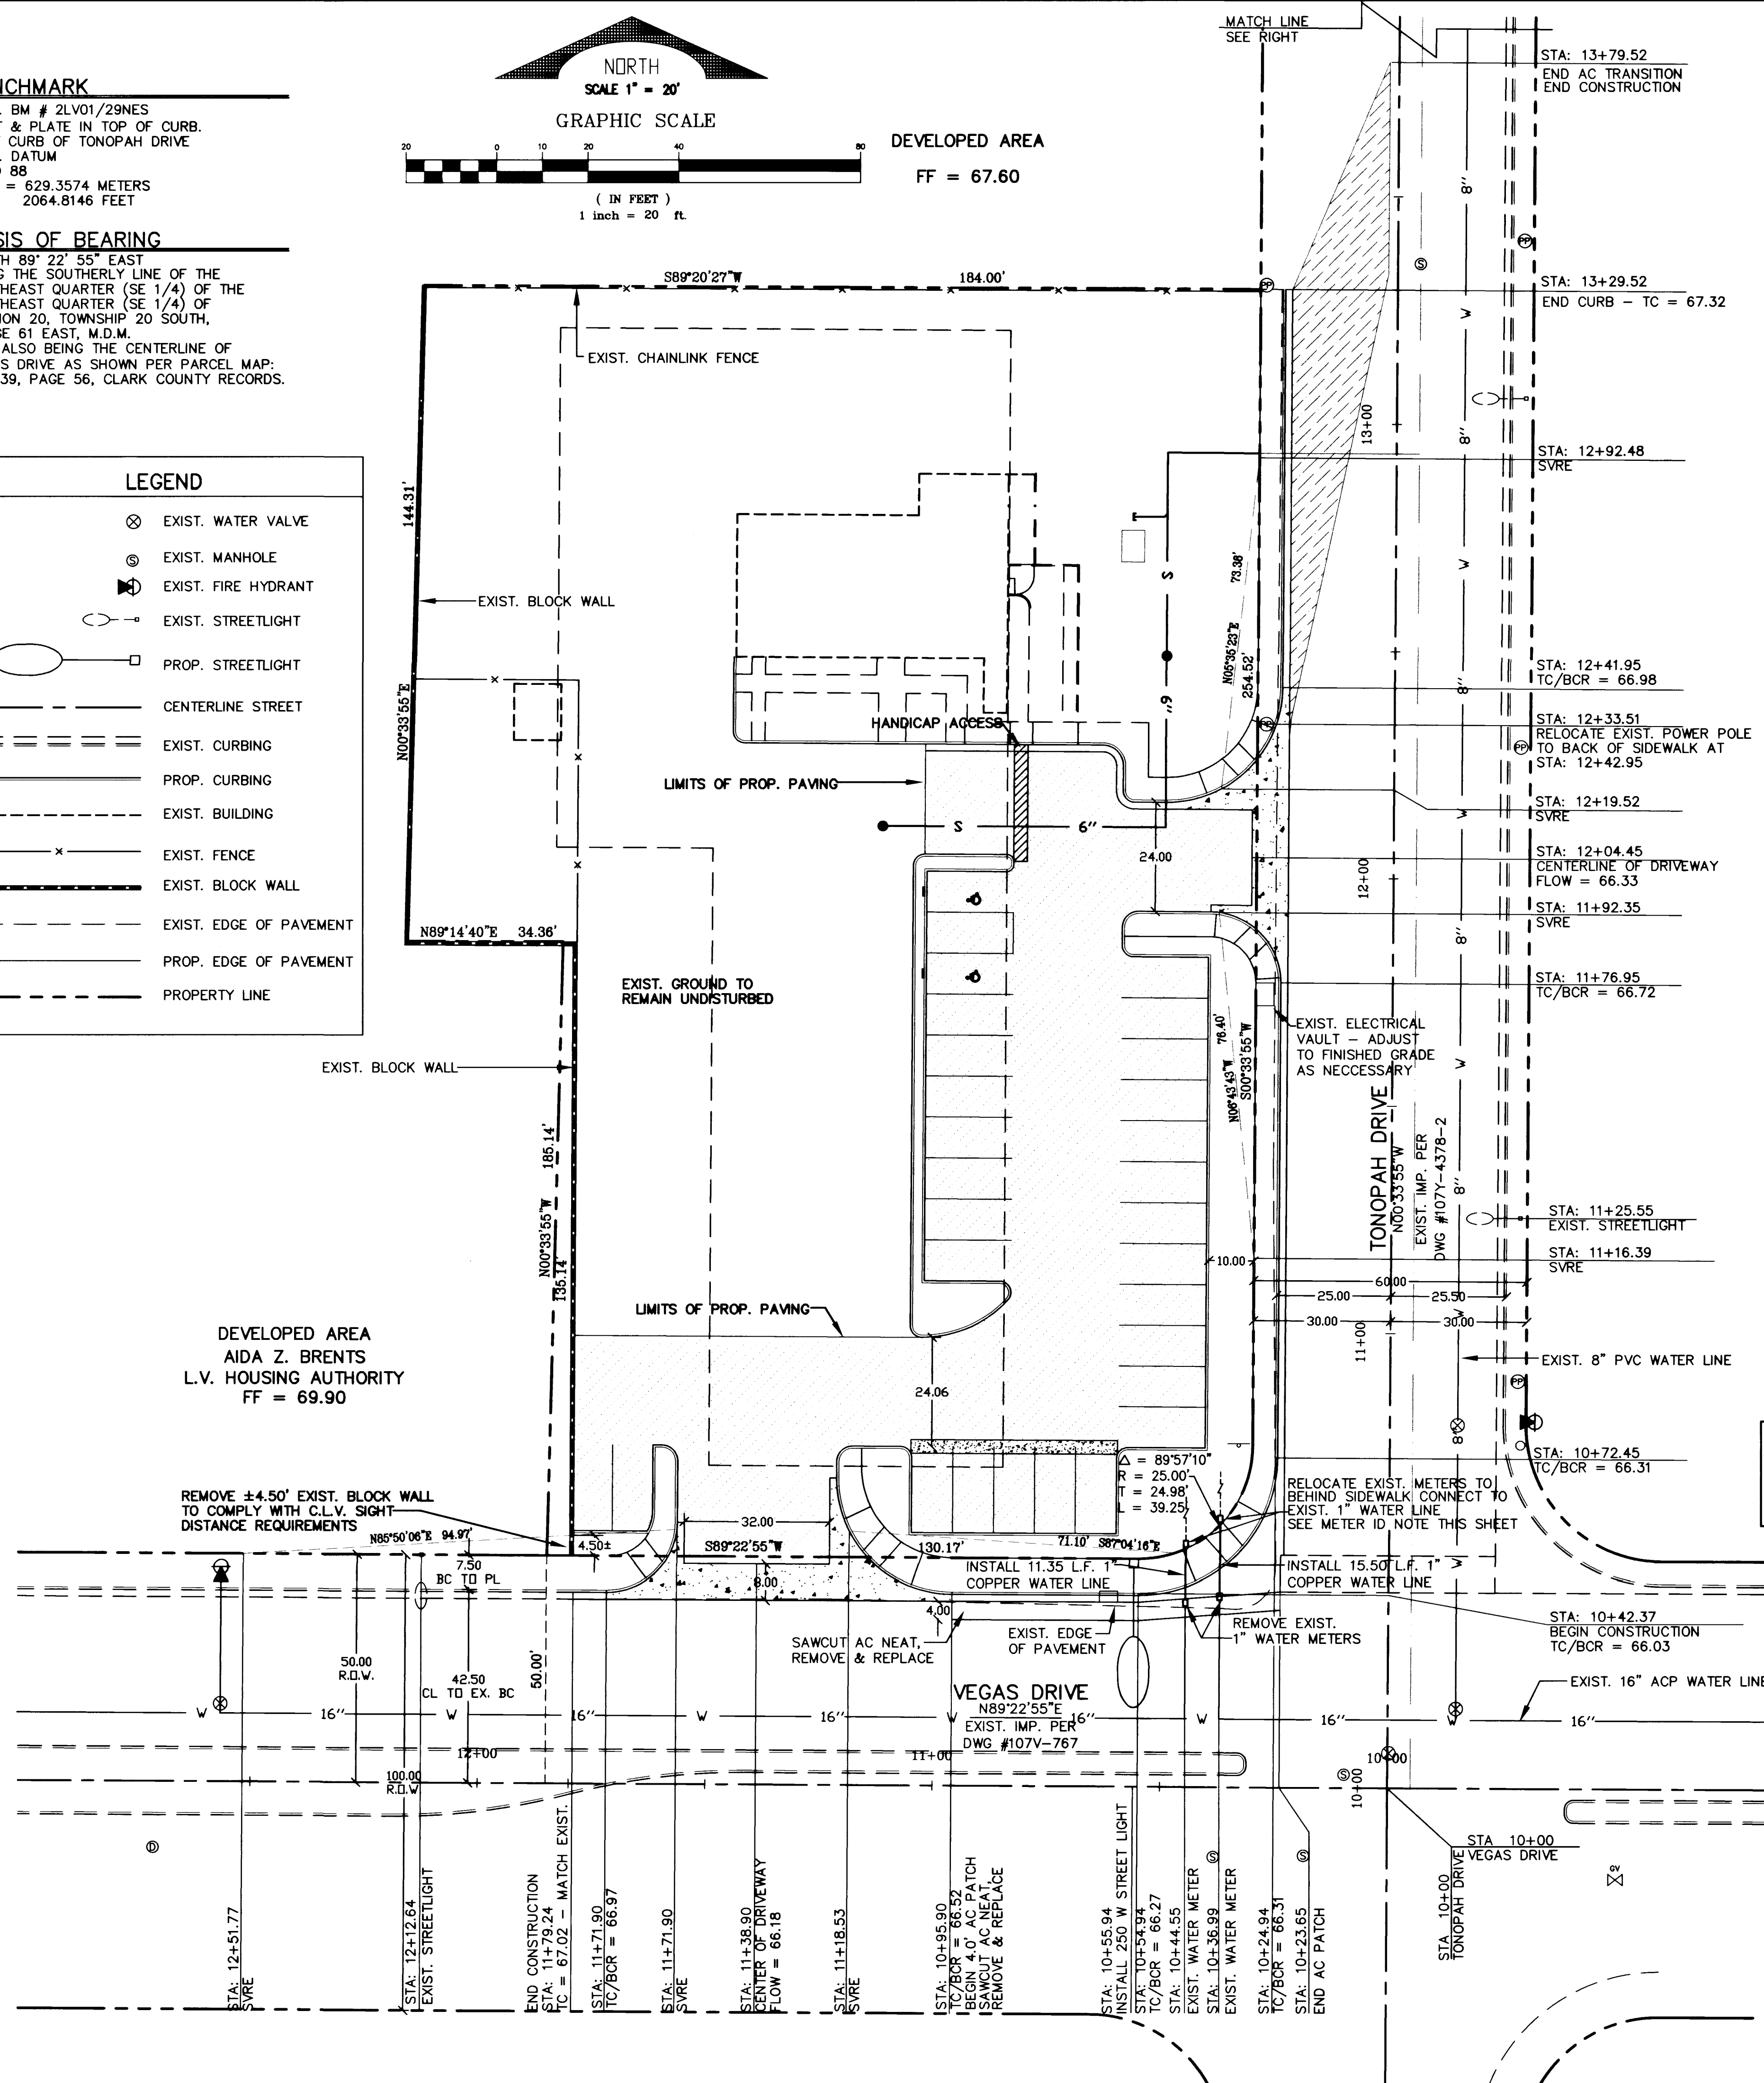

METER ID NOTE

ACC. NO.	METER NO.	SIZE
48591	252893	1"
150734	363343	1"

LVVWD STANDARD NOTES

- NO WORK SHALL BEGIN UNTIL THE WATER PLANS HAVE BEEN RELEASED FOR CONSTRUCTION BY THE LVVWD. FOLLOWING WATER PLAN APPROVAL, 48 HOUR NOTICE SHALL BE GIVEN TO THE LVVWD COMMUNICATION SUPPORT CENTER (258-7171) PRIOR TO THE START OF CONSTRUCTION. NOTICE MUST BE GIVEN BY 2:00 PM THE BUSINESS DAY PRIOR TO A LVVWD INSPECTION.
- ALL WORK SHALL CONFORM TO THE LVVWD'S STANDARD PLATES, DRAWINGS AND SPECIFICATIONS AND THE UNIFORM DESIGN AND CONSTRUCTION STANDARDS FOR WATER DISTRIBUTION SYSTEMS (UDACS), LATEST EDITION.
- ALL WORK, EXCEPT AS MODIFIED BY THESE PLANS OR BY NOTE 2, SHALL BE DONE IN ACCORDANCE WITH THE MOST CURRENT DRAFT OR EDITION OF THE UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OFFSITE IMPROVEMENTS CLARK COUNTY AREA.
- A SINGLE PIPE MATERIAL SHALL BE USED THROUGHOUT THE PROJECT UNLESS OTHER OTHERWISE APPROVED BY THE LVVWD.
- ALL SERVICE LATERALS TWO (2) INCHES IN DIAMETER AND SMALLER SHALL BE COPPER TUBING WITH LVVWD APPROVED SERVICE SADDLES.
- ALL WATER METER BOXES SHALL BE LOCATED OUTSIDE OF DRIVEWAY AREAS.
- ALL VALVES SHALL BE LOCATED OUTSIDE OF DRIVEWAYS, VALLEY AND CURB GUTTERS.
- THE FOLLOWING REQUIREMENTS MUST BE MET IN THE EVENT A WATER LINE AND SANITARY OR STORM SEWER LINE CROSS:
A MINIMUM EIGHTEEN (18) INCH VERTICAL SEPARATION (OUTSIDE TO OUTSIDE) MUST BE MAINTAINED WHEN THE WATER LINE IS INSTALLED OVER THE SANITARY OR STORM SEWER LINE. IF THE VERTICAL SEPARATION CANNOT BE MAINTAINED OR THE WATER LINE MUST BE PLACED UNDER THE SANITARY OR STORM SEWER LINE, THE SANITARY OR STORM SEWER LINE MUST BE CONSTRUCTED WITH ONE OF THE FOLLOWING OR AS SHOWN ON THESE PLANS:
A. POTABLE WATER SUPPLY QUALITY MATERIAL.
B. ENCASEMENT WITH FOUR (4) INCH CONCRETE (MINIMUM)
C. SLEEVING WITH POTABLE WATER SUPPLY QUALITY PIPE.
EACH PROVISION MUST EXTEND ALONG THE SANITARY OR STORM SEWER ON EITHER SIDE OF THE MAIN, A MINIMUM TEN (10) FOOT DISTANCE PERPENDICULAR TO THE WATER MAIN EXTERIOR.
- WARNING TAPE SHALL BE REQUIRED OVER ALL MAINS, ALL SIX (6) INCH DIAMETER AND LARGER SERVICE LATERALS, AND ANY SERVICE LATERAL NOT INSTALLED PERPENDICULAR TO THE MAIN IN ACCORDANCE WITH STANDARD PLATE NO. 27.
- ALL WATER FACILITIES SHALL BE FILLED, DISINFECTED, PRESSURE TESTED, FLUSHED, FILLED AND AN ACCEPTABLE WATER SAMPLE OBTAINED PRIOR TO CONNECTION TO THE LVVWD'S DISTRIBUTION SYSTEM.
- THE CONTRACTOR MUST OBTAIN ALL METERS TWO (2) INCHES AND SMALLER FROM LVVWD CENTRAL STORES. TELEPHONE 258-3152 FORTY-EIGHT (48) HOURS PRIOR TO PICKUP
- CONSTRUCTION MAY INTERRUPT SERVICE WITH LVVWD APPROVAL AND PROPER NOTIFICATION. BETWEEN THE HOURS OF 10 PM AND 6 AM, SUNDAY THROUGH THURSDAY. CIRCUMSTANCES MAY REQUIRE TEMPORARY SERVICE FEEDS BE INSTALLED WITHOUT LVVWD REIMBURSEMENT. ANY TEMPORARY SERVICE FEEDS MUST HAVE PRIOR LVVWD APPROVAL
- ALL WATER FACILITY CONSTRUCTION MATERIALS USED MUST BE AS LISTED ON THE LVVWD'S PREAPPROVED MATERIALS AND MANUFACTURERS LISTING FOR NEW FACILITIES, LATES REVISION, OR SPECIFICALLY APPROVED ON THESE PLANS

REV. JUNE 23, 1996

1ST APP-2 11/06/99

[Signature]
LAS VEGAS VALLEY WATER DISTRICT


5/06/99
DATE

AVOID CUTTING UNDERGROUND UTILITIES. ITS COSTLY.
CALL BEFORE YOU DIG
1-800-227-2600
UNDERGROUND SERVICE (USA)

NOTICE !

EXISTING UTILITIES ARE LOCATED ON THE PLANS FOR THE CONVENIENCE OF THE CONTRACTOR ONLY. THE ENGINEER BEARS NO RESPONSIBILITY FOR THE LOCATION OF UTILITIES SHOWN OR NOT SHOWN ON THE PLANS. THE CONTRACTOR SHALL NOTIFY ALL UTILITY COMPANIES BEFORE STARTING CONSTRUCTION AND IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THE LOCATION OF ALL UTILITIES WITH THE UTILITY COMPANIES.


AVOID OVERHEAD POWER LINE CONTACT.
CALL BEFORE YOU OVERHEAD
1-702-593-6111
NEVADA POWER ENVIRONMENT AND SAFETY SERVICES DEPT.

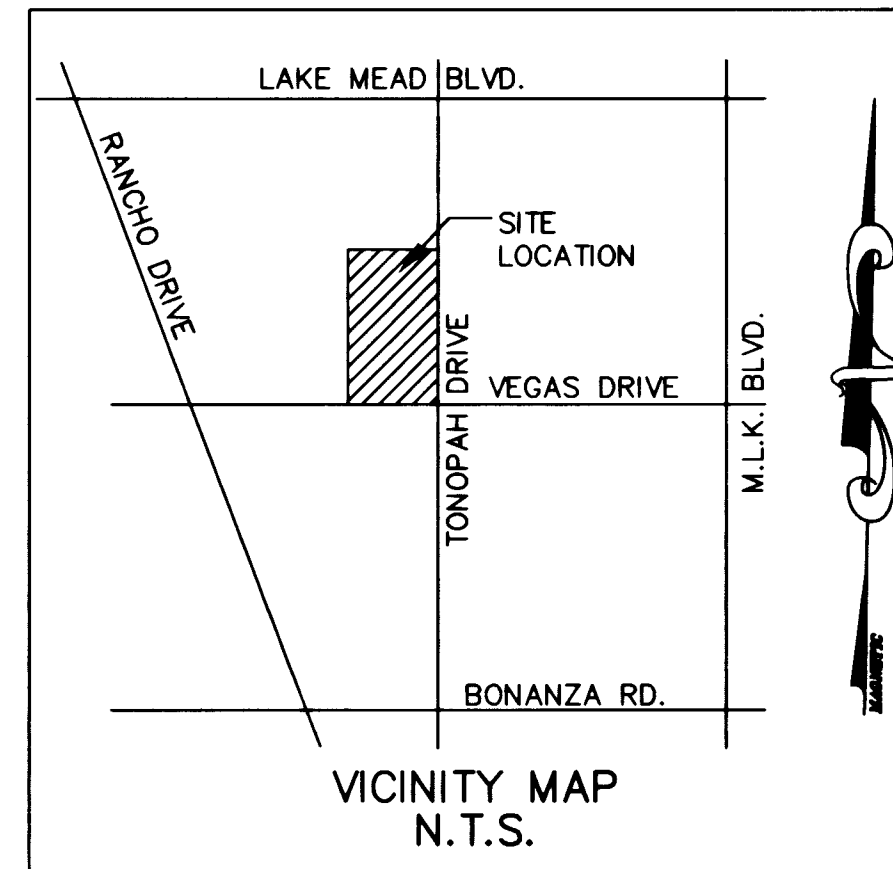

Redrocks
ENGINEERING & SURVEYING, INC.
4270 SOUTH DECATUR BLVD., #B8-101
LAS VEGAS, NEVADA 89103
PHONE (702) 968-8030

METER RELOCATION
VEGAS DRIVE & TONOPAH
REVIVAL TEMPLE CHURCH
1603 TONOPAH DRIVE
LAS VEGAS, NEVADA

DRAWN BY : M.B.
DESIGNED BY : M.B.
CHECKED BY : W.D.C.
DATE : 3/16/99
JOB # : 970485
APN : 139-20-802-009
SECT 20 T 20 S R 61 E
SCALE : HORIZ 1" = 20'
VERT 1" = 2'

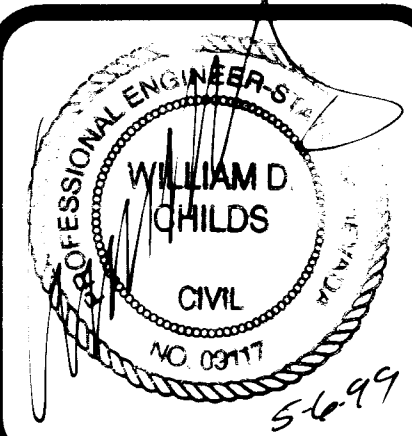

SHEET #
C7
7 OF 7
107-V2847

