



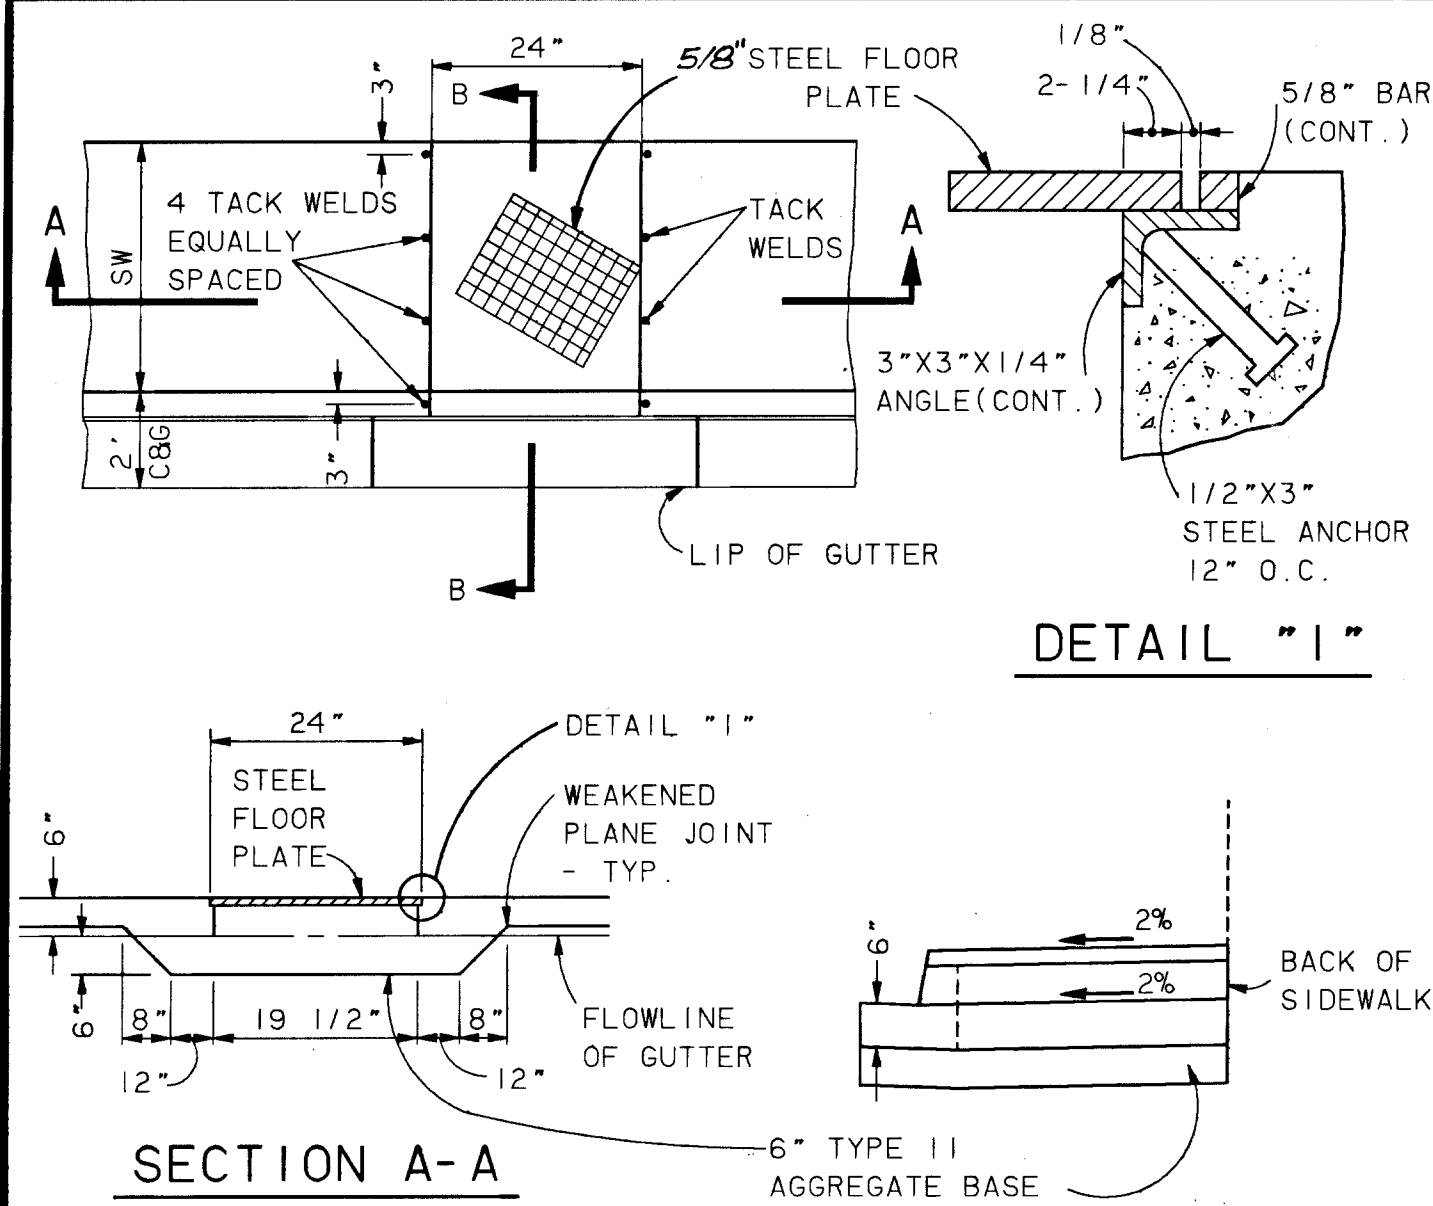


NOTES:

1. ALL EXPOSED METAL PARTS SHALL BE GALVANIZED AND ALL GALVANIZING DAMAGED BY FABRICATION OR INSTALLATION SHALL RECEIVE TWO COATS OF ALUMINUM PAINT (GALVONOX OR EQUAL)

SIDEWALK DRAIN DETAIL
STD. DWG. #236

1
C6.01

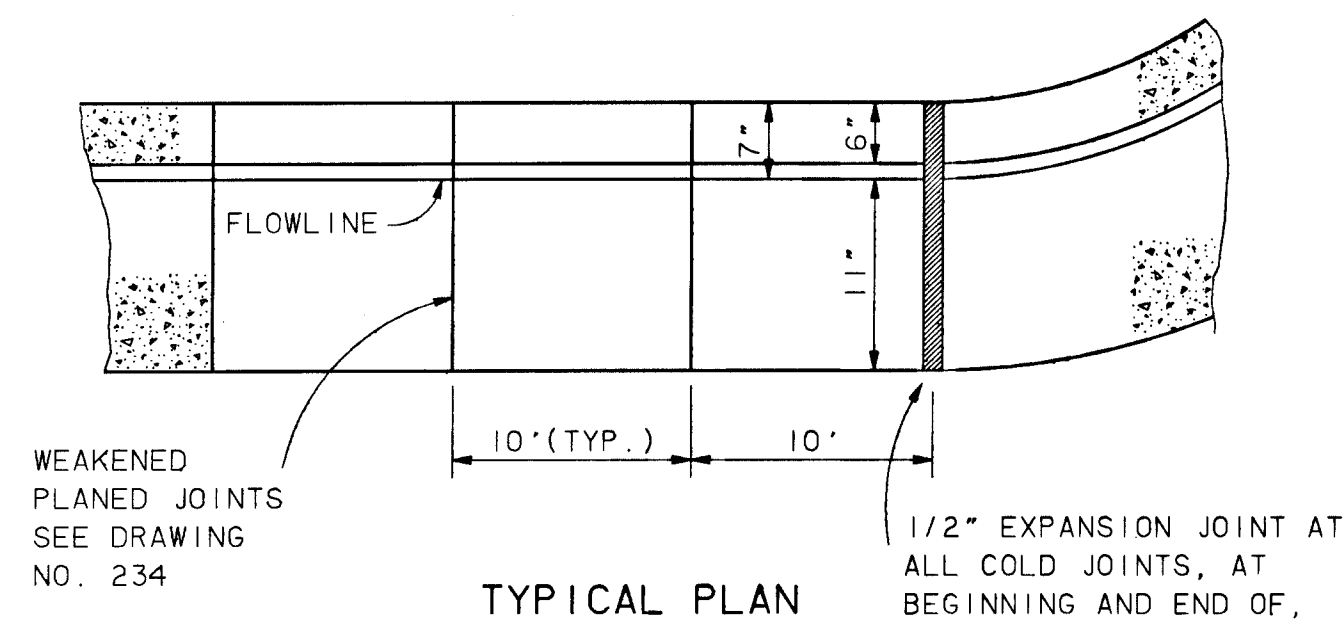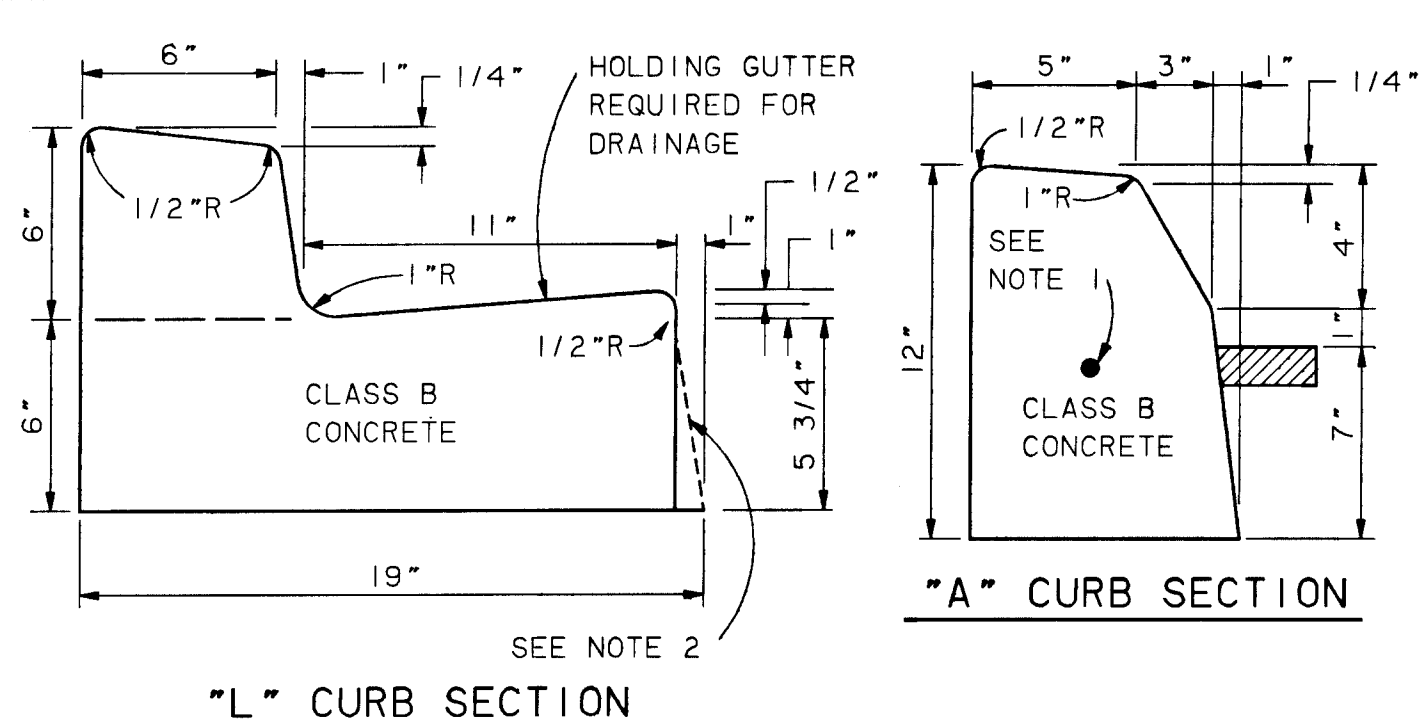



NOTES:

1. CONTINUOUS NO. 4 BAR REQUIRED IN NOSE OF MEDIAN ONLY.
2. 1" BATTER ON GUTTER FACE OPTIONAL.

ONSITE 'L' & 'A' CURB DETAILS

* SEE NOTE ON SHEET C6.02

2
C6.01

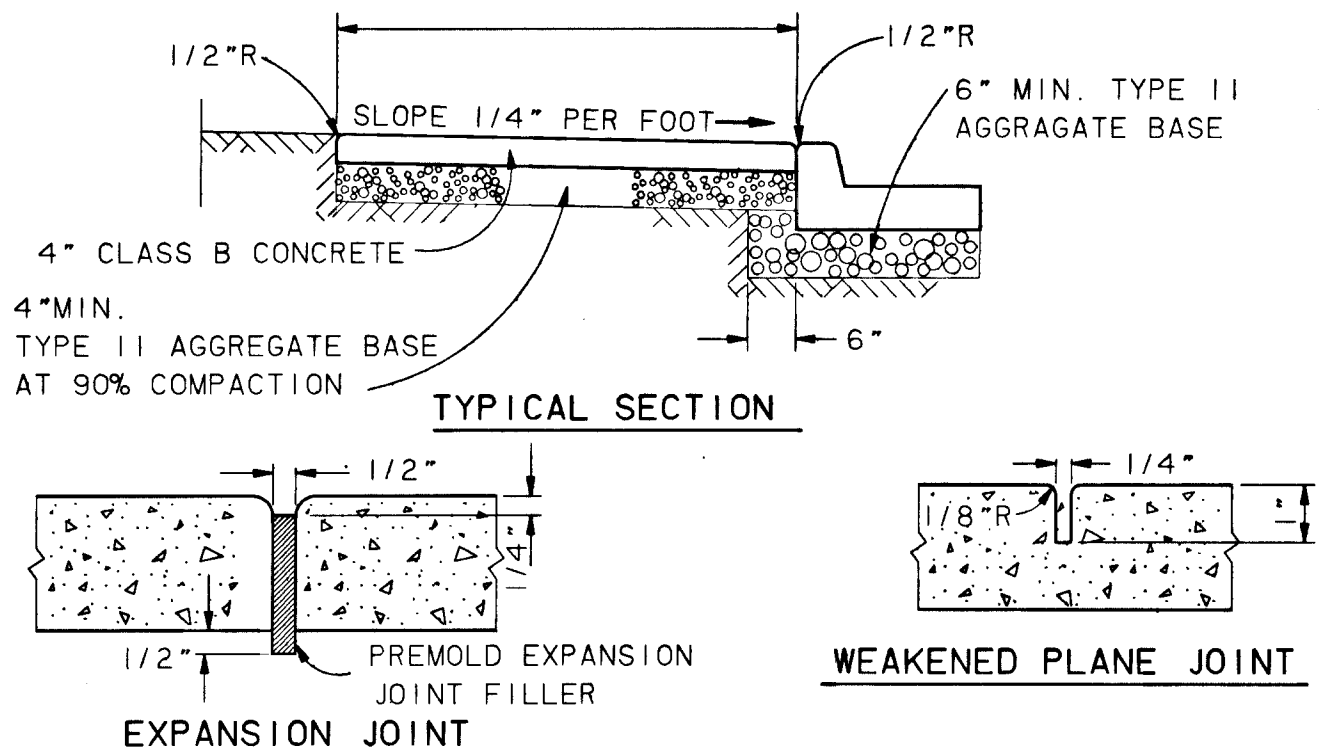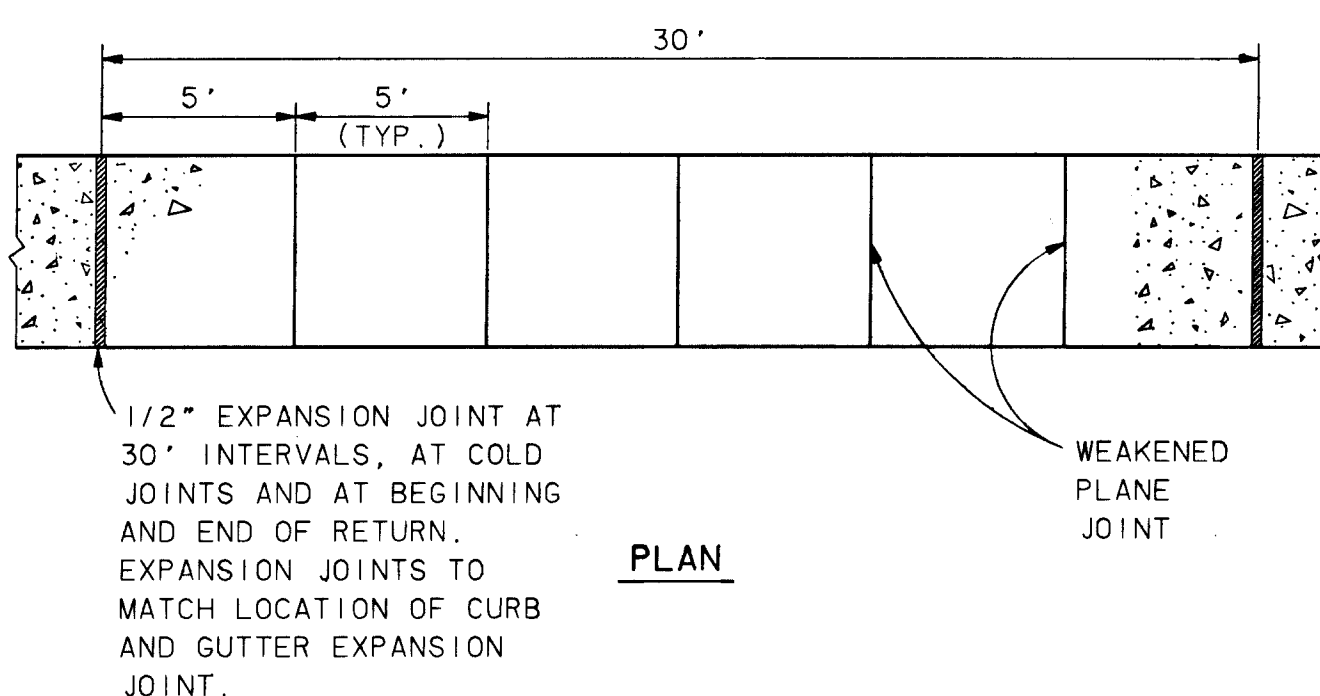


NOTE:

1. ON ALL CURB RETURNS A 1/2" EXPANSION JOINT SHALL BE CONSTRUCTED BETWEEN THE BACK OF CURB AND THE SIDEWALK FOR THE ENTIRE LENGTH OF THE RETURN.

SIDEWALKS

STD. DWG. #234

3
C6.01

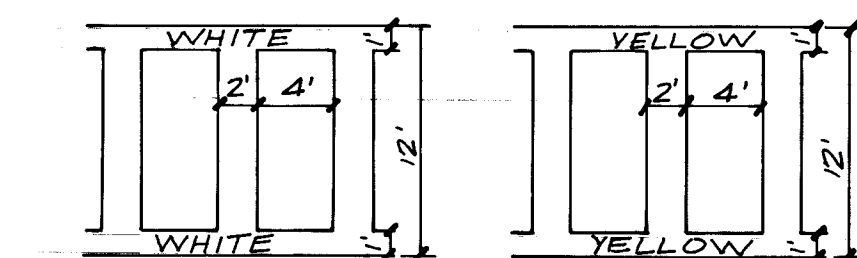


TYPE I

CROSSWALK TO BE WHITE IN COLOR

TYPE III

CROSSWALK TO BE YELLOW IN COLOR

REV	DESCRIPTION	DATE	BY
1	ADDED COMMON TRENCH DETAIL	5/20/01	J.D.
2	ADDED CROSSWALK TYPES	5/20/01	J.D.
3	SIGNATURES	3/19/20/00	

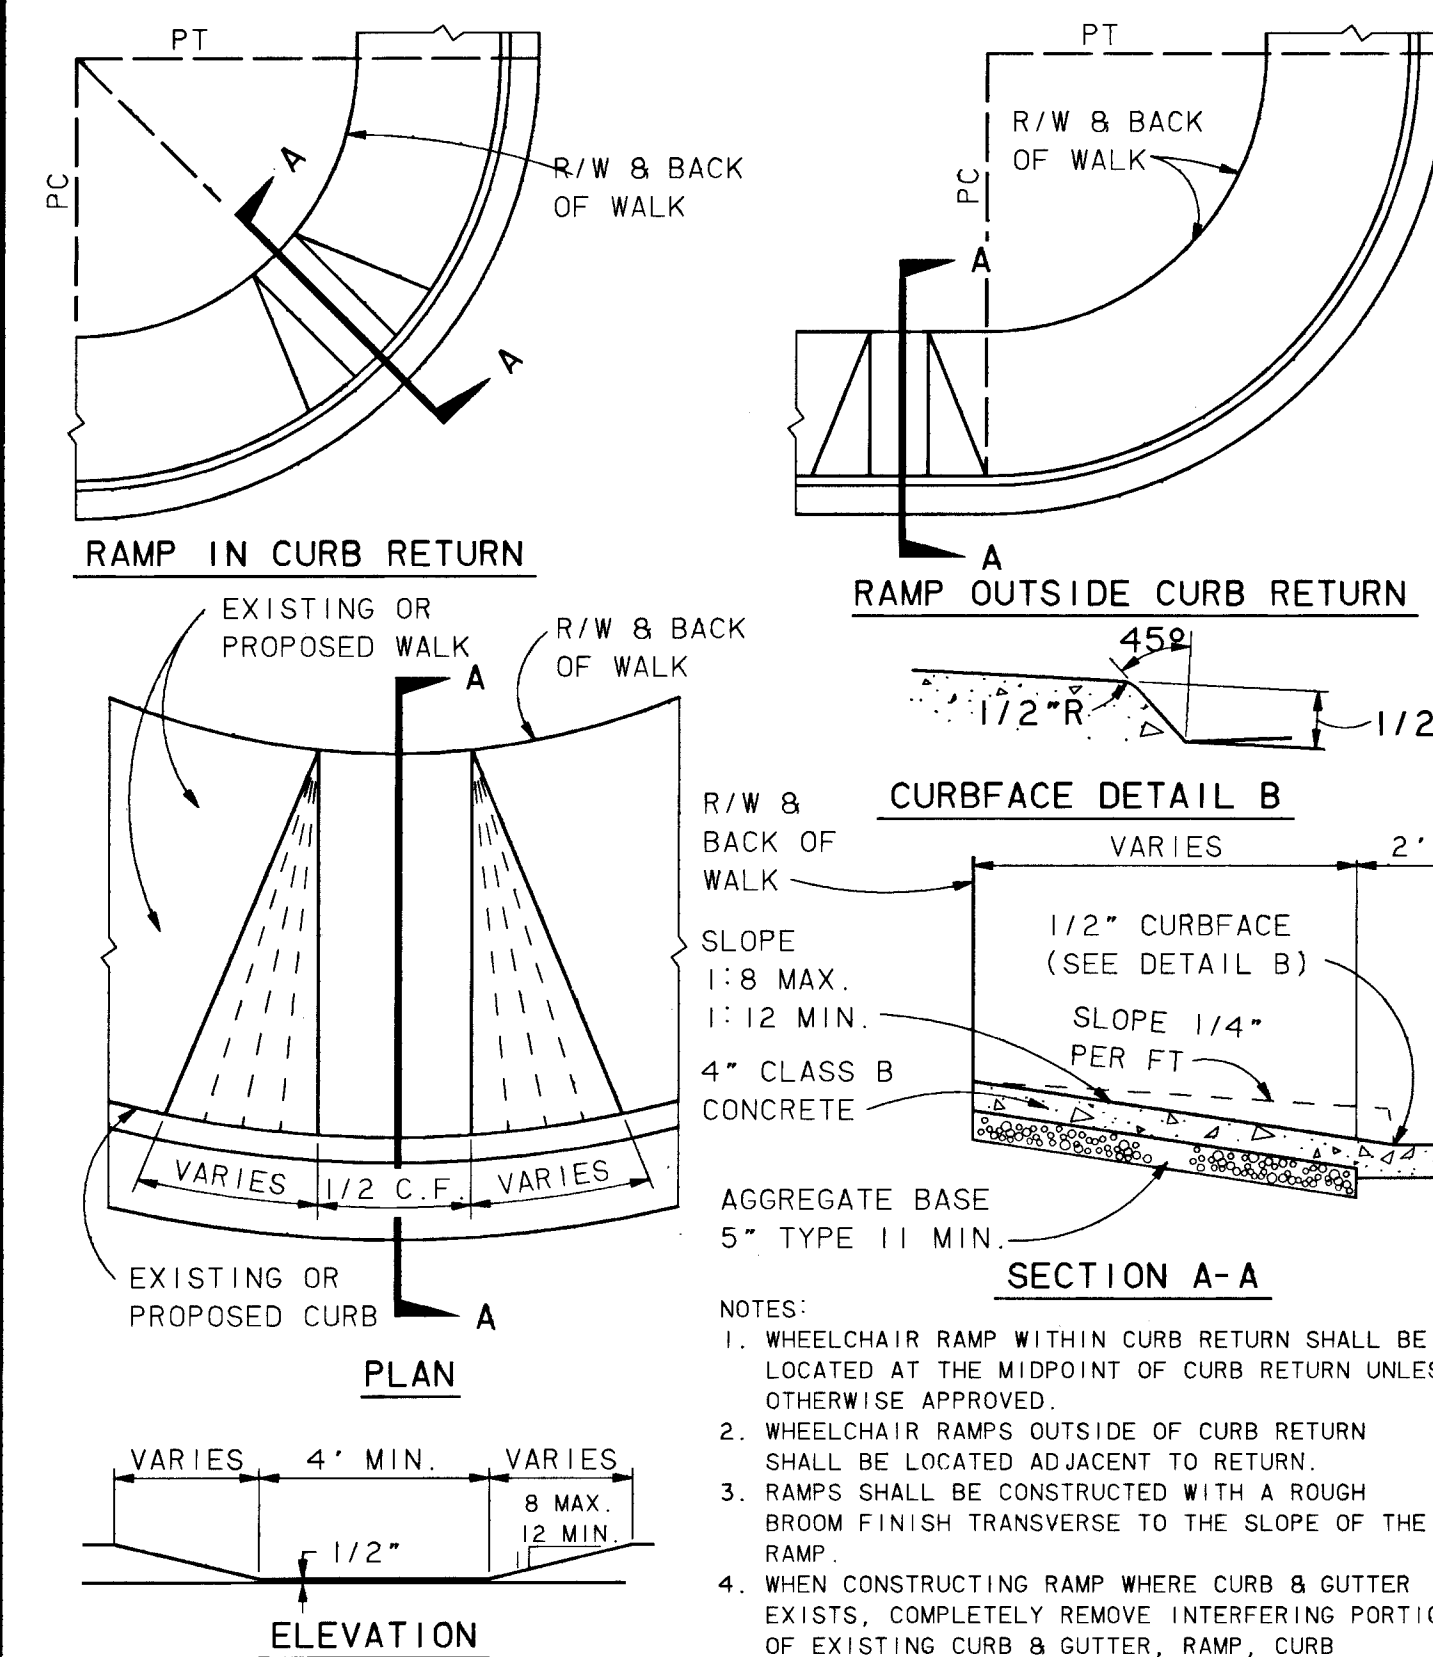


NOTES:

1. WHEELCHAIR RAMP WITHIN CURB RETURN SHALL BE LOCATED AT THE MIDPOINT OF CURB RETURN UNLESS OTHERWISE APPROVED.
2. WHEELCHAIR RAMP OUTSIDE OF CURB RETURN SHALL BE LOCATED ADJACENT TO RETURN.
3. RAMP SHALL BE CONSTRUCTED WITH A ROUGH BROOM FINISH TRANSVERSE TO THE SLOPE OF THE RAMP.
4. WHEN CONSTRUCTING RAMP WHERE CURB & GUTTER EXISTS, COMPLETELY REMOVE INTERFERING PORTIONS OF EXISTING CURB & GUTTER, RAMP, CURB & GUTTER TO BE MONOLITHIC.

WHEELCHAIR RAMPS
STD. DWG. #235

4
C6.01

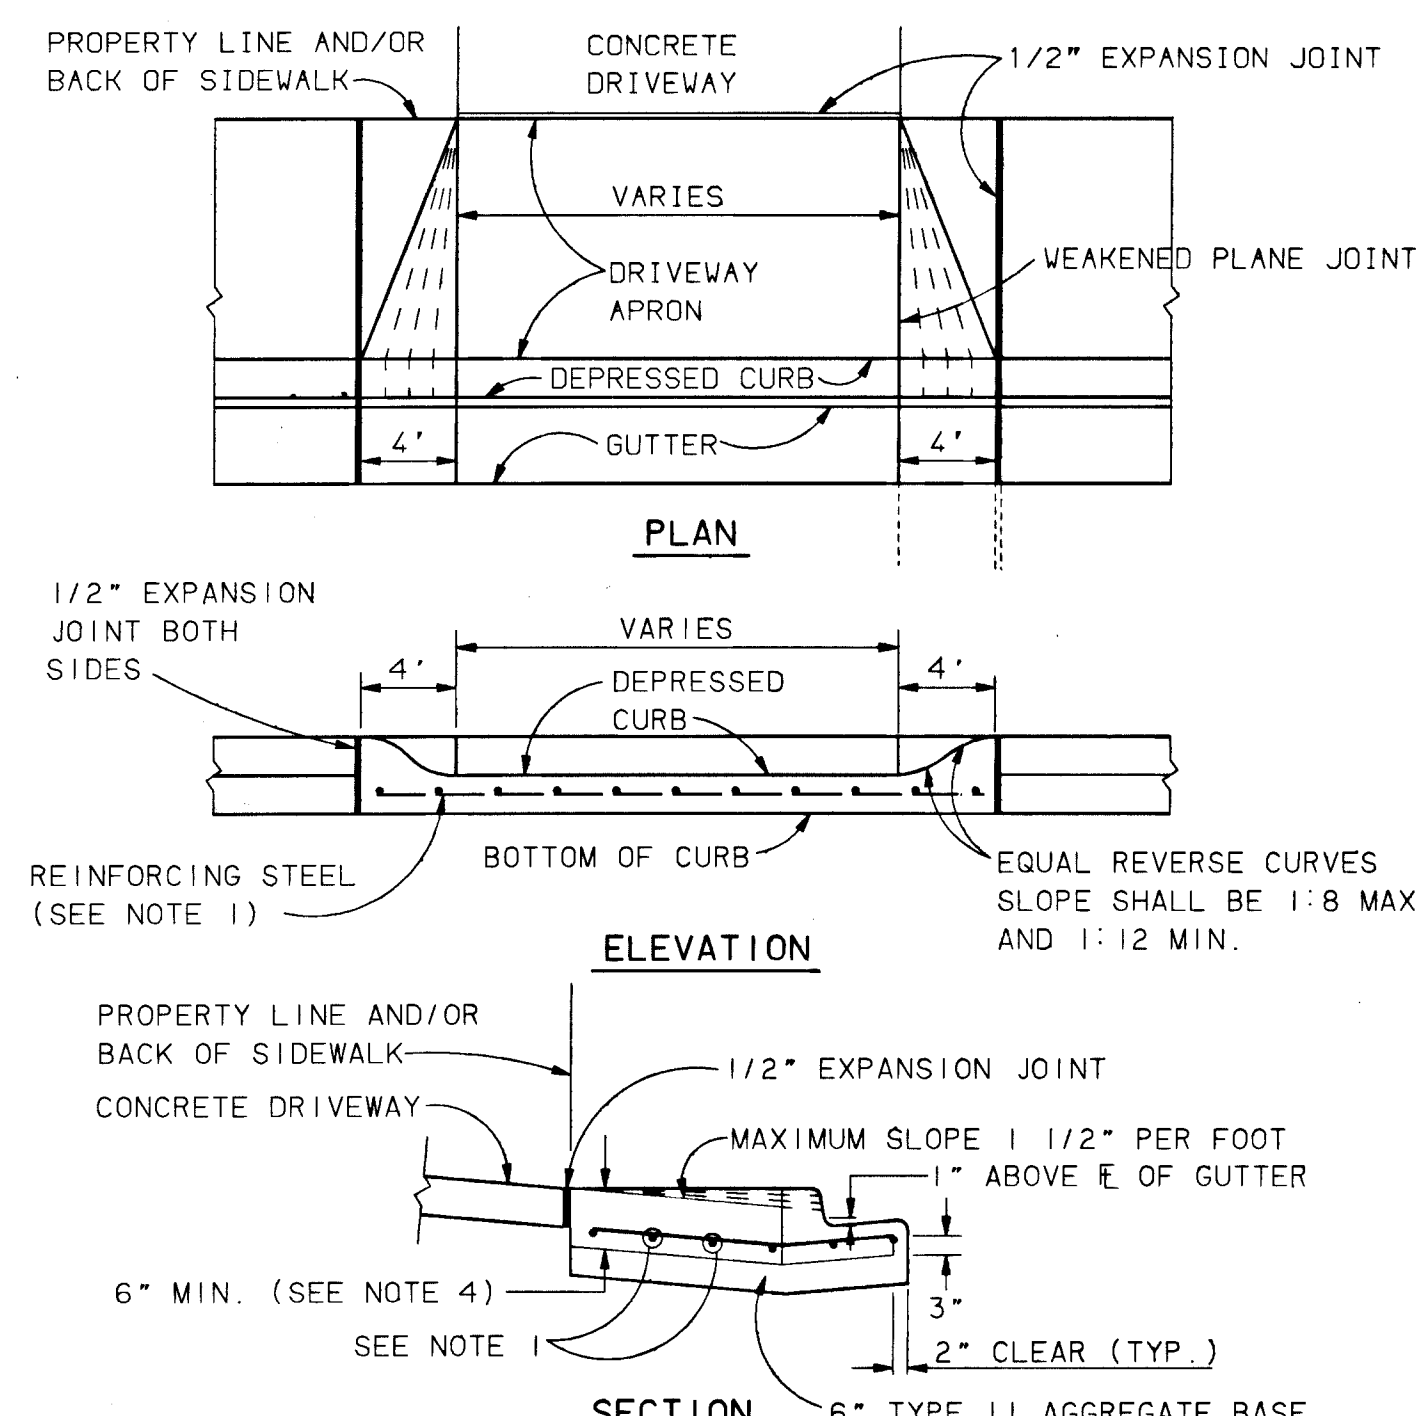


NOTES:

1. NO. 4 BARS @ 16" O.C. BOTH WAYS EXTENDING INTO GUTTER. NO. 4 BARS SHALL BE PLACED 3" ABOVE BOTTOM OF CONCRETE SUPPORTED BY NONFERROUS CHAIRS APPROVED BY THE ENGINEER.
2. WHEN CONSTRUCTING DRIVEWAY WHERE AND GUTTER EXISTS, COMPLETELY REMOVE INTERFERING PORTIONS OF EXISTING CURB AND GUTTER. DRIVEWAY SHALL BE MONOLITHIC TO A.C. LINE.
3. CONCRETE SHALL BE CLASS B.
4. DRIVEWAY THICKNESS FOR INDUSTRIAL USE SHALL BE 8" MIN.
5. WEAKENED PLANE JOINTS SHALL BE EQUALLY SPACED AT 15' MAX. INTERVALS, SEE DWG. 234.

DRIVEWAYS

STD. DWG. #224

5
C6.01

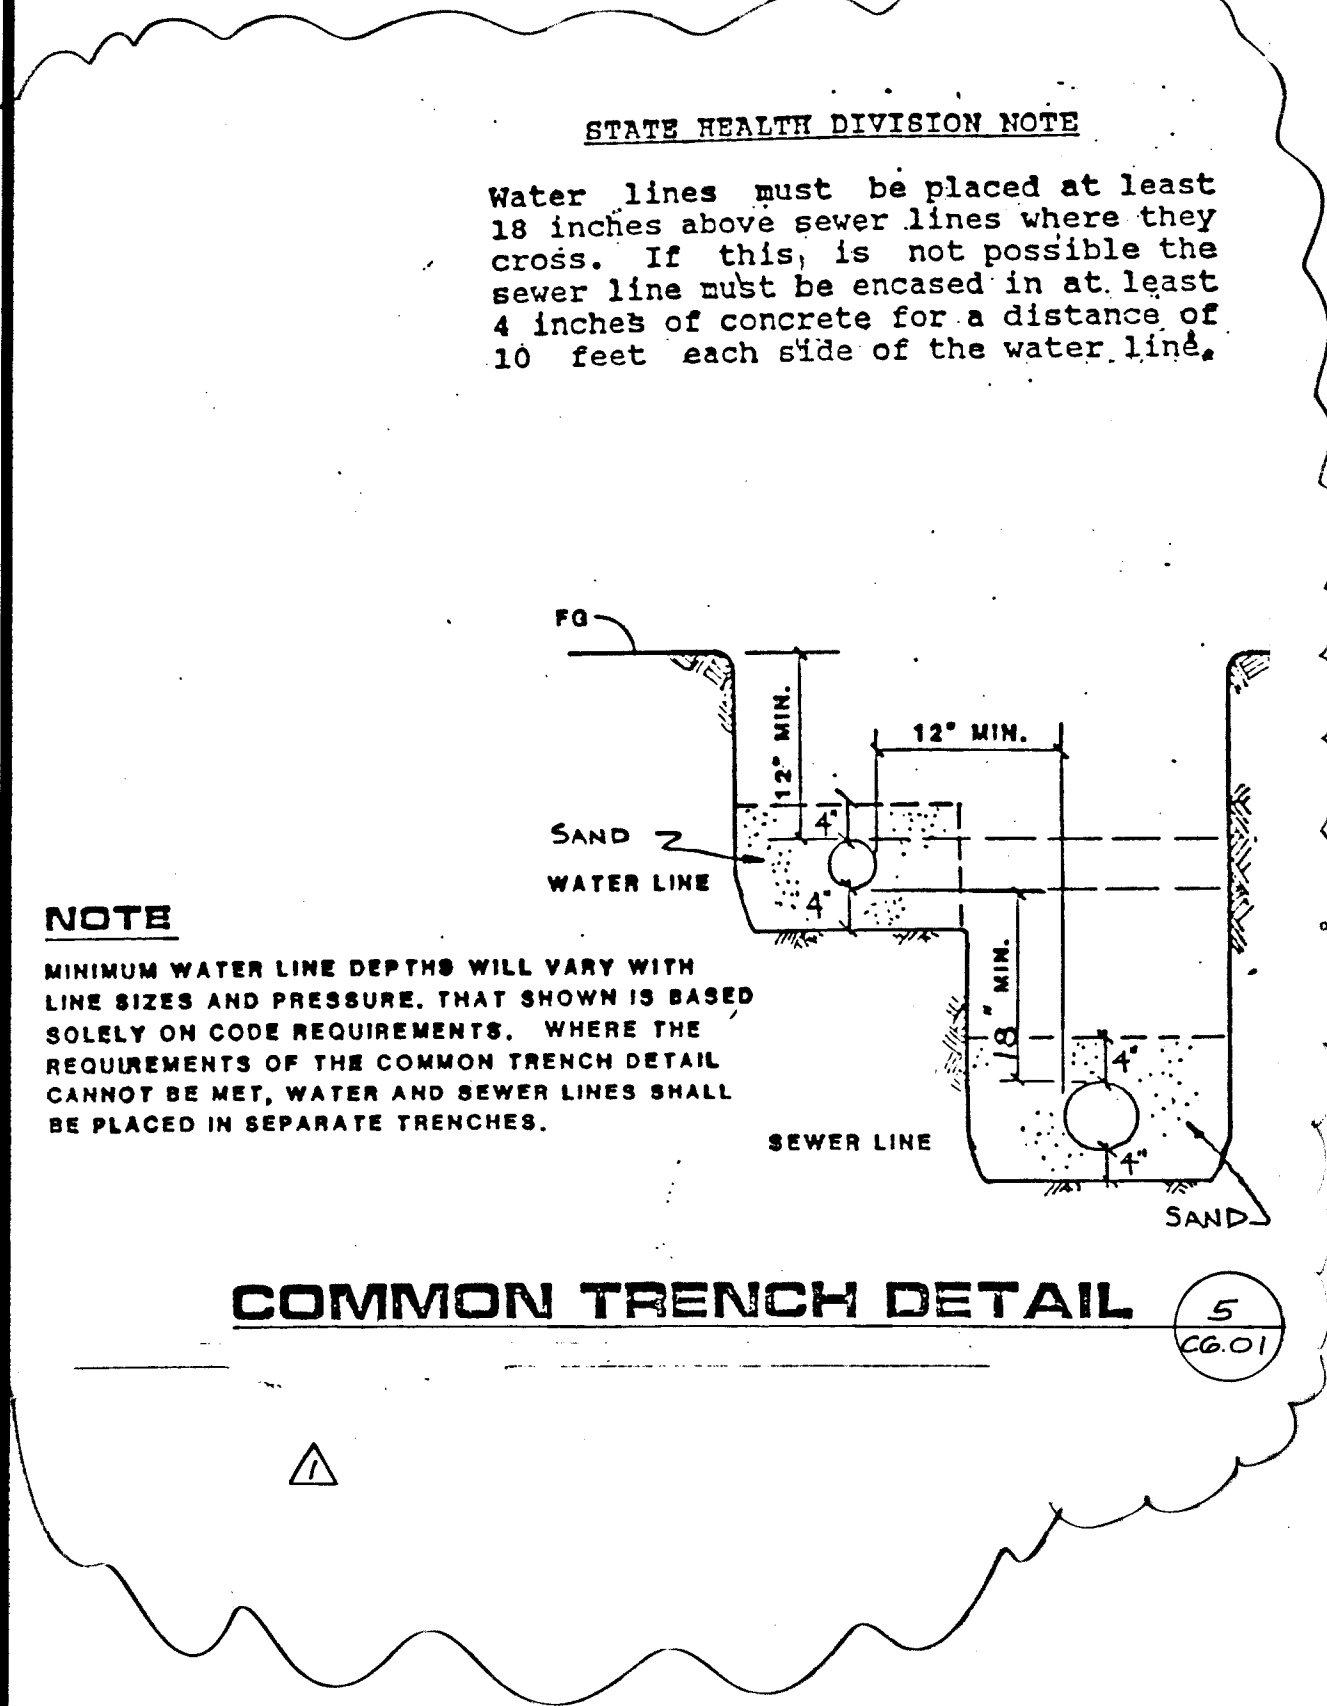


NOTE


MINIMUM WATER LINE DEPTHS WILL VARY WITH LINE SIZES AND PRESSURE. THAT SHOWN IS BASED SOLELY ON CODE REQUIREMENTS. WHERE THE REQUIREMENTS OF THE COMMON TRENCH DETAIL CANNOT BE MET, WATER AND SEWER LINES SHALL BE PLACED IN SEPARATE TRENCHES.

STATE HEALTH DIVISION NOTE

Water lines must be placed at least 18 inches above sewer lines where they cross. If this is not possible the sewer line must be encased in at least 4 inches of concrete for a distance of 10 feet each side of the water line.

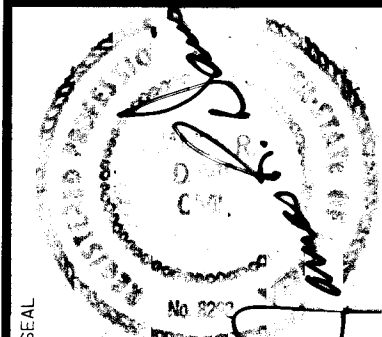

CCSD PROJECT NO.	DATE
CCSD REVIEW	DATE
APPROVED BY	DATE
DATE	
DATE	10-30-89
DRAWN BY	R. YOUNG
CHECKED BY	J. DAVIS
SUBMITTAL	
DATE	
FILE PROJECT NO.	10919

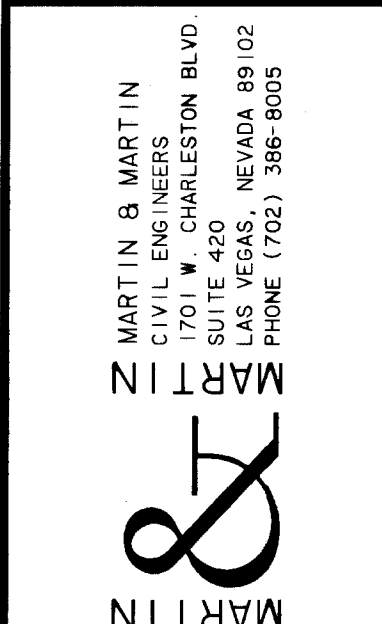

JMA ARCHITECTS & ENGINEERS, INC.
Architecture and Engineering
Research and Planning
Interior and Graphic Design
Landscape Architecture
4292 S. Maryland Parkway
Las Vegas, Nevada 89109-7530
Ph. (702) 731-2033 Fax 731-2039

CLARK COUNTY SCHOOL DISTRICT

SPECIAL PROJECTS 4260 EUCALYPTUS ANEX 795-5025 LAS VEGAS, NEVADA 89121

ROBERT LUNT ELEMENTARY SCHOOL

SECTIONS AND DETAILS

SHEET NO.

C6.01

7 OF 8

7/15-70

2