


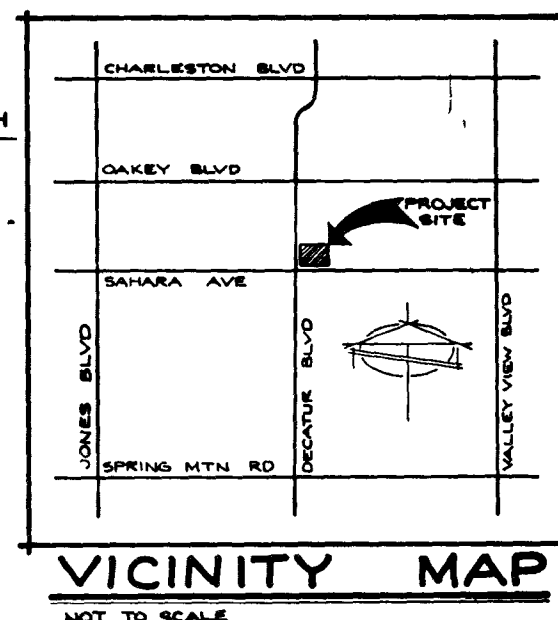

The location of underground utilities shown hereon has been determined from surface evidence of their existence or from information obtained from the utility companies. The Engineer accepts no liability for the existence or non-existence of utility lines. Contractors and others using this map must confirm the location of underground lines or structures with the utility companies prior to commencing any excavation.

FIRE LOOP

WATER NOTES

- 1 All work to conform to Las Vegas Valley Water District latest
Standard Plates and Specifications
- 2 All Work, except as modified hereon or by Note No. 1, shall be
done in accordance with the most current draft or edition
of Uniform Standard Specifications for Public Works
Construction Official Improvements, Clark County Area
- 3 Notice to be given Engineering Department of the Las Vegas
Valley Water District 48 hours prior to actual construction.
- 4 Service saddles or tapped collars will be required on all
1 1/2" and 2" service laterals. Service saddles only will
be permitted on 1 1/2" and 2" service laterals. Double
tapped collars are not permitted
- 5 All lines to be pressure tested to 200 psi.
- 6 Deflection angle shall not exceed 2 1/2 degrees per 13 foot
and 1 1/2" pipe laterals. Deflection angle between 14 inches,
and shall not exceed 2 degrees for pipe sizes between 14" and
16".
- 7 All meters shall be located outside of driveway.
- 8 Detector tape required in accordance with Standard Plate No.
27 where indicated and as follows:
- A. Over all mains not installed at 6 feet from back of curb
 - B. Over all service laterals not installed at right angles
to mains.
- 9 The detector check assembly and vault with non-traffic
cover, shall be installed in accordance with the
District's standard plates and with standard vault drawing C-
475
- 10 Any future block wall or fence must be designed around
the existing meter and detector. The detector must have
direct access to the meter(s) from the adjacent right-of-way.
- 11 Call Before You Dig 1-800-247-2600

Glenn Miller 3/18/80
LAS VEGAS VALLEY WATER DISTRICT DAY

Glenn Miller 3/2/80
CITY OF LAS VEGAS FIRE MARSHALL DAY
SEE COVER SHEET FOR FIRE DEPT. NOTES & DAY

David A. Donnelly 2/22/89
LAWYER Date

FIRE FLOW = 2200 G.P.M.

