

26-4-73

GENERAL NOTES -
LAS VEGAS VALLEY WATER DISTRICT

1. ALL WORK TO CONFORM TO LAS VEGAS VALLEY WATER DISTRICT STANDARD PLATES.
2. ALL WORK, EXCEPT AS MODIFIED HEREON OR BY NOTE NO.1 SHALL BE DONE IN ACCORDANCE WITH THE MOST CURRENT DRAFT OR EDITION OF UNIFORM STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION OFFSITE IMPROVEMENTS CLARK COUNTY AREA, 1976.
3. NOTICE TO BE GIVEN ENGINEERING DEPARTMENT OF THE LAS VEGAS VALLEY WATER DISTRICT 48 HOURS PRIOR TO ACTUAL CONSTRUCTION.
4. SERVICE SADDLES OR TAPPED COLLARS WILL BE REQUIRED ON ALL SERVICES; DOUBLE TAPPED COLLARS ARE NOT PERMITTED.
5. ALL LINES TO BE PRESSURE TESTED TO 200 P.S.I.
6. ALL VALVE BOXES SHALL HAVE CONCRETE COLLARS AT SURFACE OF PAVED AREAS.
7. DEFLECTION ANGLE SHALL NOT EXCEED 2.5 DEGREES PER 15 FOOT SECTION OF PIPE. FOR PIPE SIZES SMALLER THAN 14 INCHES AND SHALL NOT EXCEED 2 DEGREES FOR PIPE SIZES BETWEEN 14" AND 16".
8. ALL METERS SHALL BE LOCATED OUTSIDE OF DRIVEWAYS.
9. NO OTHER UTILITY LINES MAY BE PLACED IN SAME TRENCH WITH WATER LINE.
10. ALL WATER SERVICE LOCATIONS TO BE PERMANENTLY IDENTIFIED ON CURB BY INSTALLING CONTRACTOR.
11. DO NOT FIELD CHANGE LOCATIONS OF WATER SERVICES WITHOUT PRIOR APPROVAL OF THE L.V.V.W.D.
12. ALL LINES SHALL BE MINIMUM OF 3 FEET DEPTH.
13. CONTRACTOR TO VERIFY EXACT LOCATION OF EXISTING UTILITIES PRIOR TO CONSTRUCTION.

FIRE DEPARTMENT NOTES -

1. ALL WORK SHALL BE DONE IN STRICT ACCORDANCE WITH THE C.L.V. STANDARD SPECIFICATIONS.
2. ALL WORK SHALL BE DONE IN STRICT ACCORDANCE WITH THE C.L.V. FIRE DEPARTMENT HYDRANT SPECIFICATIONS, HYDRANT INSTALLATIONS AND WATER RESOLUTION REQUIREMENTS.
3. ON ANY NEW HOME OR BUILDING CONSTRUCTION, ACCESSIBLE FIRE HYDRANTS SHALL BE INSTALLED BEFORE ACTUAL CONSTRUCTION COMMENCES AND SAID FIRE HYDRANTS SHALL BE IN GOOD WORKING ORDER WITH AN ADEQUATE WATER SUPPLY.
4. PAINTING OF CURBS AND/OR STRIPING OF ASPHALT AREAS AND PROTECTION OF HYDRANTS FROM PHYSICAL INJURY PER THE C.L.V. FIRE DEPARTMENT HYDRANT INSTALLATION SPECIFICATIONS SHALL BE COMPLETED BEFORE APPROVAL OF THE HYDRANTS BY THE C.L.V. FIRE DEPARTMENT CAN BE OBTAINED.
5. NO FIRE HYDRANT SHALL BE LOCATED WITHIN SIX FEET OF DRIVEWAY, SIX FEET OF A POWER POLE, LIGHT STANDARD OR OTHER OBSTRUCTION FOR WALL, FENCE AND PLANTER LOCATIONS, DRAWING 44.1 SHALL BE USED.

WATER —
QUANTITIES & LEGEND

ITEM	QUANTITY
ONSITE:	
1. WATER MAIN, 6" ACP	----- LF
2. WATER MAIN, 8" ACP	----- LF
3. WATER MAIN, 10" ACP	----- LF
4. WATER MAIN, 12" ACP	----- LF
5. WATER MAIN, 16" ACP	----- LF
6. WATER MAIN	----- LF
7. FIRE HYDRANTS	----- EA
8. WATER SERVICES (3/4")	----- EA
OFFSITE:	
1. WATER MAIN, 6" ACP	----- LF
2. WATER MAIN, 8" ACP	----- LF
3. WATER MAIN, 10" ACP	----- LF
4. WATER MAIN, 12" ACP	----- LF
5. WATER MAIN, 16" ACP	----- LF
6. WATER MAIN	----- LF
7. FIRE HYDRANTS	----- EA
8. WATER SERVICES (3/4")	----- EA

— APPROVALS —


Michael P. Reago Dec 31, 1979
LAS VEGAS VALLEY WATER DISTRICT DATE

W. W. Barber 12-31-79
CITY OF LAS VEGAS FIRE DEPARTMENT DATE

GARY HOLLER
CITY OF LAS VEGAS ENGINEER DATE

NA
FIELD OPERATIONS ENGINEER DATE


9-23-80
QUALITY CONTROL SUPERVISOR DATE

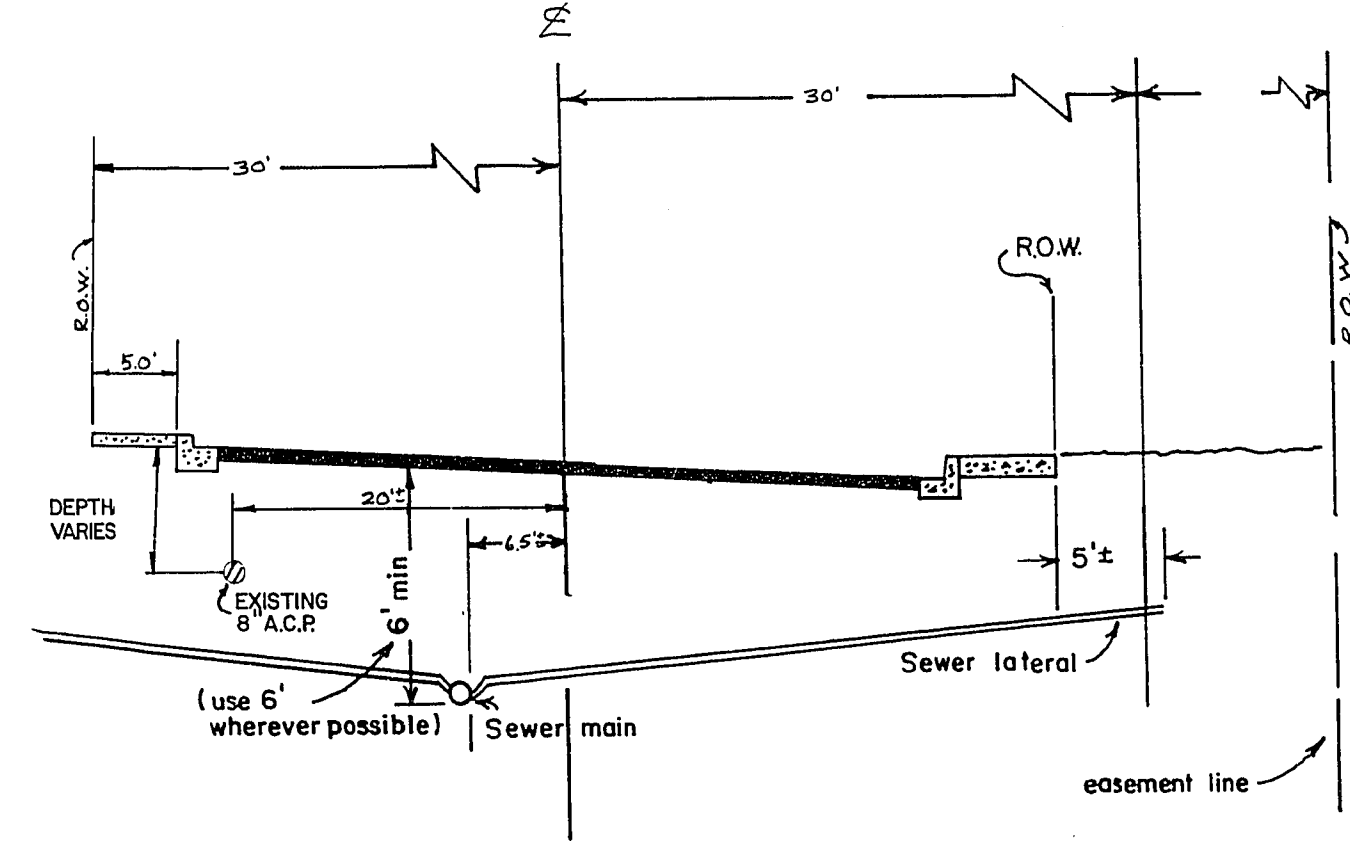

TYPICAL STREET SECTION

Scale 1" = 10'

NOTE: ONE 5' SECTION OF V.C.P. PIPE SHALL BE LAID PAST THE PROPERTY LINE OR UTILITY EASEMENT IF APPLICABLE

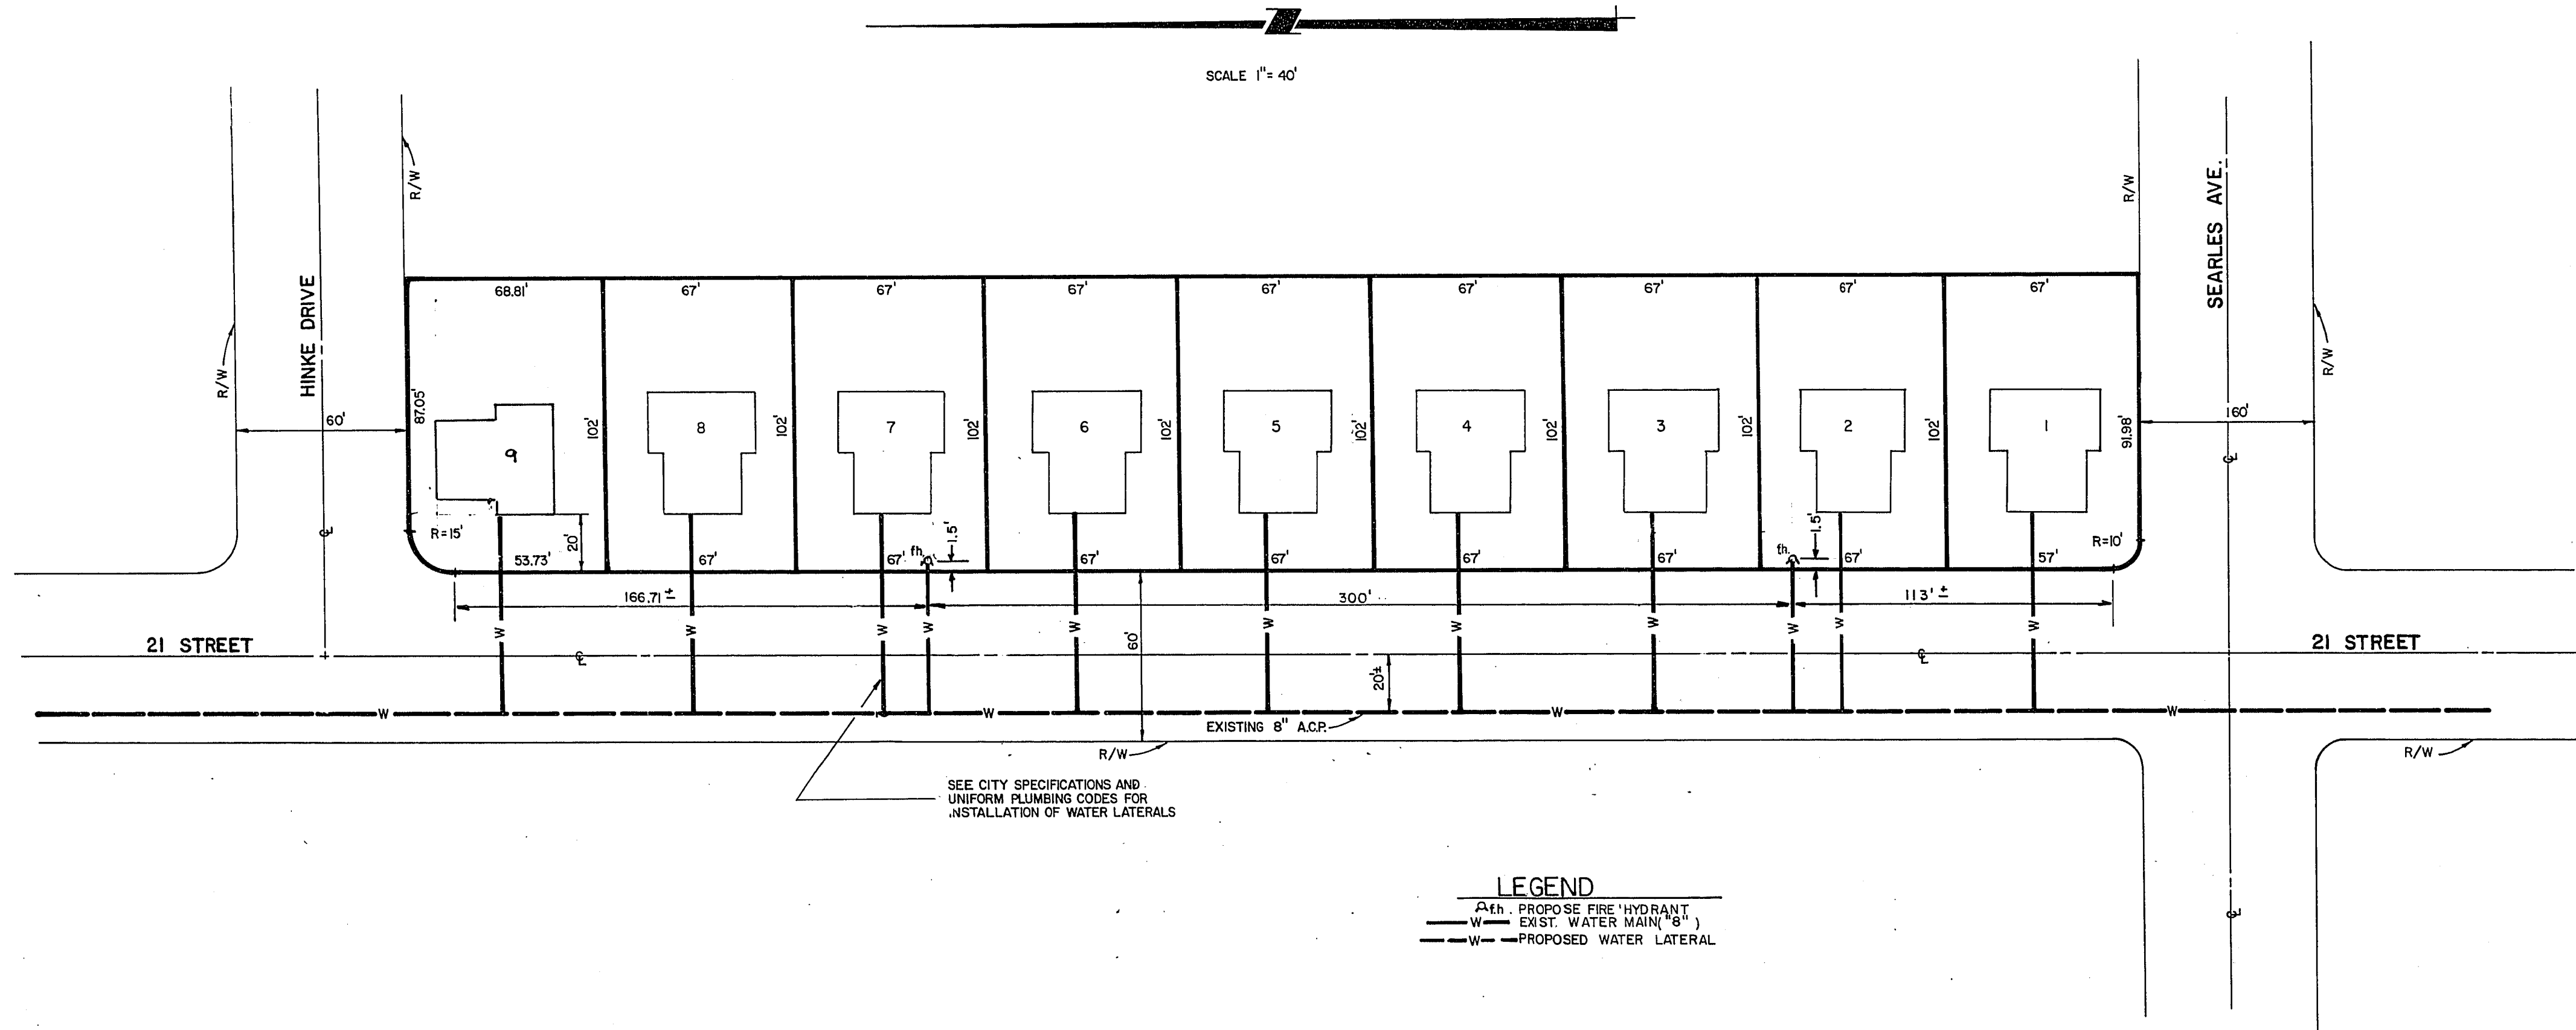

LEGEND
Ath. PROPOSE FIRE HYDRANT
W- EXIST. WATER MAIN (8")
--- PROPOSED WATER LATERAL

WATER PLAN of

STRATTON GARDENS

PTN. NE 1/4, NE 1/4,
SEC. 20, T20S, R61E,
M.D.B. & M.

SCALE: 1" = 40'
DATE: 1-22-79

DRN. BY: J. PASCOE
DATE: 1-22-79
CHECKED BY: R.F.
DATE: 6/10/79

RICK STRATTON
26 ROME PARK
FOR: LAS VEGAS VALLEY DRIVE, LOS CASA VEGAS
LAS VEGAS, NEVADA

BY: Avery
ENGINEERING CONSULTANTS
(DIV. OF AVERY CORPORATION)
1401 Maryland Parkway
Las Vegas, Nevada (702) 385-3877

REVISED DATE:
9/12/80 B.A.S.
DRAWING NO. A9-6
8 of 9

