


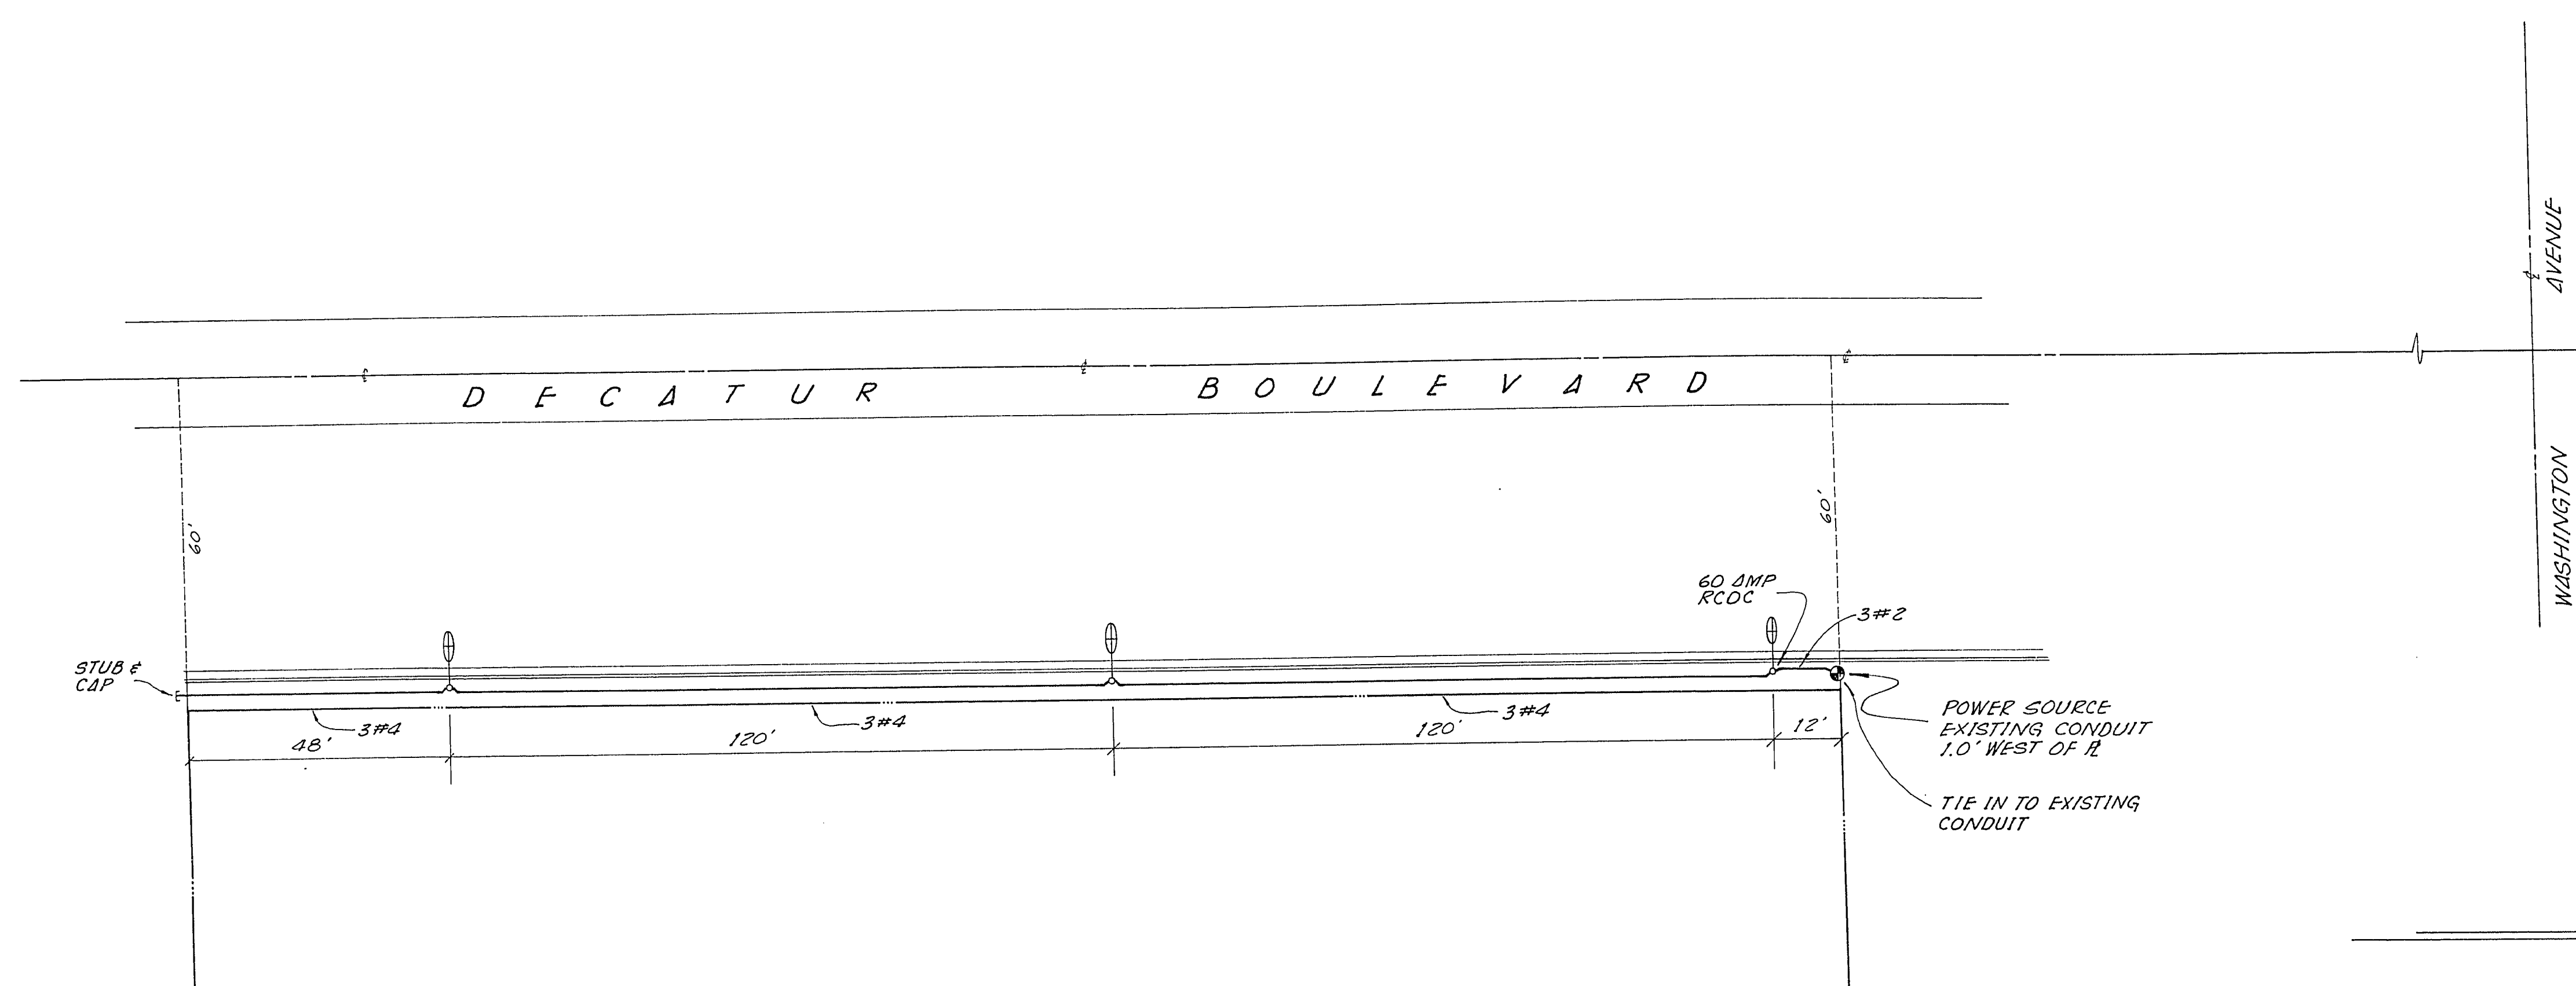

- NOTES:
1. ALL CONSTRUCTION TO CONFORM TO UNIFORM STANDARD SPECIFICATIONS (AND DRAWINGS) FOR PUBLIC WORKS CONSTRUCTION CLARK COUNTY AREA.
 2. ALL POLES TO BE LOCATED 15 FT. BACK OF CURB.
 3. ALL STREET LIGHT FOUNDATIONS SHALL BE AS PER STD. DWG. 4030.
 4. LIGHT STANDARDS SHALL BE 11 GAUGE AND SHALL BE AS PER STD. DWG. 4001.
 5. ALL CONDUITS SHALL BE 1 1/4" P.V.C. SCH. 40, TO BE LOCATED UNDER THE SIDEWALK AND HAVE 24" MIN. COVER IN ALL AREAS. CONDUIT SHALL BE STUBBED 2.0 FT. PAST PROPERTY LINE (SOUTH) FOR FUTURE CONNECTIONS.
 6. LIGHTING SYSTEM TO BE 120/240 VOLT 60 CYCLE SINGLE PHASE 3 WIRE MULTIPLE UNDERGROUND 400 W (TYPE OV 25 WESTINGHOUSE OR EQUIV.) LUMINAIRES TO BE CONNECTED 120 V GROUND NEUTRAL TO EACH POLE. SPEC. DATED JAN 1, 1968 TO APPLY.
 7. WIRE SHALL BE 3 #4 THW TWO COLOR (1 WHITE)

ESTIMATED QUANTITIES	
1 1/4" P.V.C.	302 LIN. FT.
11 GA POLES	3 EA.
400 W.M.V. LUMINAIRE	3 EA.

REVISIONS

APPROVALS

10-12-69
DATE
11/3/69
DATE
11/3/69
DATE
CITY ENGINEER
CITY ELECTRICIAN

LEAVITT & HOLLER
SURVEYORS LIMITED
REGISTERED PROFESSIONAL ENGINEERS
5336 EAST SAHARA AVENUE
LAS VEGAS, NEVADA
PHONE 735-0230

SCALE
1" = 20'
DATE
CHECK

STREET LIGHT DESIGN
DECATUR BOULEVARD

A PORTION OF THE
TOWNSHIP 20 SOUTH, RANGE 67 EAST
SECTION 30, TOWNSHIP 20 SOUTH, RANGE 67 EAST
CITY OF LAS VEGAS
NEVADA