

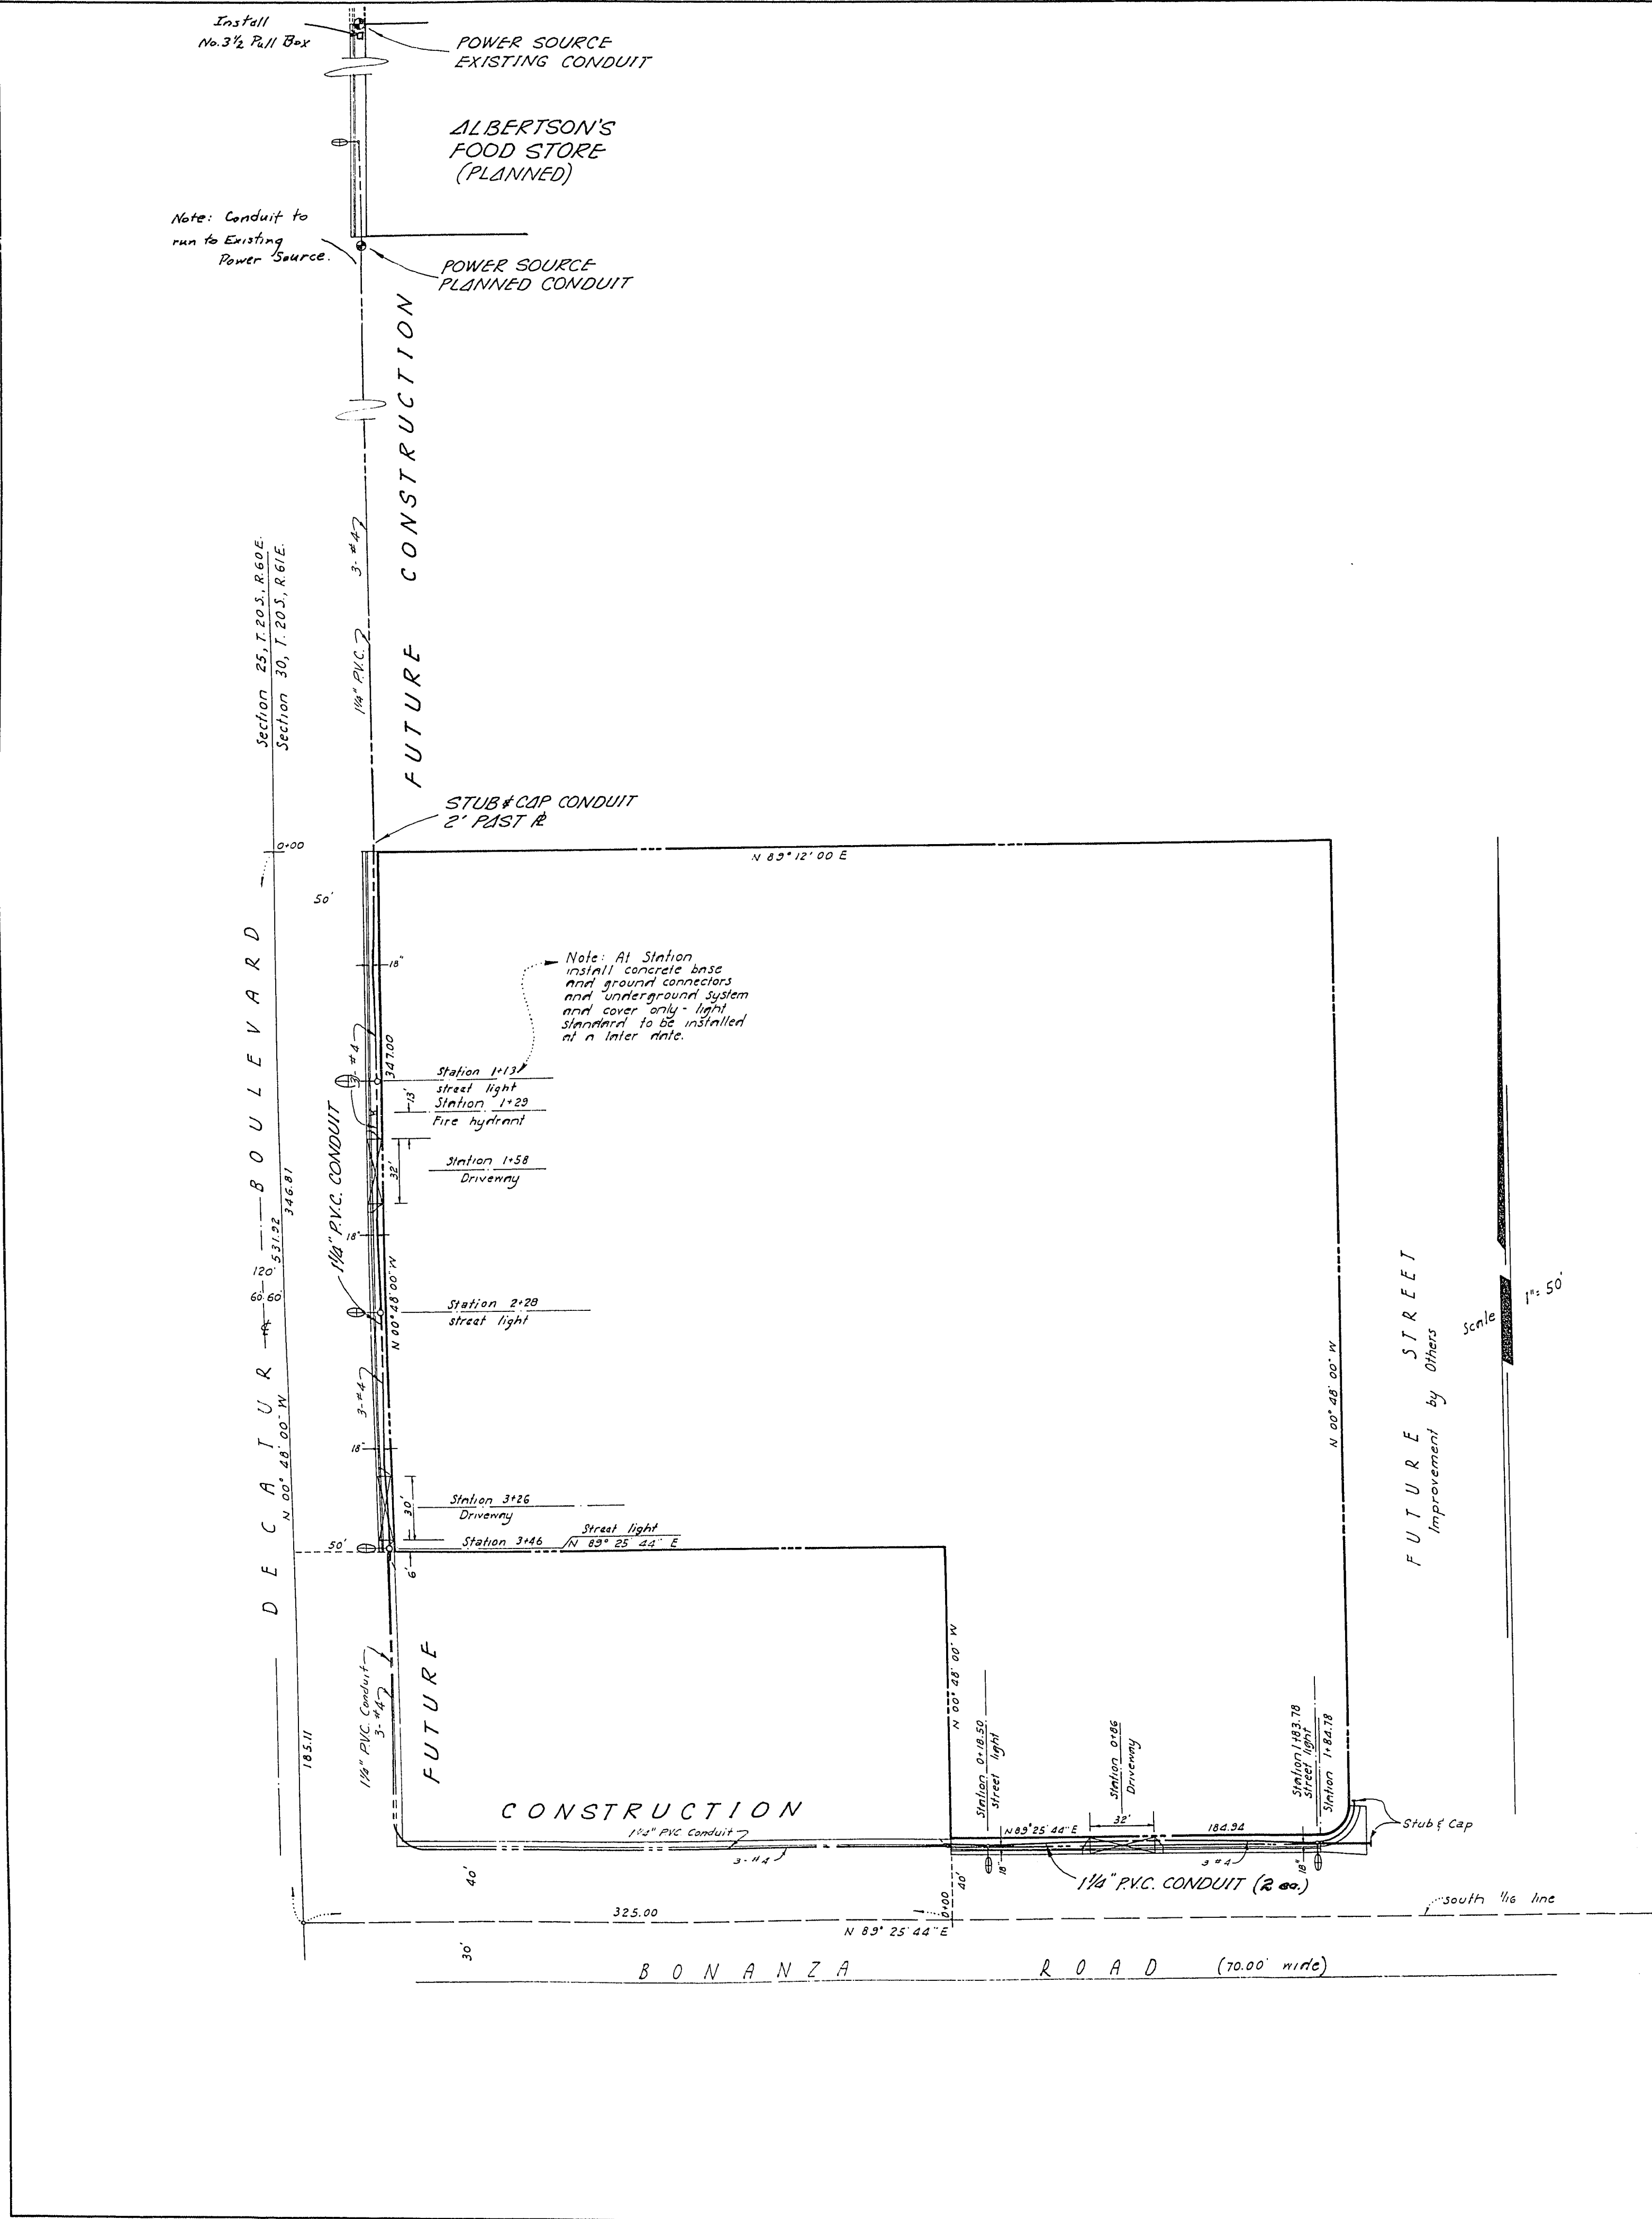


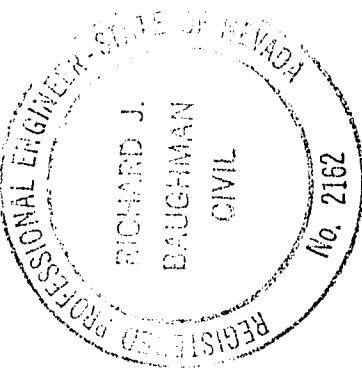

- NOTES
1. All construction shall conform to Uniform Standard Specifications and Drawings for Public Works Construction - Clark County Area.
 2. All poles to be located 18" back of curb.
 3. All street light foundations shall be as per Standard Drawing No. 2030.
 4. Light Standards shall be 11 gauge and shall be as per Standard Dwg. 4001.
 5. All conduit shall be 1 1/4" P.V.C. Sch. 40, to be located under sidewalk and have 24" cover in all areas. Conduit shall be stubbed 2' past end of sidewalk for future connections.
 6. Lighting system to be 120/240 volt, 60 amp. multiple relay 400 watt (type OV 25 Westinghouse or equal) luminaire, to be connected to 240 volt ground neutral to each pole. (Underground Specs. dated Jan. 1, 1968 to apply).
 7. Wire to be No. 4, 3 wire, 2 color (1 white).

ESTIMATED QUANTITIES

1 1/4" P.V.C. (Street light)	1030 lin. ft.
11 gauge poles	4 each
400 watt luminaire	4 each
No. 3 1/2 Pull Box	1 each
1 1/4" P.V.C. (Fire Alarm)	210 lin. ft.

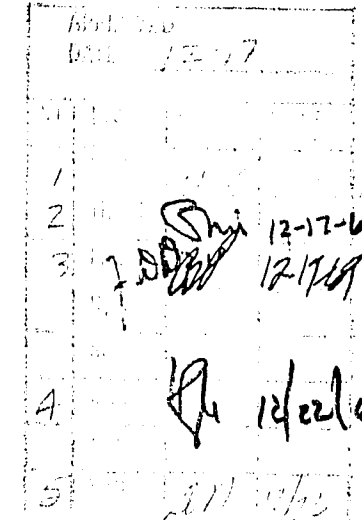

STREET LIGHT PLAN BONANZA ROAD and DECATUR BOULEVARD A portion of the NW 1/4 SW 1/4 of Section 30 T. 20 S. R. 61 E. M.D.M. City of Las Vegas Nevada		LEAVITT & ASSOCIATES Consulting Engineers 336 East Sahara Avenue Las Vegas, Nevada Design: Richard J. Baughman R.E. 2162	Scale: 1" = 50'	City Engineer Date: 12/20/69
REVISIONS		APPROVALS Richard J. Baughman Nevada Power Company Date: 12-14-69	Date: 12-17-69	Date: 12-20-69