
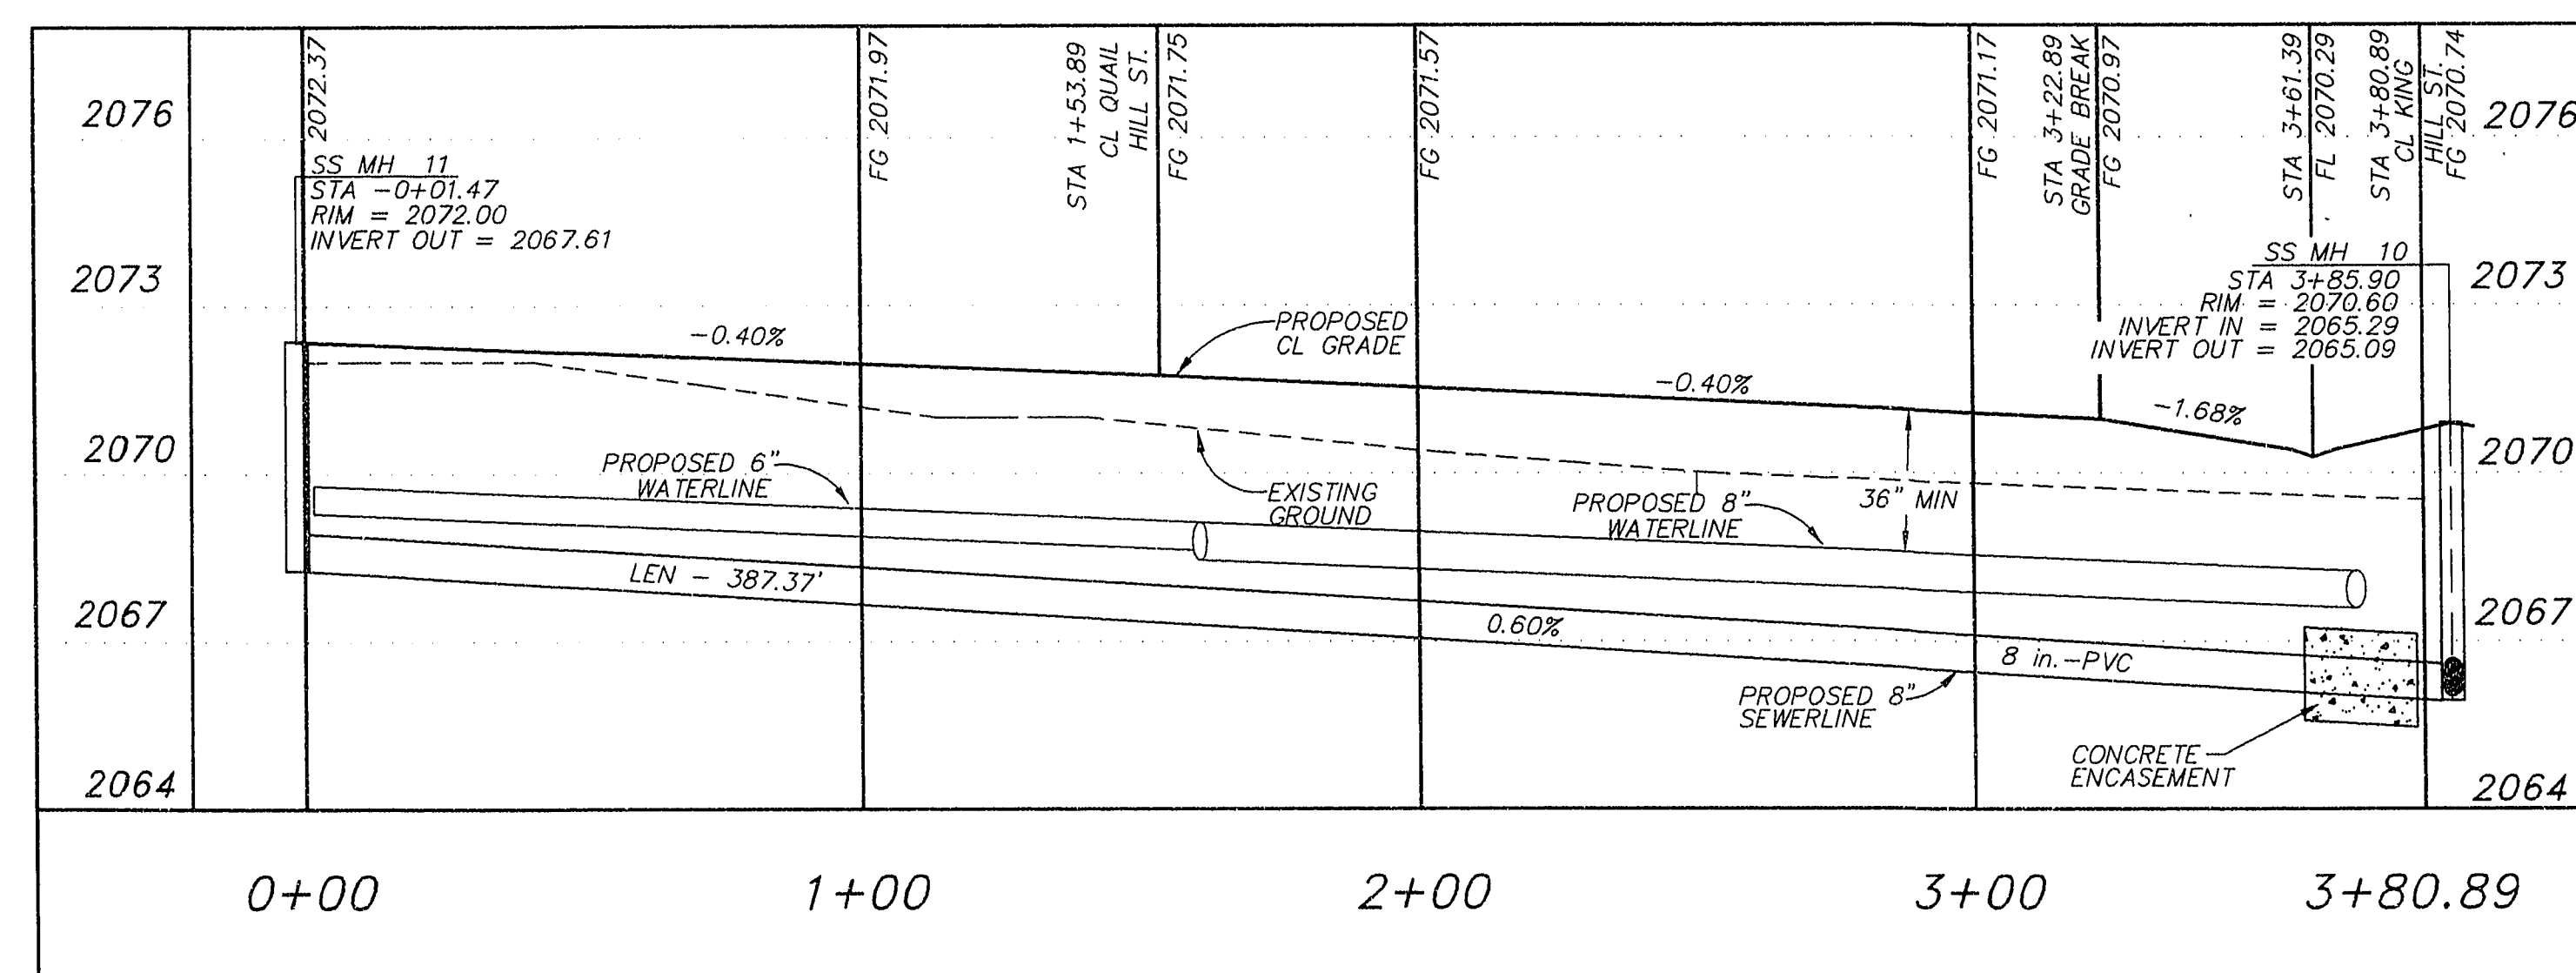
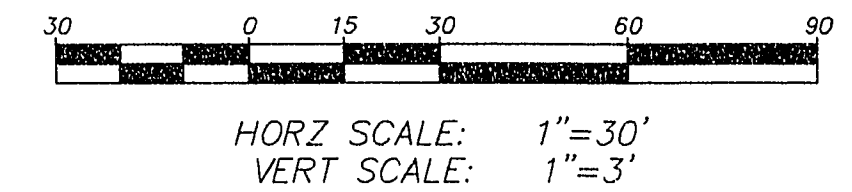
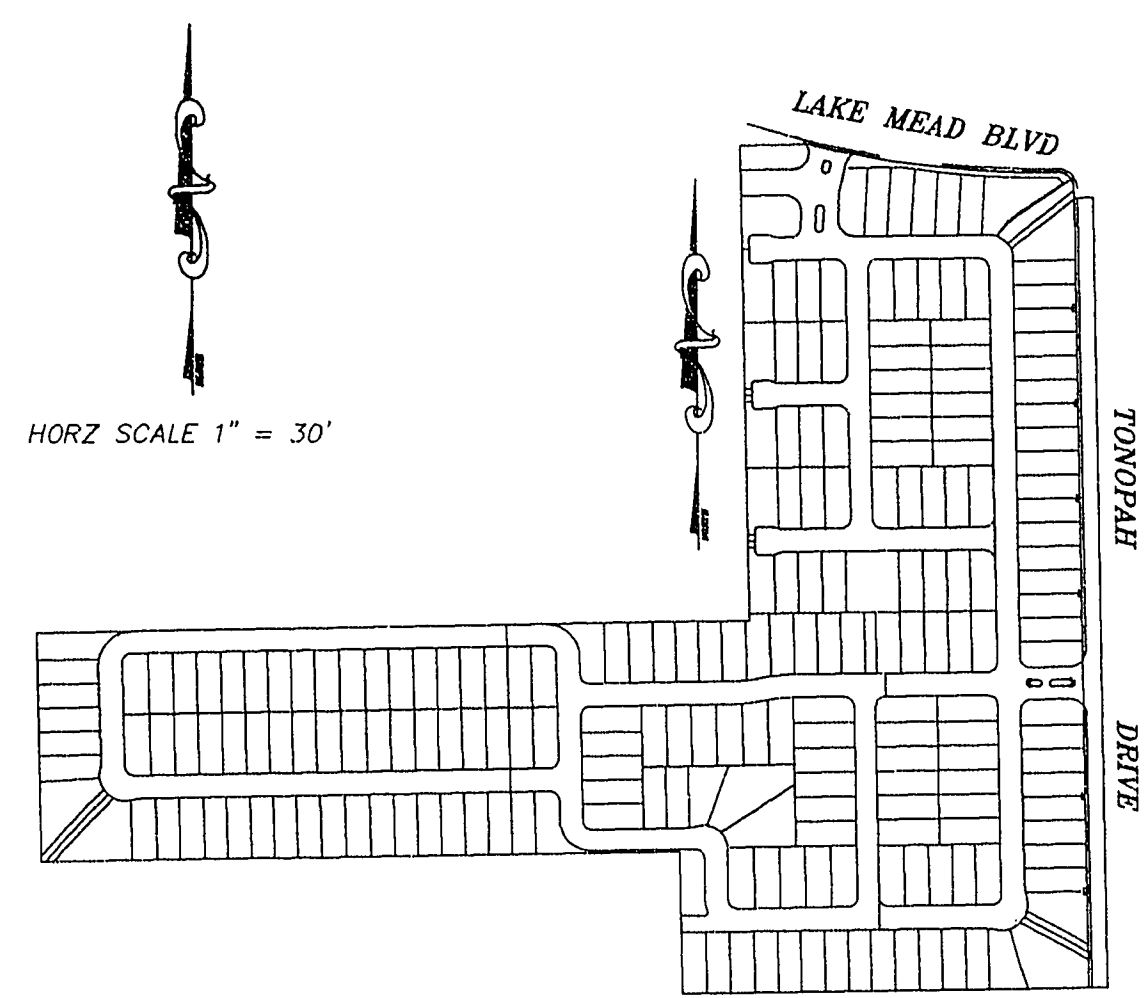





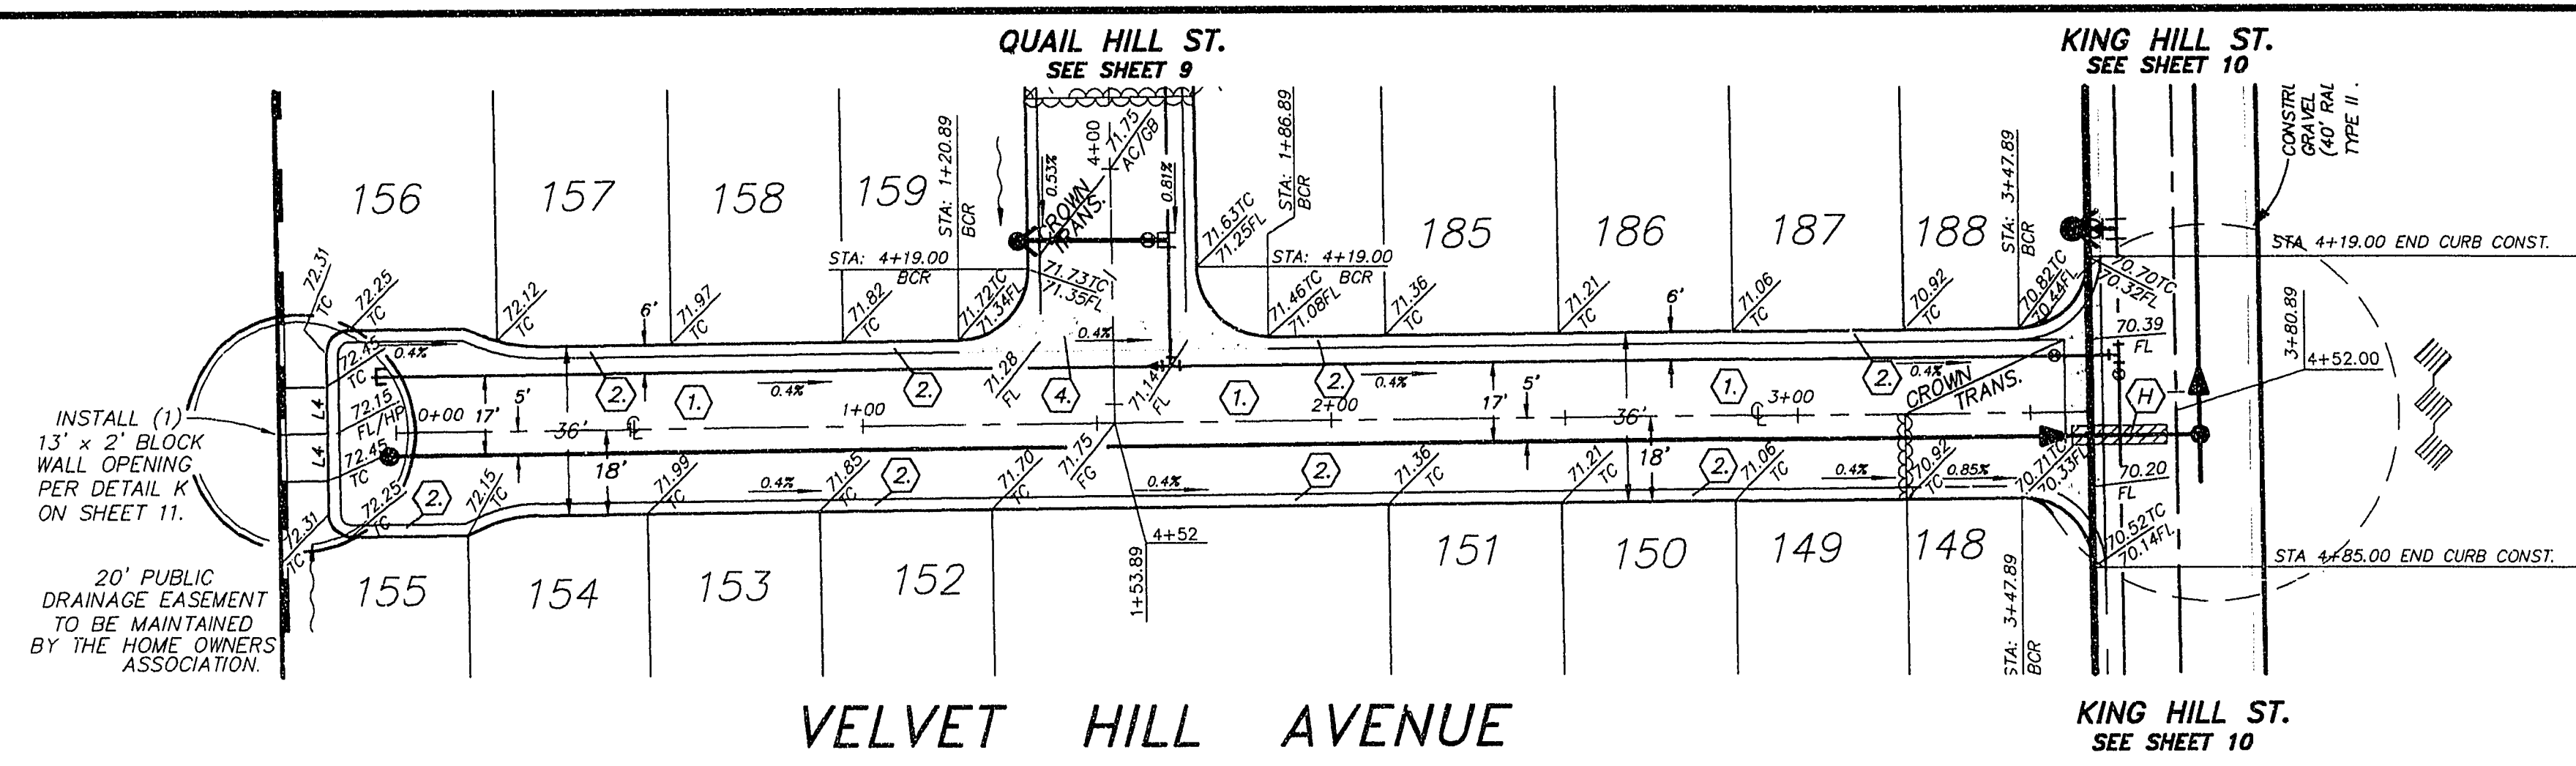


NOTES:

1. NOTIFY HUNSAKER & ASSOCIATES IMMEDIATELY OF ANY DISCREPANCIES IN THE PLANS OR CONDITIONS IN THE FIELD.
2. PRIOR TO CONSTRUCTION THE CONTRACTOR SHALL LOCATE AND VERIFY SIZE, MATERIAL, DEPTH, CONDITION, PRESSURE, AND LOCATION OF ALL EXISTING UTILITY LINES WITHIN THE CONSTRUCTION AREA. HUNSAKER & ASSOCIATES SHALL BE CONTACTED ONCE THE UTILITY LINE IS LOCATED.
3. PLANS MAY NOT INDICATE ALL EXISTING UTILITY LINES. CONTRACTOR IS TO EXERCISE EXTREME CAUTION DURING EXCAVATION IN ORDER TO AVOID DAMAGING ANY EXISTING UTILITY LINES. IF THE UTILITY LINES ARE DAMAGED BY THE CONTRACTOR, SUCH DAMAGE SHALL BE REPAIRED TO THE SATISFACTION OF THE OWNER AT THE CONTRACTOR'S EXPENSE.
4. CONTRACTOR TO SAWCUT AND REMOVE EXISTING ASPHALT AND CONCRETE AS NECESSARY FOR UTILITY TRENCHES. BACKFILL AND PATCH ALL TRENCHES ACCORDING TO CITY OF LAS VEGAS STANDARDS.
5. ALL WATER SERVICE LINES AND METERS SHALL BE INSTALLED PER L.V.W.D.
6. CONTRACTOR TO FIELD VERIFY LOCATION AND INVERT OF MANHOLE PRIOR TO CONSTRUCTION. HUNSAKER & ASSOCIATES SHALL BE CONTACTED ONCE THIS INFORMATION HAS BEEN OBTAINED.

LEGEND:

- 100.00 DESIGN ELEVATION
- (100.00) EXISTING ELEVATION
- AC ASPHALTIC CONCRETE
- TC TOP OF CURB
- FG FINISH GRADE
- GB GRADE BREAK
- HP HIGH POINT
- PE PAD ELEVATION
- FF FINISH FLOOR
- FL FLOWLINE
- SLOPE DIRECTION
- SWALE/FLOWLINE
- GRADE BREAK
- 1 EXISTING CONTOUR (1' INTERVAL)
- 5 EXISTING CONTOUR (5' INTERVAL)
- 2 CONSTRUCTION NOTES
- 10 LOT NUMBER
- 2 BLOCK NUMBER
- PROPOSED WATER LINE
- PROPOSED FIRE HYDRANT
- PROPOSED GATE VALVE
- CONSTRUCT SEWER CROSSING ENCASE SEWER LINE IN CONC. 10' EACH SIDE OF WATER LINE.
- EXISTING TELEPHONE CABLE

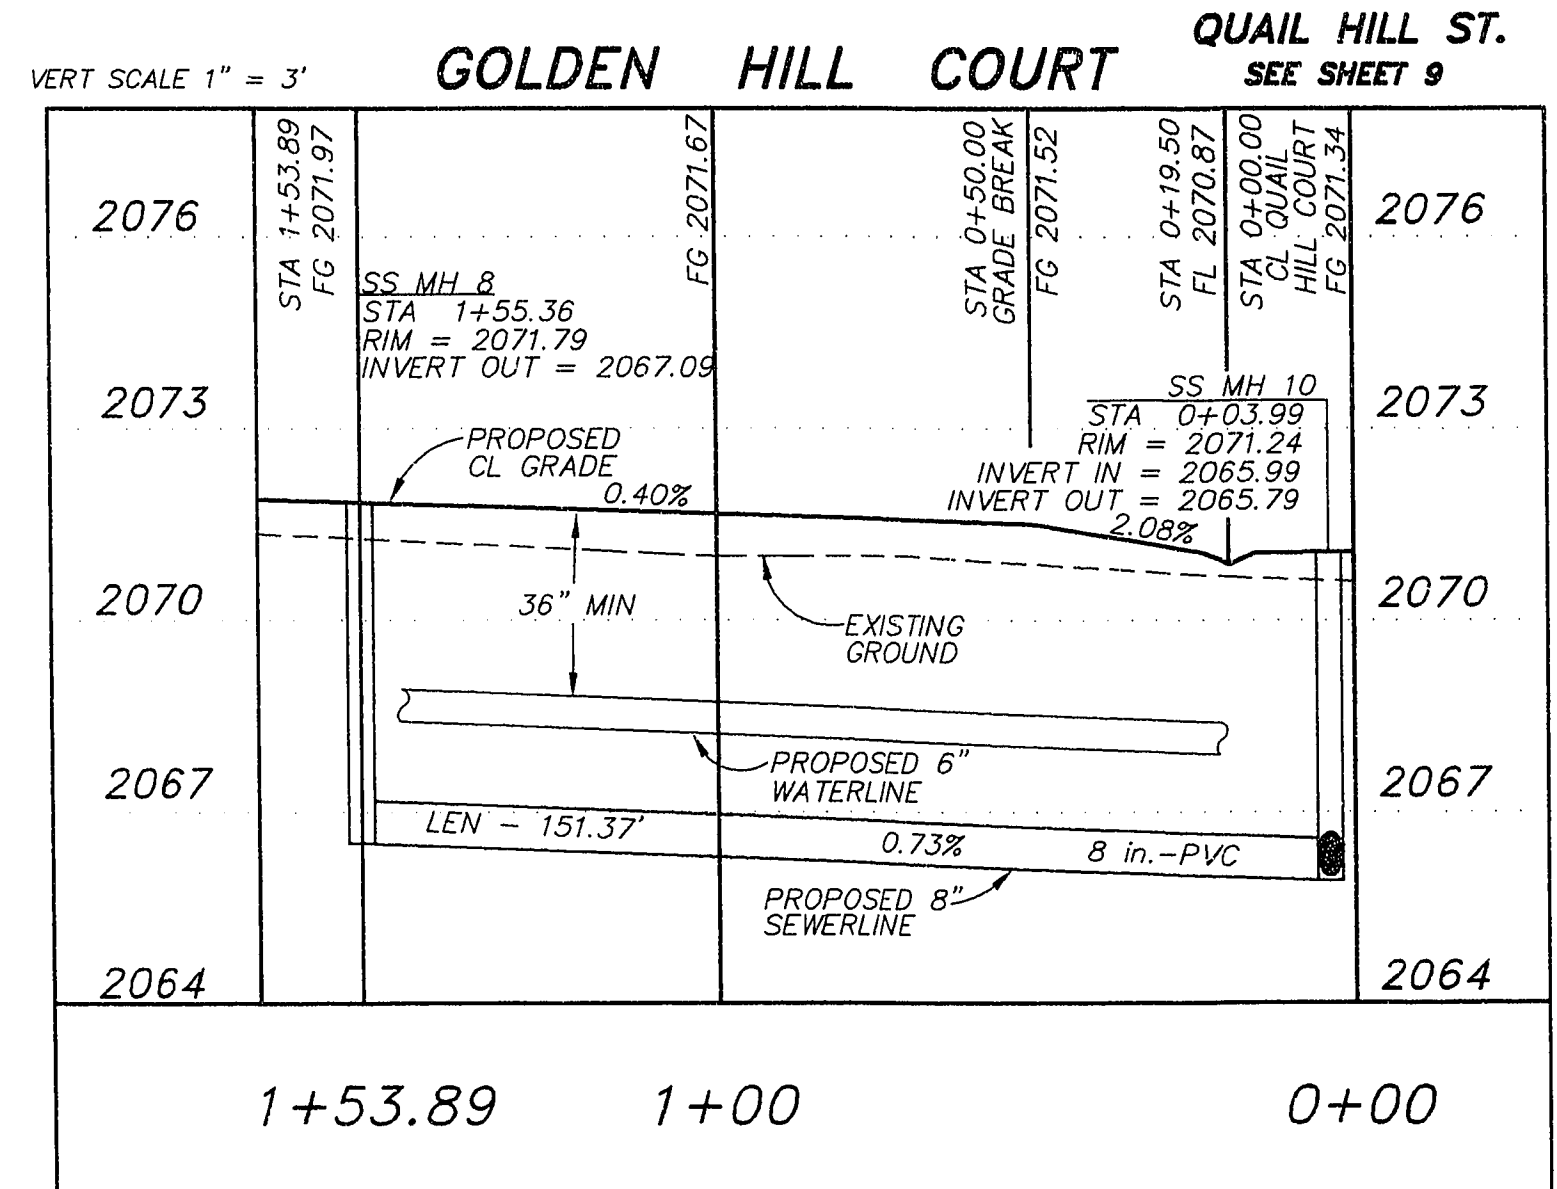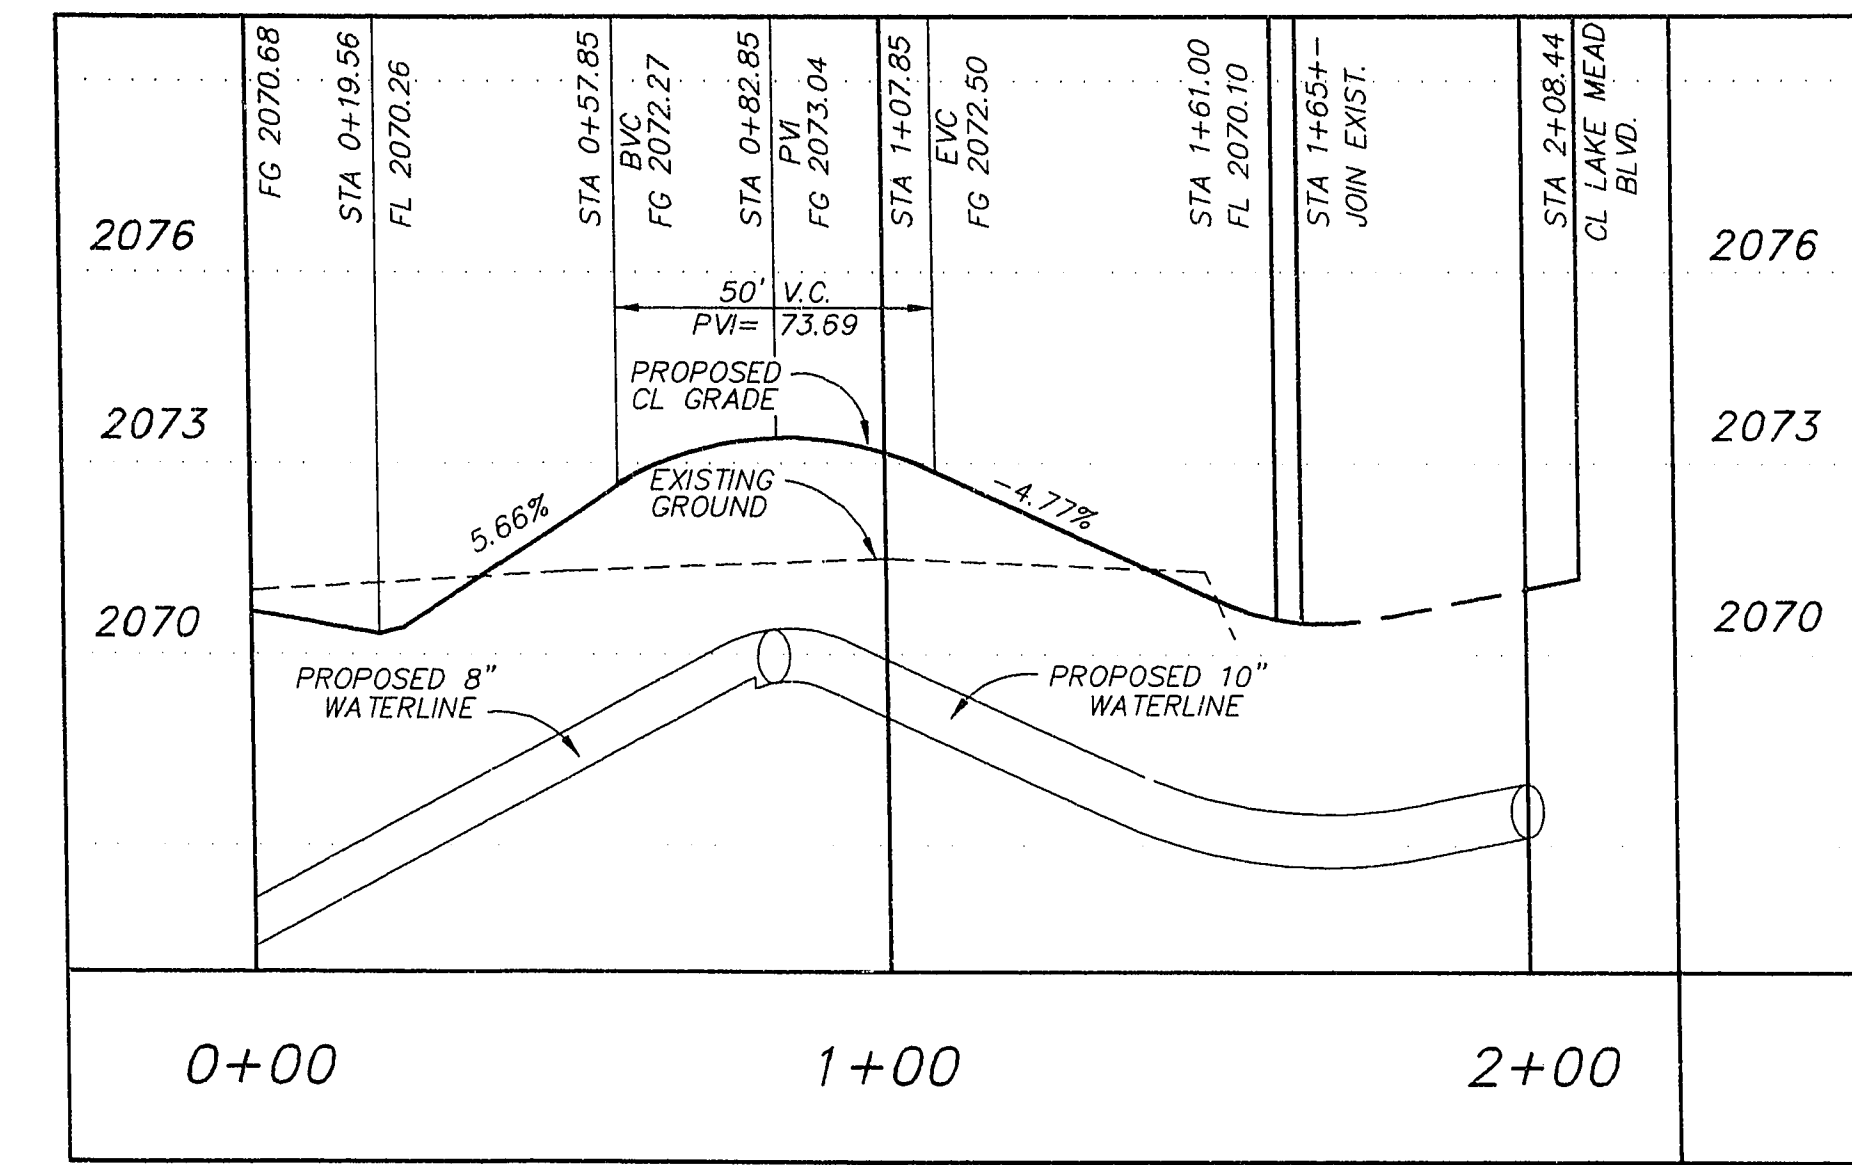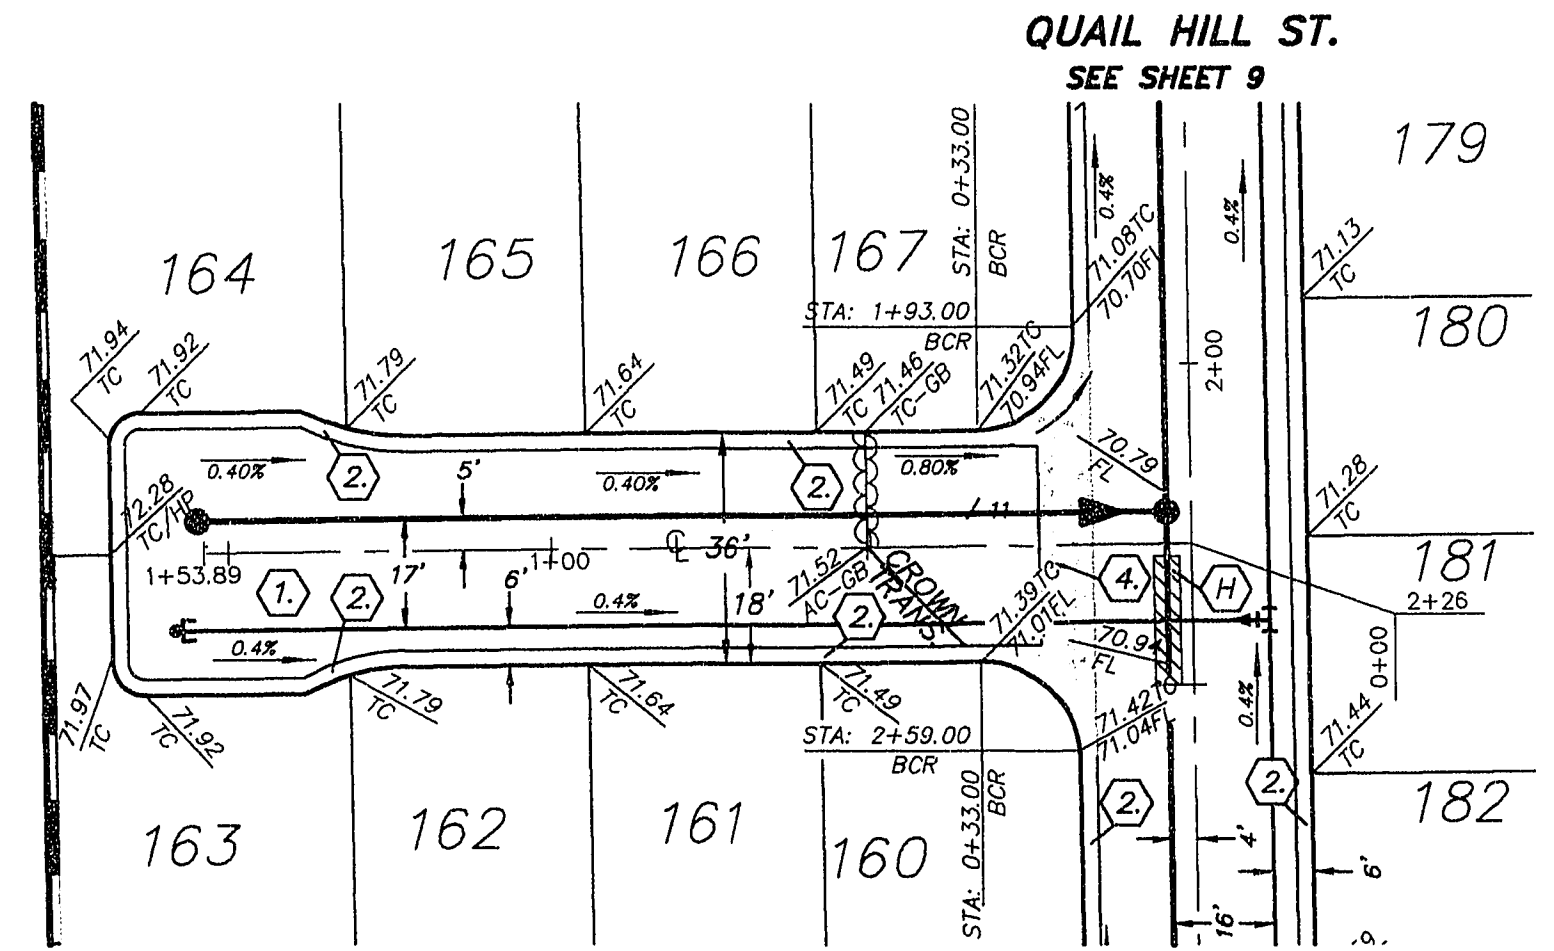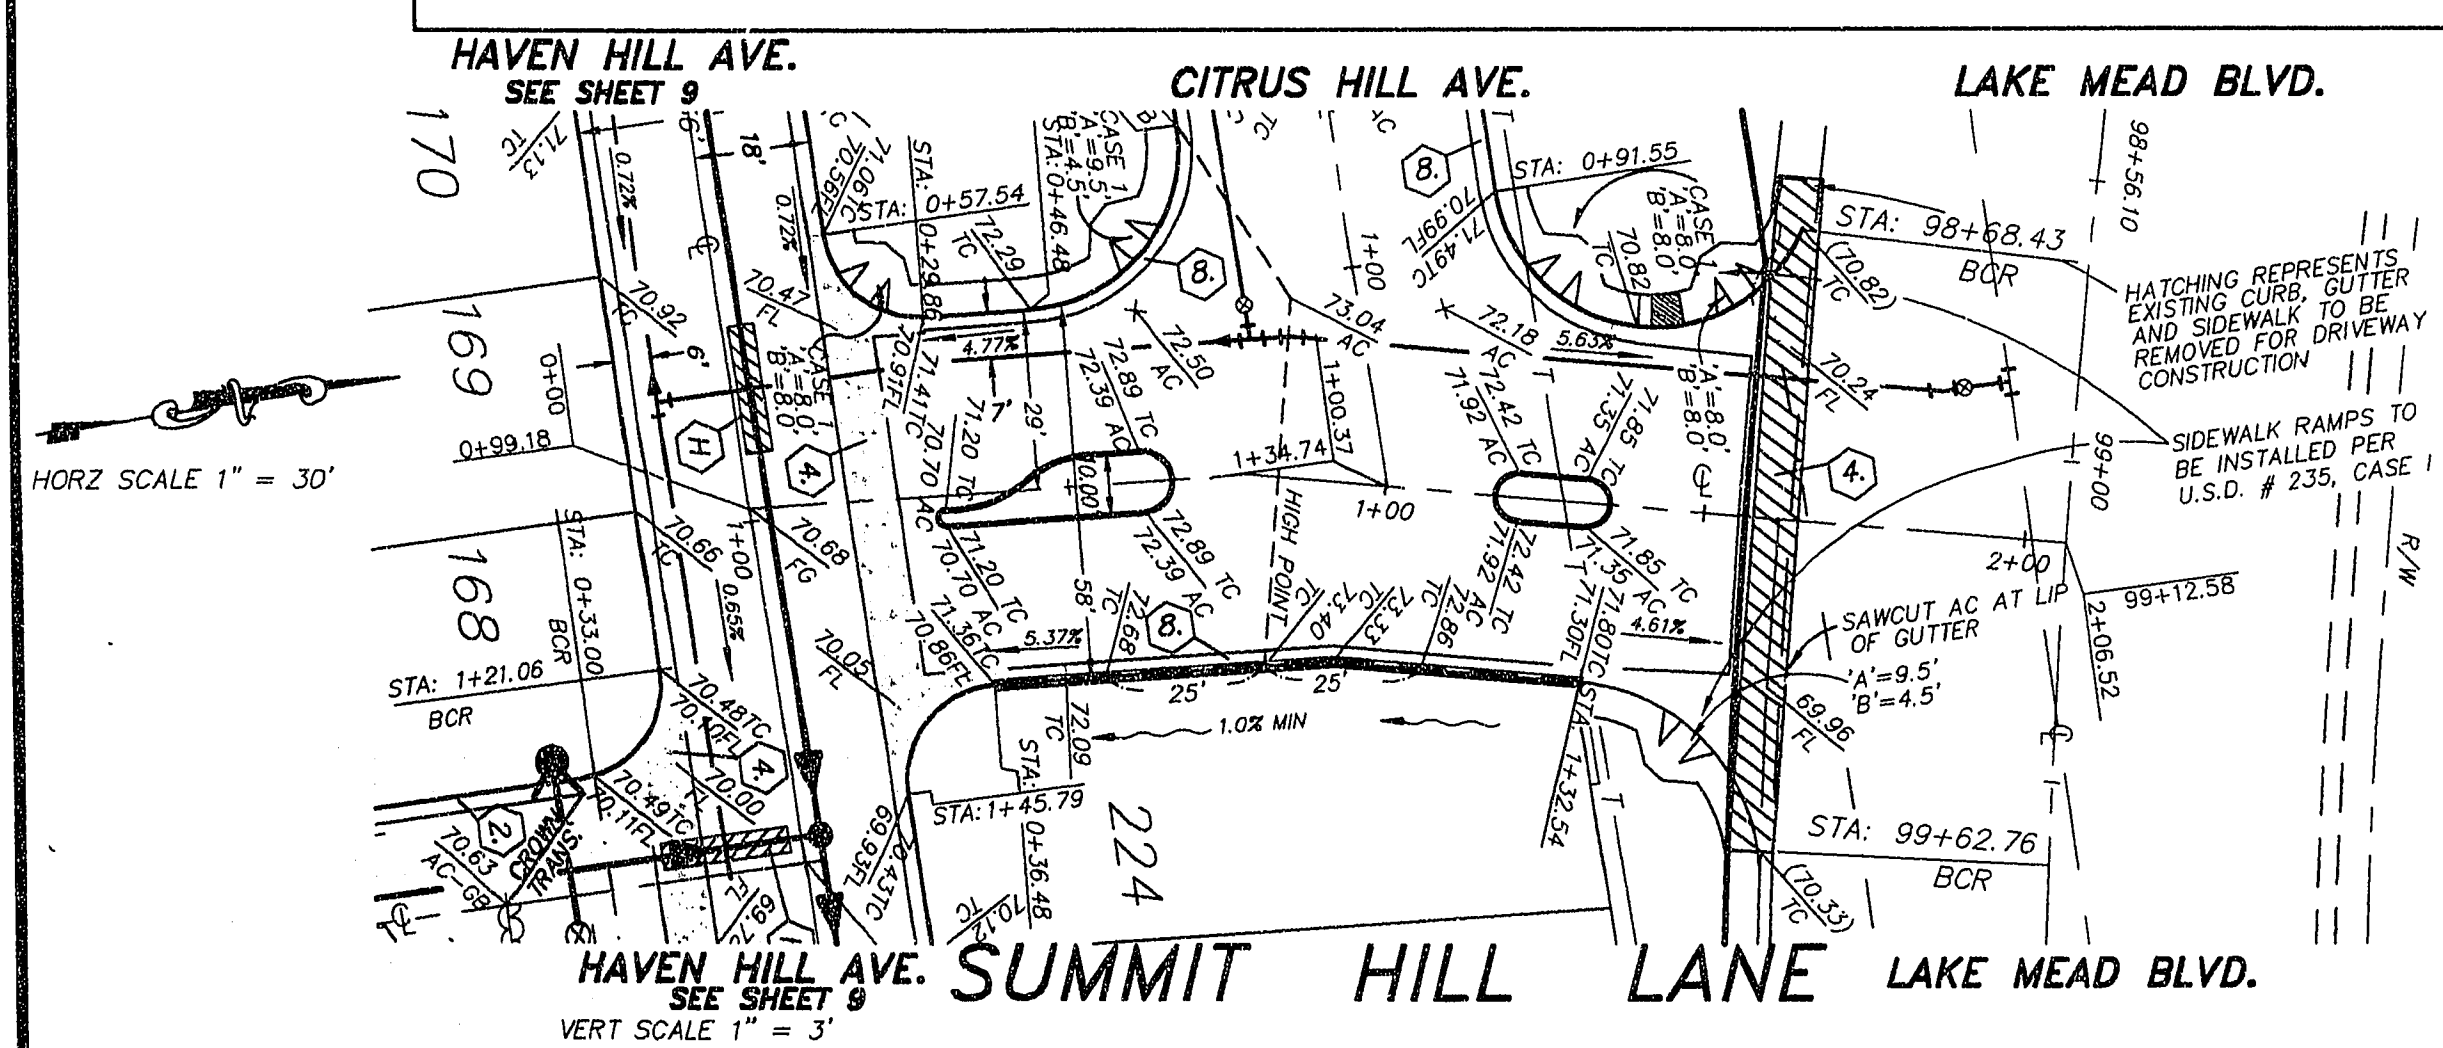


CONSTRUCTION NOTES:

1. CONSTRUCT 2" AC PAVING OVER 4" MINIMUM TYPE II, ON 6" MINIMUM TYPE I BASE OR AS APPROVED AND COORDINATED WITH CLV INSPECTOR.
2. CONSTRUCT 30" ROLL TYPE CURB PER CITY STANDARDS, SEE UNIFORM STANDARD DWG. NO. 217A.
4. CONSTRUCT 8" WIDE CONC. CROSS GUTTER PER UNIFORM STANDARD DRAWING NO. 228.
8. CONSTRUCT 'L' TYPE CURB PER CITY STANDARDS, SEE UNIFORM STANDARD DRAWING NO. 216.
- H. INSTALL SEWER LINE CROSSING. ENCASE SEWER LINE IN CONCRETE 10' EACH SIDE OF WATER LINE PER USD # 505.

Avoid cutting underground utility lines. It's costly
Call before you Dig
1-800-227-2600
UNDERGROUND SERVICE (USA)

BENCHMARK

BM CLV - #46 2LV01-29NES, WEST CURB
TONOPAH DRIVE, 200 +/- VEGAS DRIVE.
ELEV. = 2064.82 FT (NAVD88)

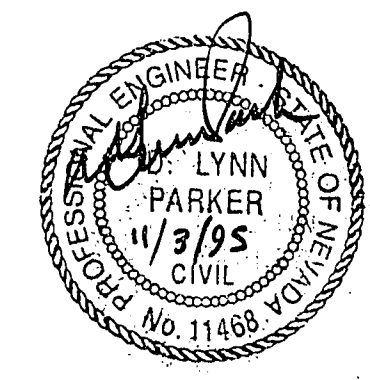

PREPARED BY: **Hunsaker & Associates**
Planning
Surveying
Engineering
Las Vegas, NV 89145
San Diego, CA 92108
San Bernardino, CA 92410
Irvine, CA 92618

SUMMIT HILLS - UNIT 1
LAS VEGAS, NEVADA

STREET & SEWER PLAN & PROFILES

NO. DESCRIPTION BY DATE APPR.
REVISIONS

SCALE(H): 1" = 30'
SCALE(V): 1" = 3'
DES. BY: PAS
DWN. BY: PAS
DATE: 10/94
PROJECT NO. 1512-1
SHEET 8 OF 11

CAD FILE NAME: 1512-SSR
DOCUMENT NO: 2160
SHEET NO: 611-B
PLOT DATE: 02/NOV/95

11-24-93

107Y-4413-1