
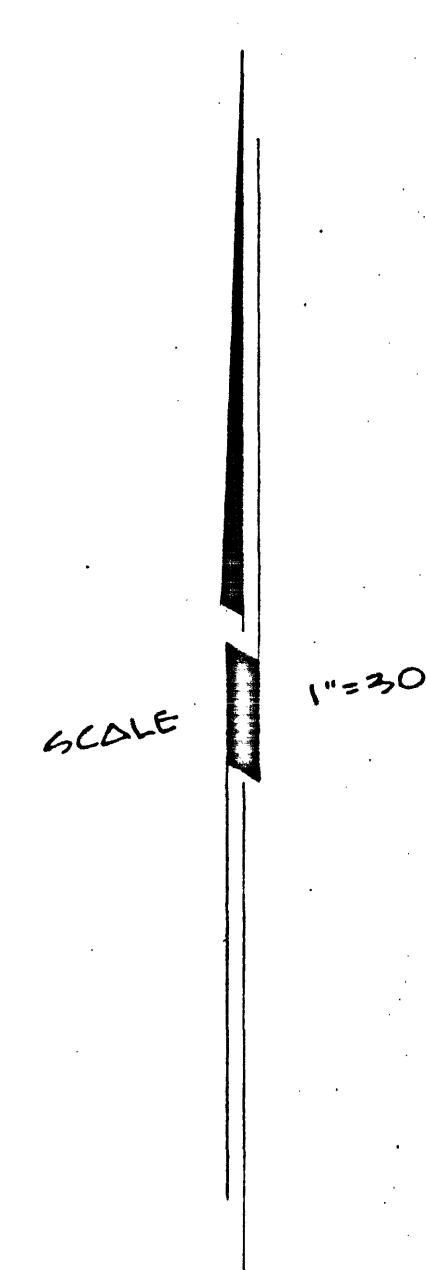


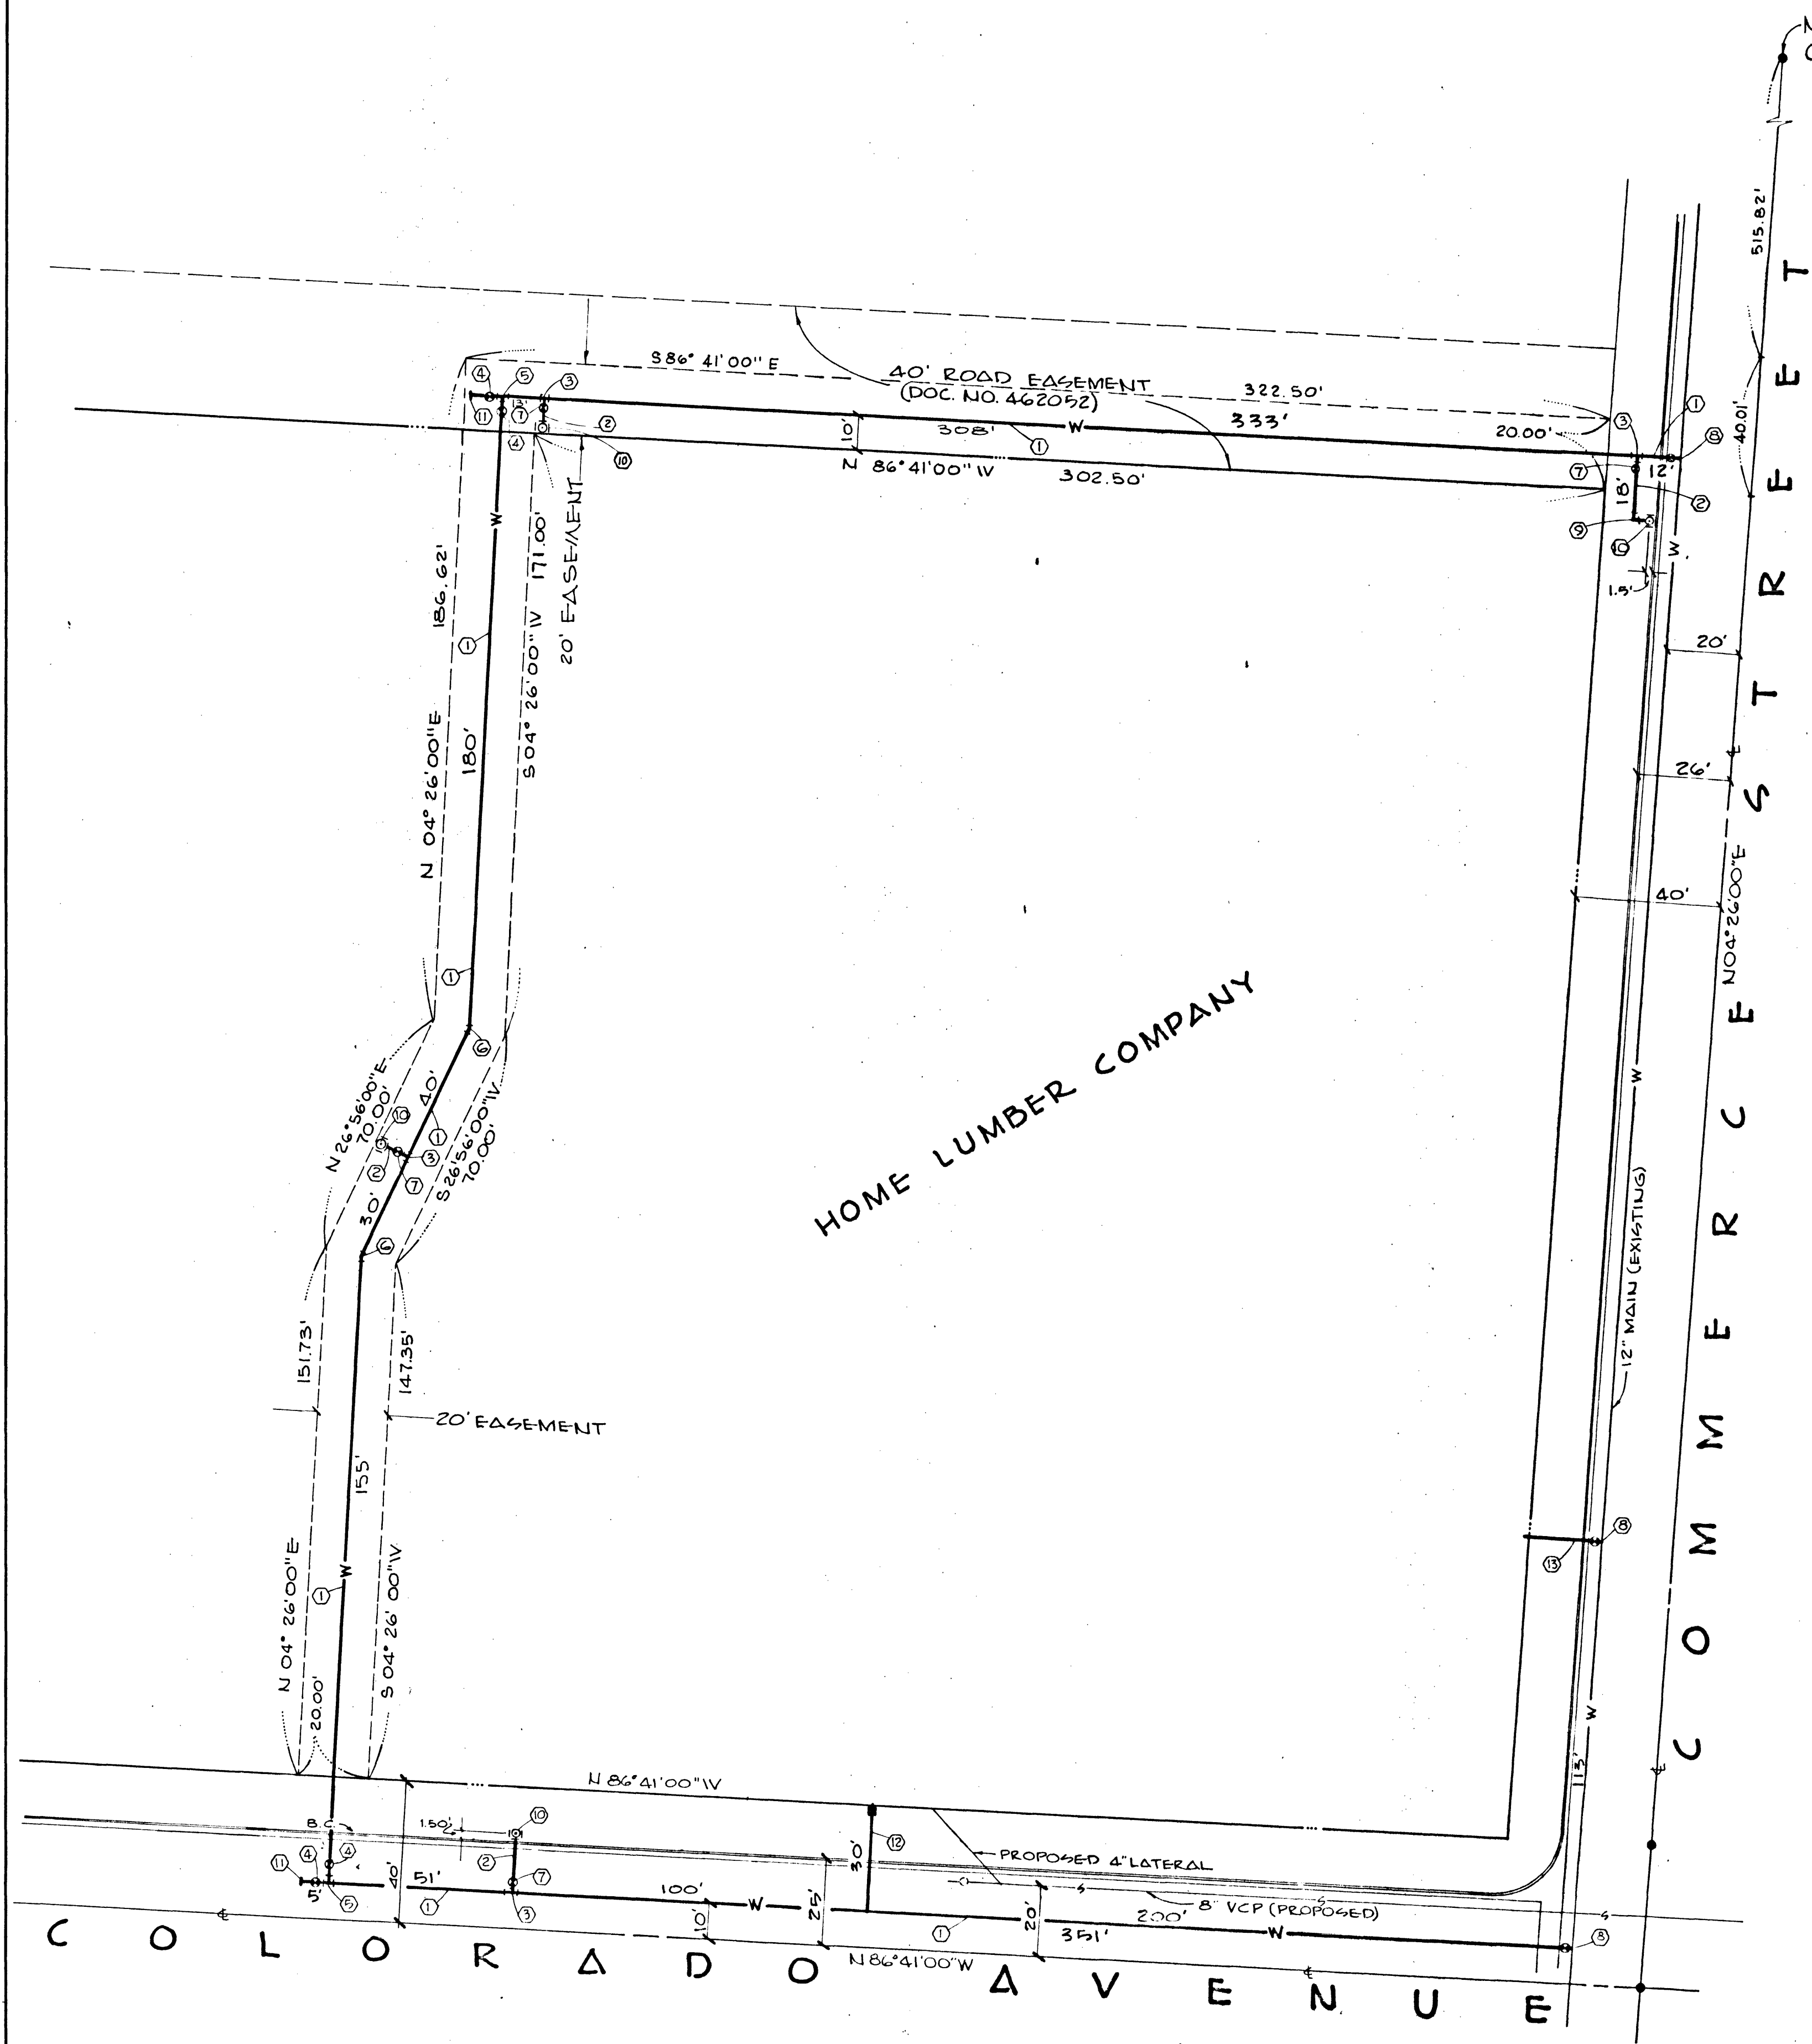

- NOTES:
1. ALL CONSTRUCTION SHALL CONFORM TO THE LAS VEGAS VALLEY WATER DISTRICT STANDARD SPECIFICATIONS FOR DISTRIBUTION MAINS AND SERVICE CONNECTIONS.
 2. PRIOR TO BACKFILL ALL PIPE SHALL BE TESTED UNDER PRESSURE OF 200 PSI.
 3. EVIDENCE OF APPROVED EXCAVATIONS PERMIT MUST BE PRESENTED TO THE LAS VEGAS VALLEY WATER DISTRICT 48 HOURS PRIOR TO ACTUAL CONSTRUCTION.
 4. FIRE PROTECTION RATE = 6500 GPM

ESTIMATED QUANTITIES	
① 10" ACP	1090 LIN. FT.
② 6" ACP	50 LIN. FT.
③ 10" x 10" x 6" C.I. TEE	4 EA.
④ 10" NRS GATE VALVE W/ VALVE BOX	4 EA.
⑤ 10" x 10" x 10" C.I. TEE	2 EA.
⑥ 10" 22 1/2° ELBOW	2 EA.
⑦ 6" NRS GATE VALVE W/ VALVE BOX	4 EA.
⑧ 12" x 10" TAPPING SLEEVE & VALVE	3 EA.
⑨ 6" 90° ELBOW	1 EA.
⑩ FIRE HYDRANT	4 EA.
⑪ C.I. CAP & THRUST BLOCK	2 EA.
⑫ 1" COPPER LINE	30 LIN. FT.
⑬ 8" ACP	20 LIN. FT.


10" WATER MAIN
THE HOME LUMBER COMPANY

LEAVITT & ASSOCIATES
CIVIL ENGINEERS • MINING ENGINEERS • LAUD SURVEYORS
536 EAST SARAZA AVENUE
LAS VEGAS, NEVADA 89105
702 735-0230

APPROVALS

CITY FIRE CHIEF
CITY ENGINEER
LAS VEGAS VALLEY WATER DISTRICT

REVISIONS



1. **1. The following are the main types of the following:**
2. **2. The following are the main types of the following:**
3. **3. The following are the main types of the following:**
4. **4. The following are the main types of the following:**

B-1 WATER MANAGEMENT	
1. WATER	100%
2. WATER	100%
3. WATER	100%
4. WATER	100%
5. WATER	100%
6. WATER	100%
7. WATER	100%
8. WATER	100%
9. WATER	100%
10. WATER	100%
11. WATER	100%
12. WATER	100%
13. WATER	100%
14. WATER	100%
15. WATER	100%
16. WATER	100%
17. WATER	100%
18. WATER	100%
19. WATER	100%
20. WATER	100%
21. WATER	100%
22. WATER	100%
23. WATER	100%
24. WATER	100%
25. WATER	100%
26. WATER	100%
27. WATER	100%
28. WATER	100%
29. WATER	100%
30. WATER	100%
31. WATER	100%
32. WATER	100%
33. WATER	100%
34. WATER	100%
35. WATER	100%
36. WATER	100%
37. WATER	100%
38. WATER	100%
39. WATER	100%
40. WATER	100%
41. WATER	100%
42. WATER	100%
43. WATER	100%
44. WATER	100%
45. WATER	100%
46. WATER	100%
47. WATER	100%
48. WATER	100%
49. WATER	100%
50. WATER	100%
51. WATER	100%
52. WATER	100%
53. WATER	100%
54. WATER	100%
55. WATER	100%
56. WATER	100%
57. WATER	100%
58. WATER	100%
59. WATER	100%
60. WATER	100%
61. WATER	100%
62. WATER	100%
63. WATER	100%
64. WATER	100%
65. WATER	100%
66. WATER	100%
67. WATER	100%
68. WATER	100%
69. WATER	100%
70. WATER	100%
71. WATER	100%
72. WATER	100%
73. WATER	100%
74. WATER	100%
75. WATER	100%
76. WATER	100%
77. WATER	100%
78. WATER	100%
79. WATER	100%
80. WATER	100%
81. WATER	100%
82. WATER	100%
83. WATER	100%
84. WATER	100%
85. WATER	100%
86. WATER	100%
87. WATER	100%
88. WATER	100%
89. WATER	100%
90. WATER	100%
91. WATER	100%
92. WATER	100%
93. WATER	100%
94. WATER	100%
95. WATER	100%
96. WATER	100%
97. WATER	100%
98. WATER	100%
99. WATER	100%
100. WATER	100%

(C) WATSON, MARY EVER, MARY, Lillian, & Cora 1000 10th St. N. W.	LEADERSHIP IN ACTION 1000 10th St. N. W.	APPROVAL 1000 10th St. N. W.	1000 10th St. N. W.
--	---	---------------------------------	---------------------