


WATER MAIN LAYOUT TWIN LAKES VILLAGE UNITS 3

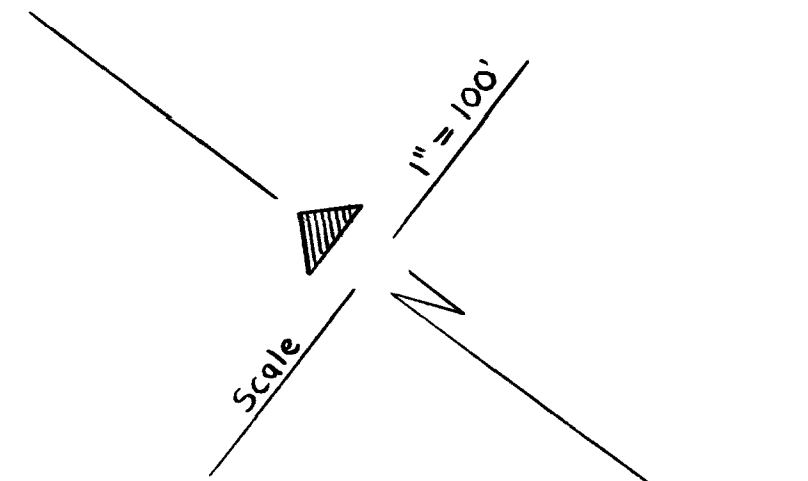


Approved By: *E. C. Jeter* 3/19/84
Fire Chief

Approved By: *John R. Webb*
Act. Director of Public Works

Note:

± of Fire Hydrant shall be located
18 inches from back of curb.

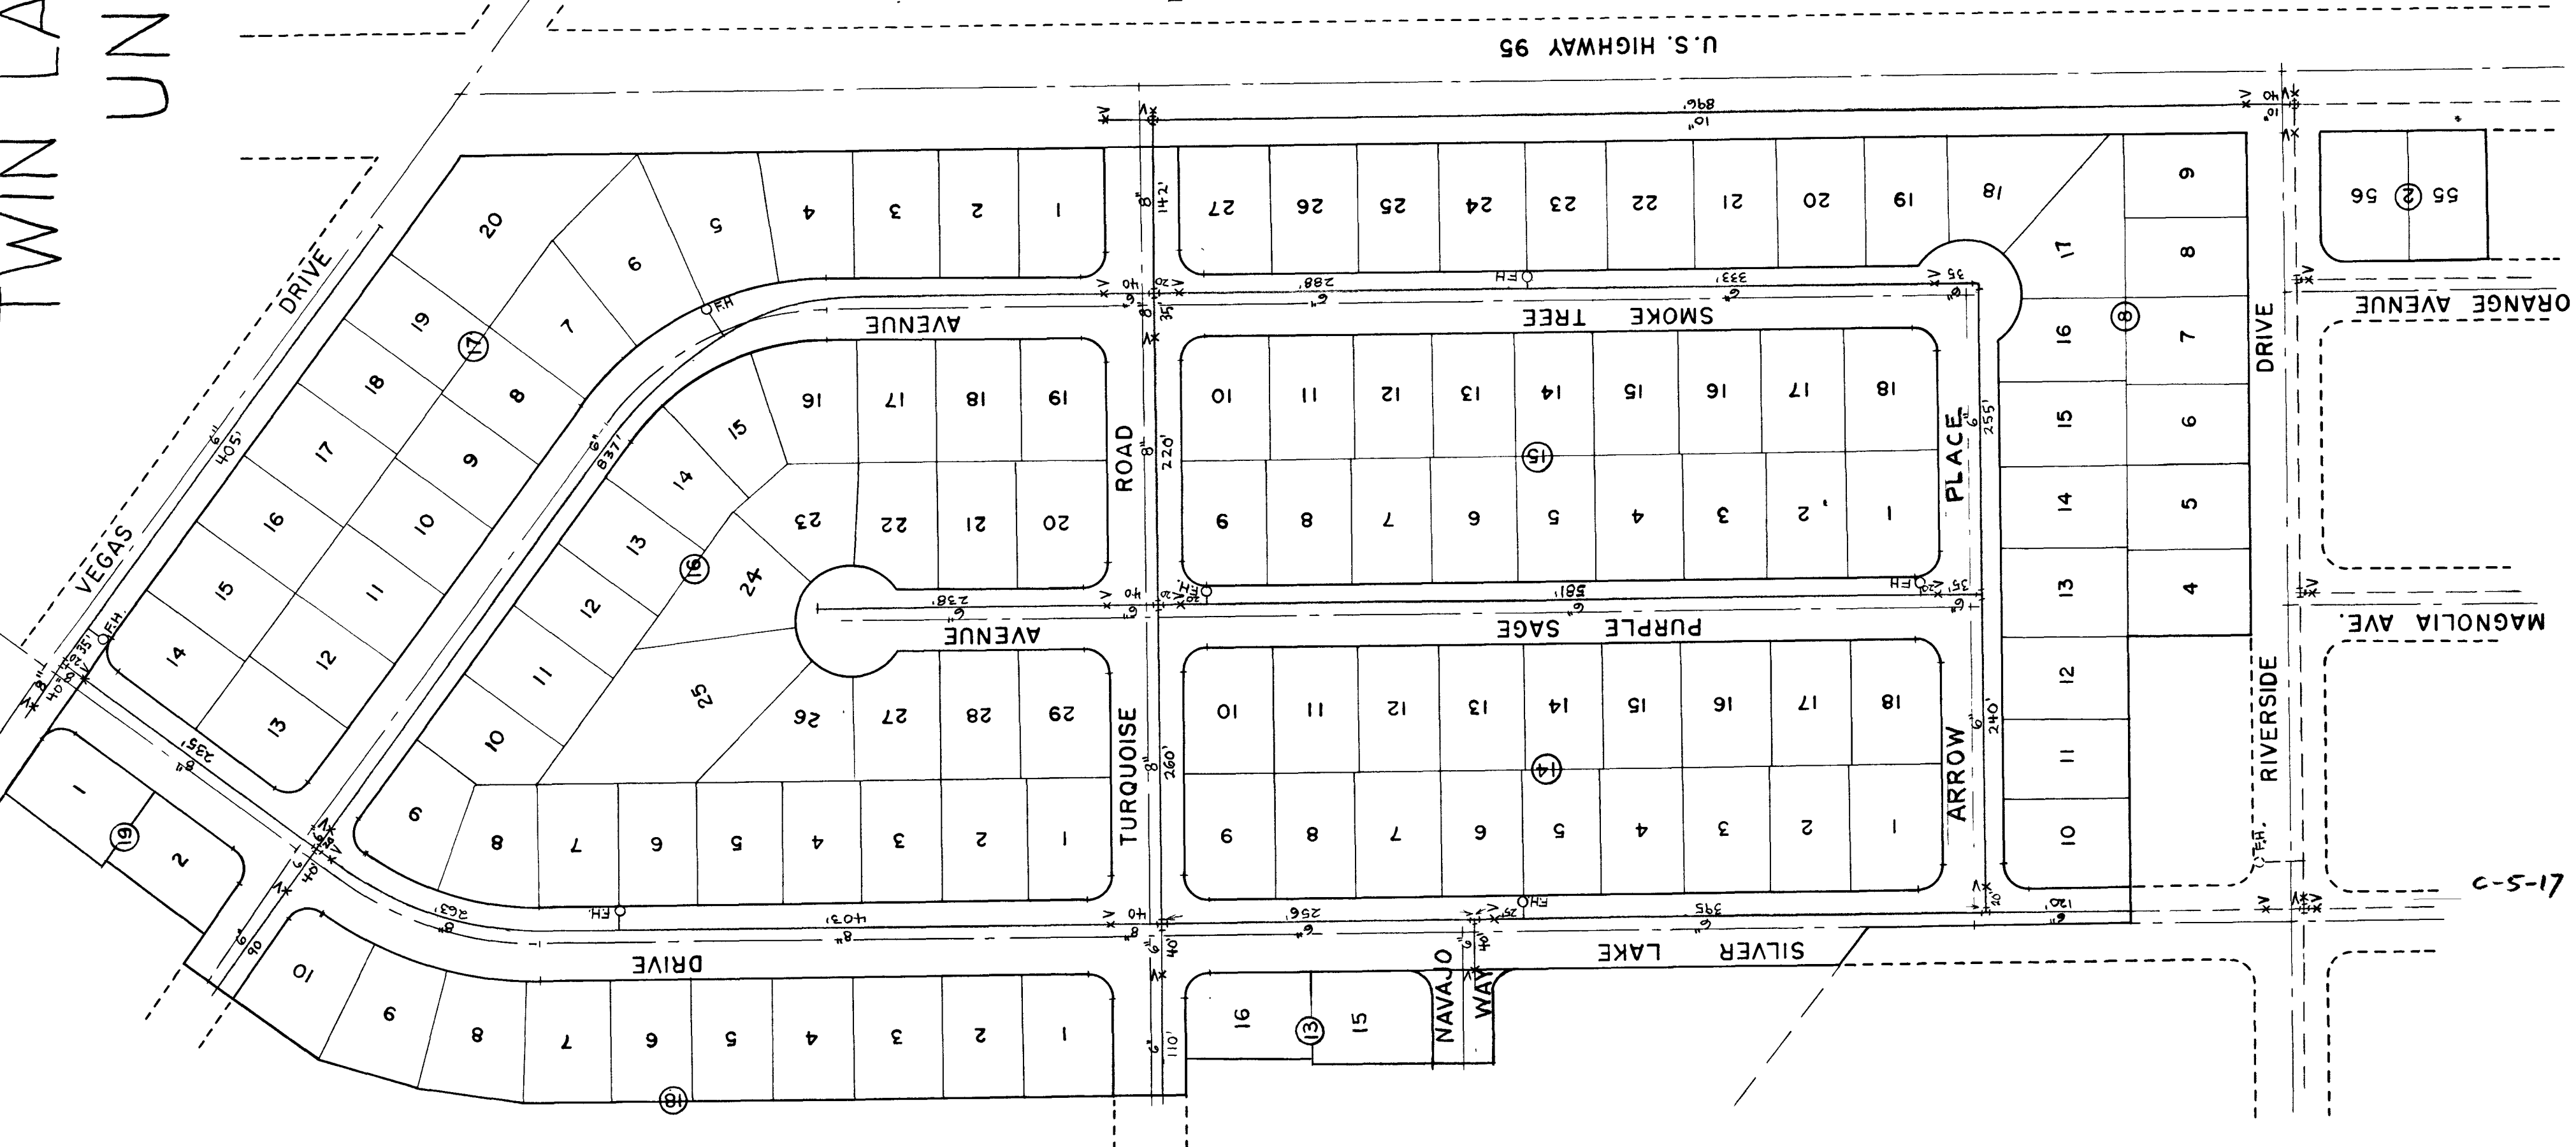

845


26-647

5674-3120-3
509.2-984-1

1-5-17

16-12-17

WATER MAIN LAYOUT TWIN LAKES VILLAGE UNITS 3

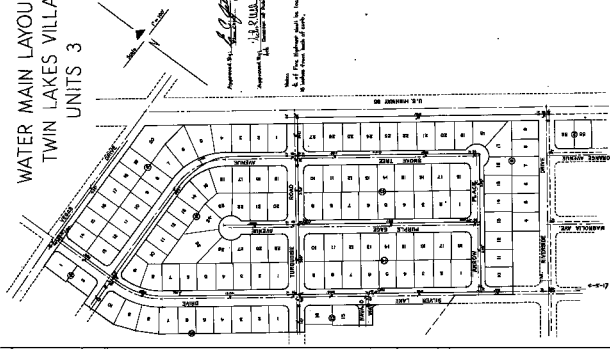

Approved by: *[Signature]*
Date: *10/10/84*

Approved by: *[Signature]*
Date: *10/10/84*
Director of Public Works

Note:
If all Fire Hydrants shall be located
at least 100 feet from lots of water.