



APPROVALS:

J. D. Dierker
Las Vegas City Engineer
2-19-74
Date

J. D. Dierker
Las Vegas Field Engineer
2-4-74
Date


Sam C. ...
Las Vegas Fire Department
1-24-74
Date

M. ...
Las Vegas Valley Water District
5/17/74
Date

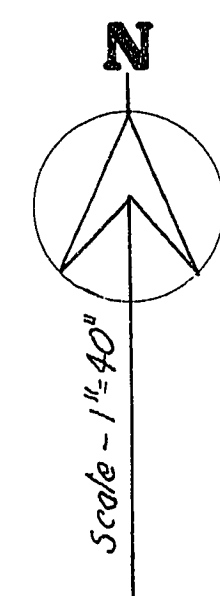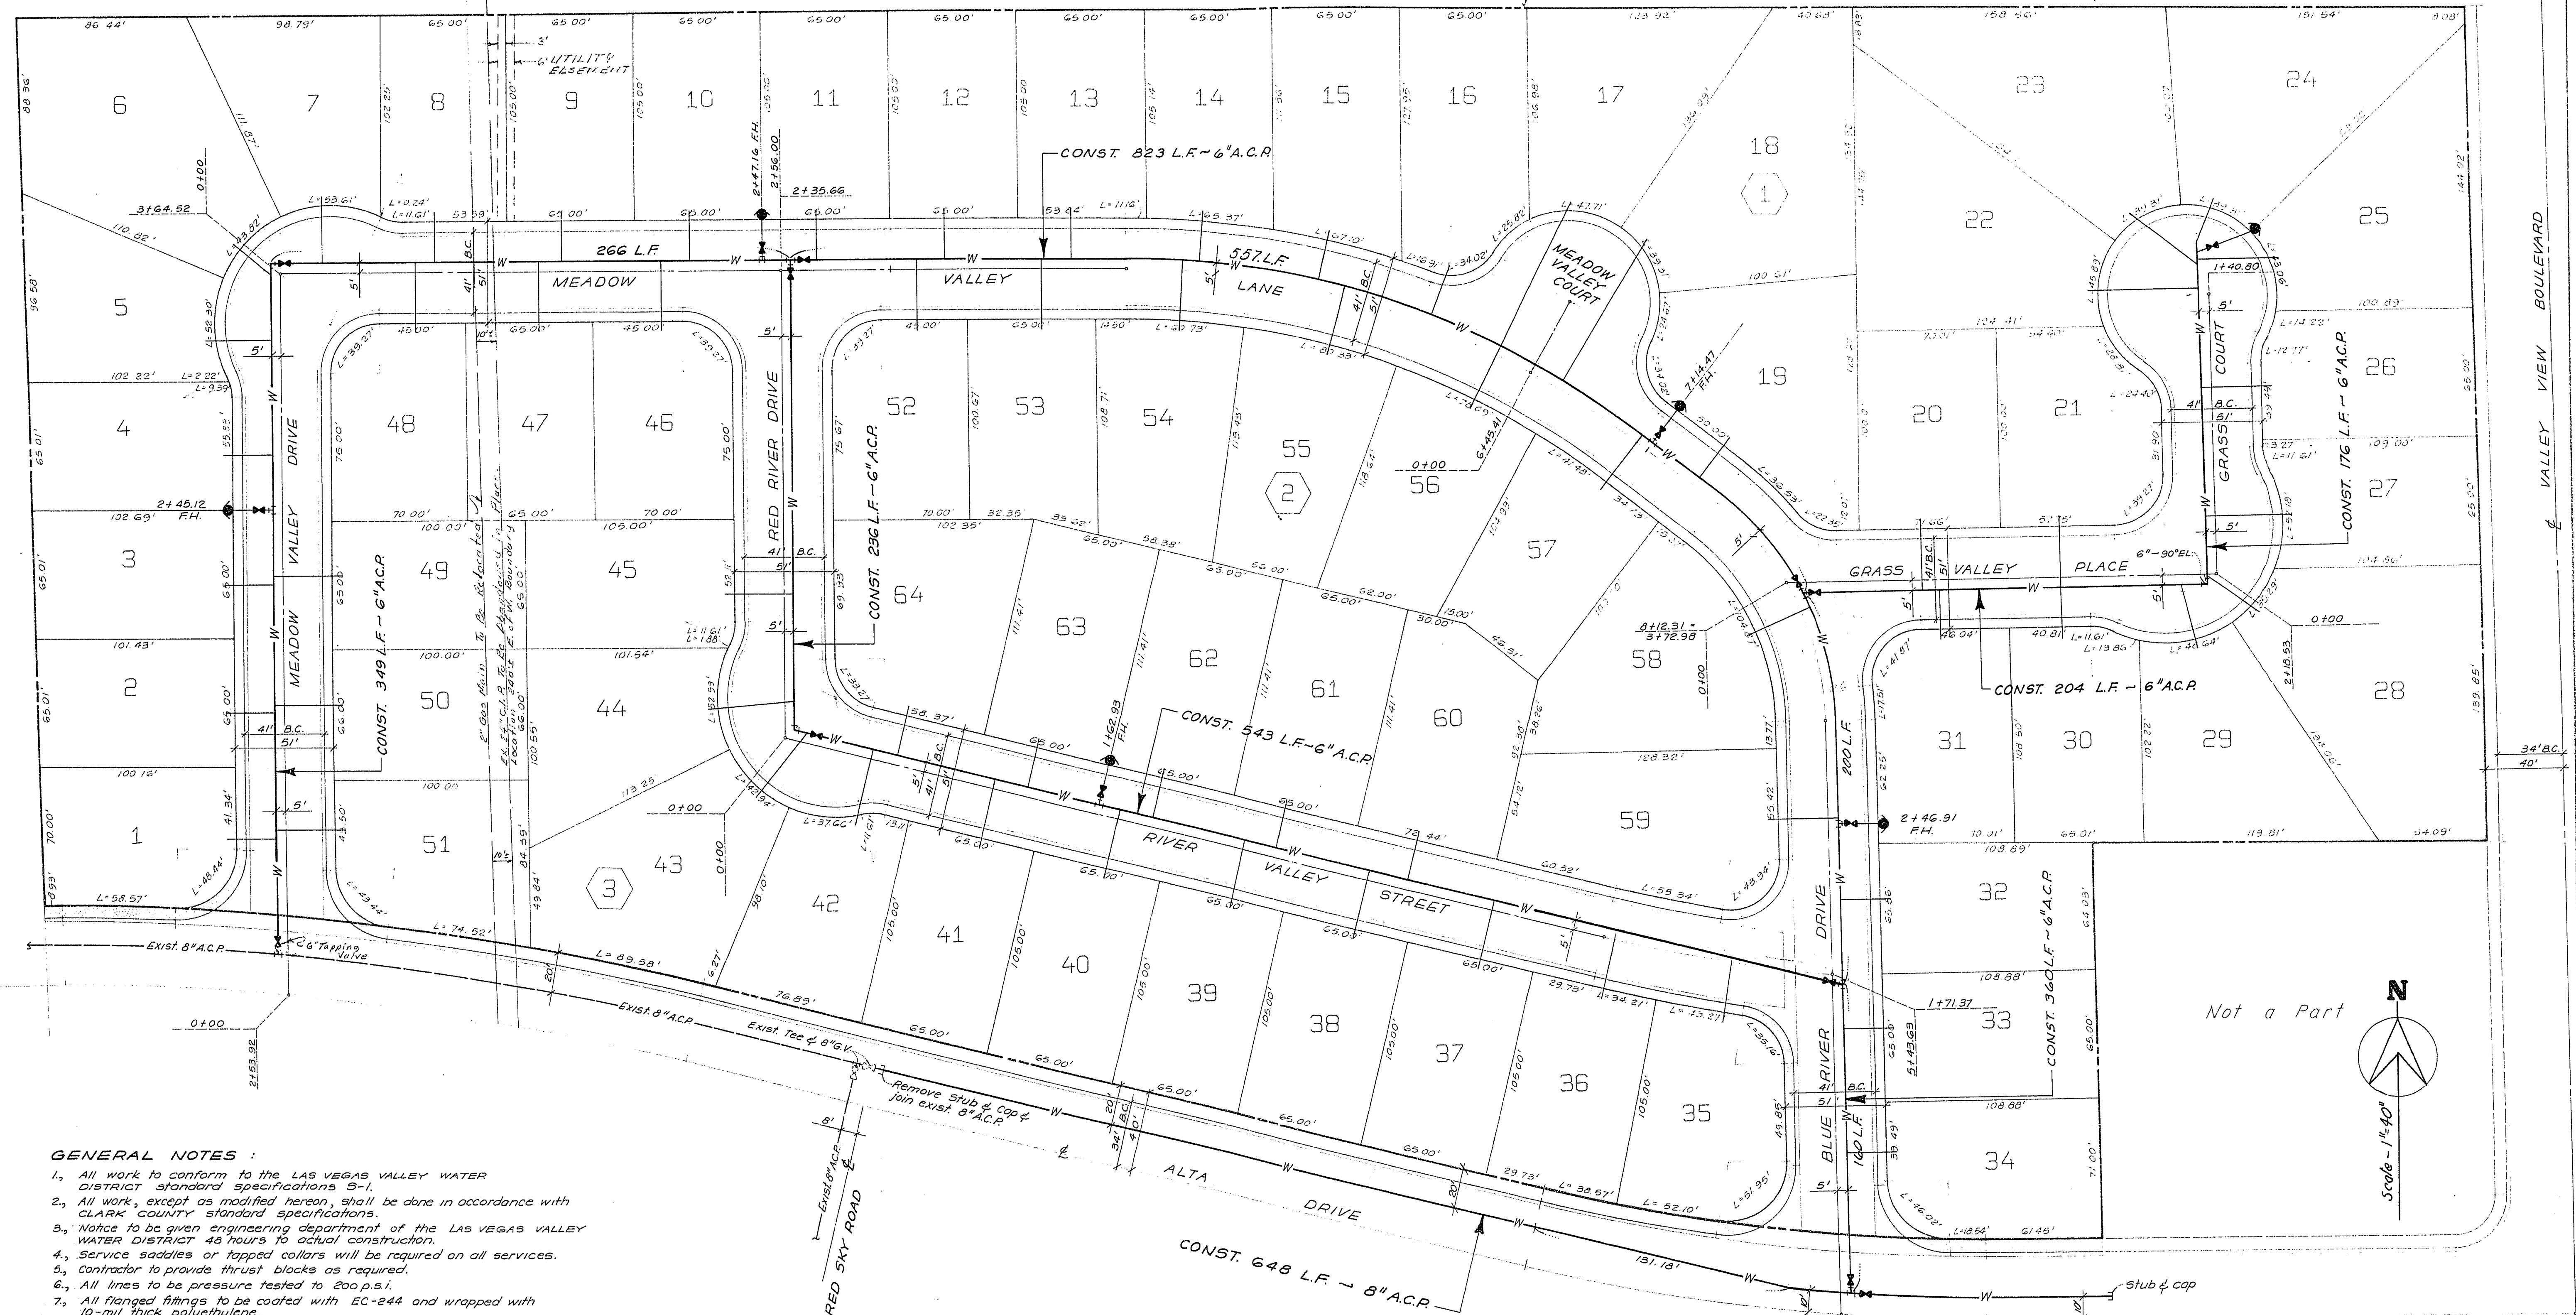

GENERAL NOTES:


- All work to conform to the LAS VEGAS VALLEY WATER DISTRICT standard specifications 8-1.
- All work, except as modified herein, shall be done in accordance with CLARK COUNTY standard specifications.
- Notice to be given engineering department of the LAS VEGAS VALLEY WATER DISTRICT 48 hours to actual construction.
- Service saddles or tapped collars will be required on all services.
- Contractor to provide thrust blocks as required.
- All lines to be pressure tested to 200 p.s.i.
- All flanged fittings to be coated with EC-244 and wrapped with 10-mil thick polyethylene.
- Parallel sewer and water lines shall have a minimum of 10' horizontal separation and 3' minimum vertical separation on all water lines.
- Deflection angle shall not exceed 5° per 13 foot section of pipe for pipe size smaller than 10\".
- All valve boxes shall have concrete collars at surface of paved areas.
- No other utility lines may be placed in same trench with water lines.
- Contractor shall verify locations of existing water lines prior to construction.
- Existing utilities shown are located by the best information available to the engineer at the time these plans were prepared.
- The contractor shall contact the appropriate utility company, 48 hours prior to construction.
- No fire hydrant shall be located within 6' of any driveway, power pole, light standard or any other obstruction.

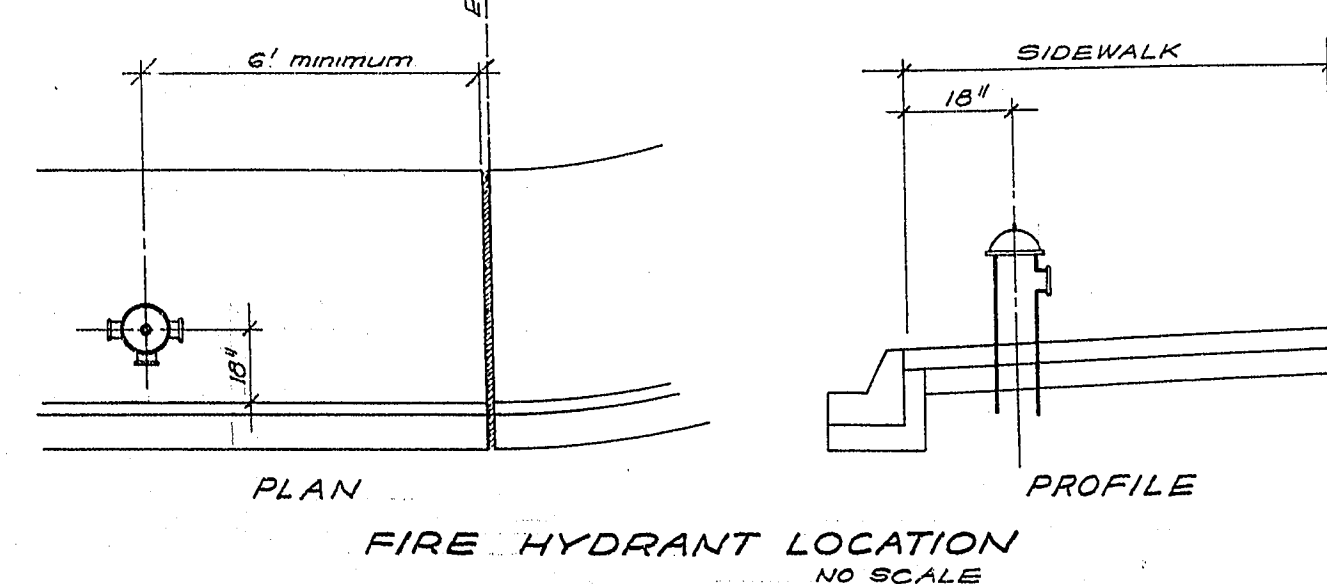

Estimated Quantities

ITEM	QUANTITY
6\"x6\"x8\" TEE	1 each
6\"x6\"x6\" TEE	9 each
6\"x6\" 90° ELBOW	3 each
FIRE HYDRANT	6 each
GATE VALVE	15 each
6\"ASBESTOS CEMENT PIPE	2,691 L.F.
8\"ASBESTOS CEMENT PIPE	648 L.F.
3/4\" COPPER SERVICE	256 each
8\" GATE VALVE	2 each

Name of Plan: Valley West Unit 2 p. 18
Water plan as shown will be acceptable. It is NOT approved for construction.
M. ...
2/15/74
Date

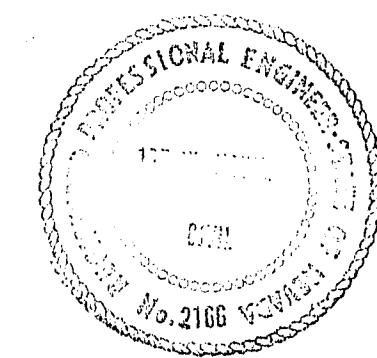

NO.	REVISIONS	DATE

WATER PLAN
VALLEY WEST, UNIT NO. 2
LAS VEGAS, NEVADA

CONSULTING ENGINEERS/PLANNERS
SPARKS, NEVADA - SEATTLE, WASHINGTON - LAS VEGAS, NEVADA


JOB NO. 273076
DESIGNED
DRAWN
COMP.
CHECKED <i>SL</i>
DATE NOV. 5, 73
SHEET NO. 18
OF 19 SHEETS

567 4-3170-2-24 XC 11A-2

APPROVAL

[Signature]
 2-2-74
 1-2-74

10
 1-2-74
 1-2-74
 1-2-74

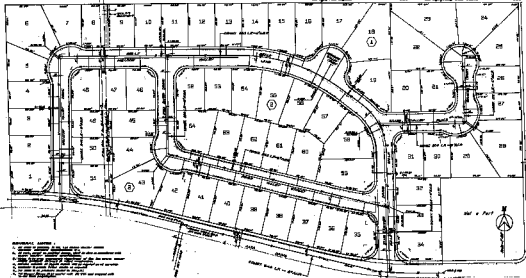

- REMARKS:**
1. The water plan is based on the survey of the area and the existing water courses.
 2. The water plan is based on the survey of the area and the existing water courses.
 3. The water plan is based on the survey of the area and the existing water courses.
 4. The water plan is based on the survey of the area and the existing water courses.
 5. The water plan is based on the survey of the area and the existing water courses.
 6. The water plan is based on the survey of the area and the existing water courses.
 7. The water plan is based on the survey of the area and the existing water courses.
 8. The water plan is based on the survey of the area and the existing water courses.
 9. The water plan is based on the survey of the area and the existing water courses.
 10. The water plan is based on the survey of the area and the existing water courses.



Estimated Quantities

Excavation	1000
Backfill	1000
Gravel	1000
Concrete	1000
Steel	1000
Other	1000

See of Building 1000, 1000, 1000
 1000, 1000, 1000, 1000



WATER PLAN
 VALLEY WEST, UNIT NO. 2
 1000, 1000, 1000, 1000

1000	1000
1000	1000
1000	1000
1000	1000
1000	1000

1000, 1000, 1000, 1000
 1000, 1000, 1000, 1000