

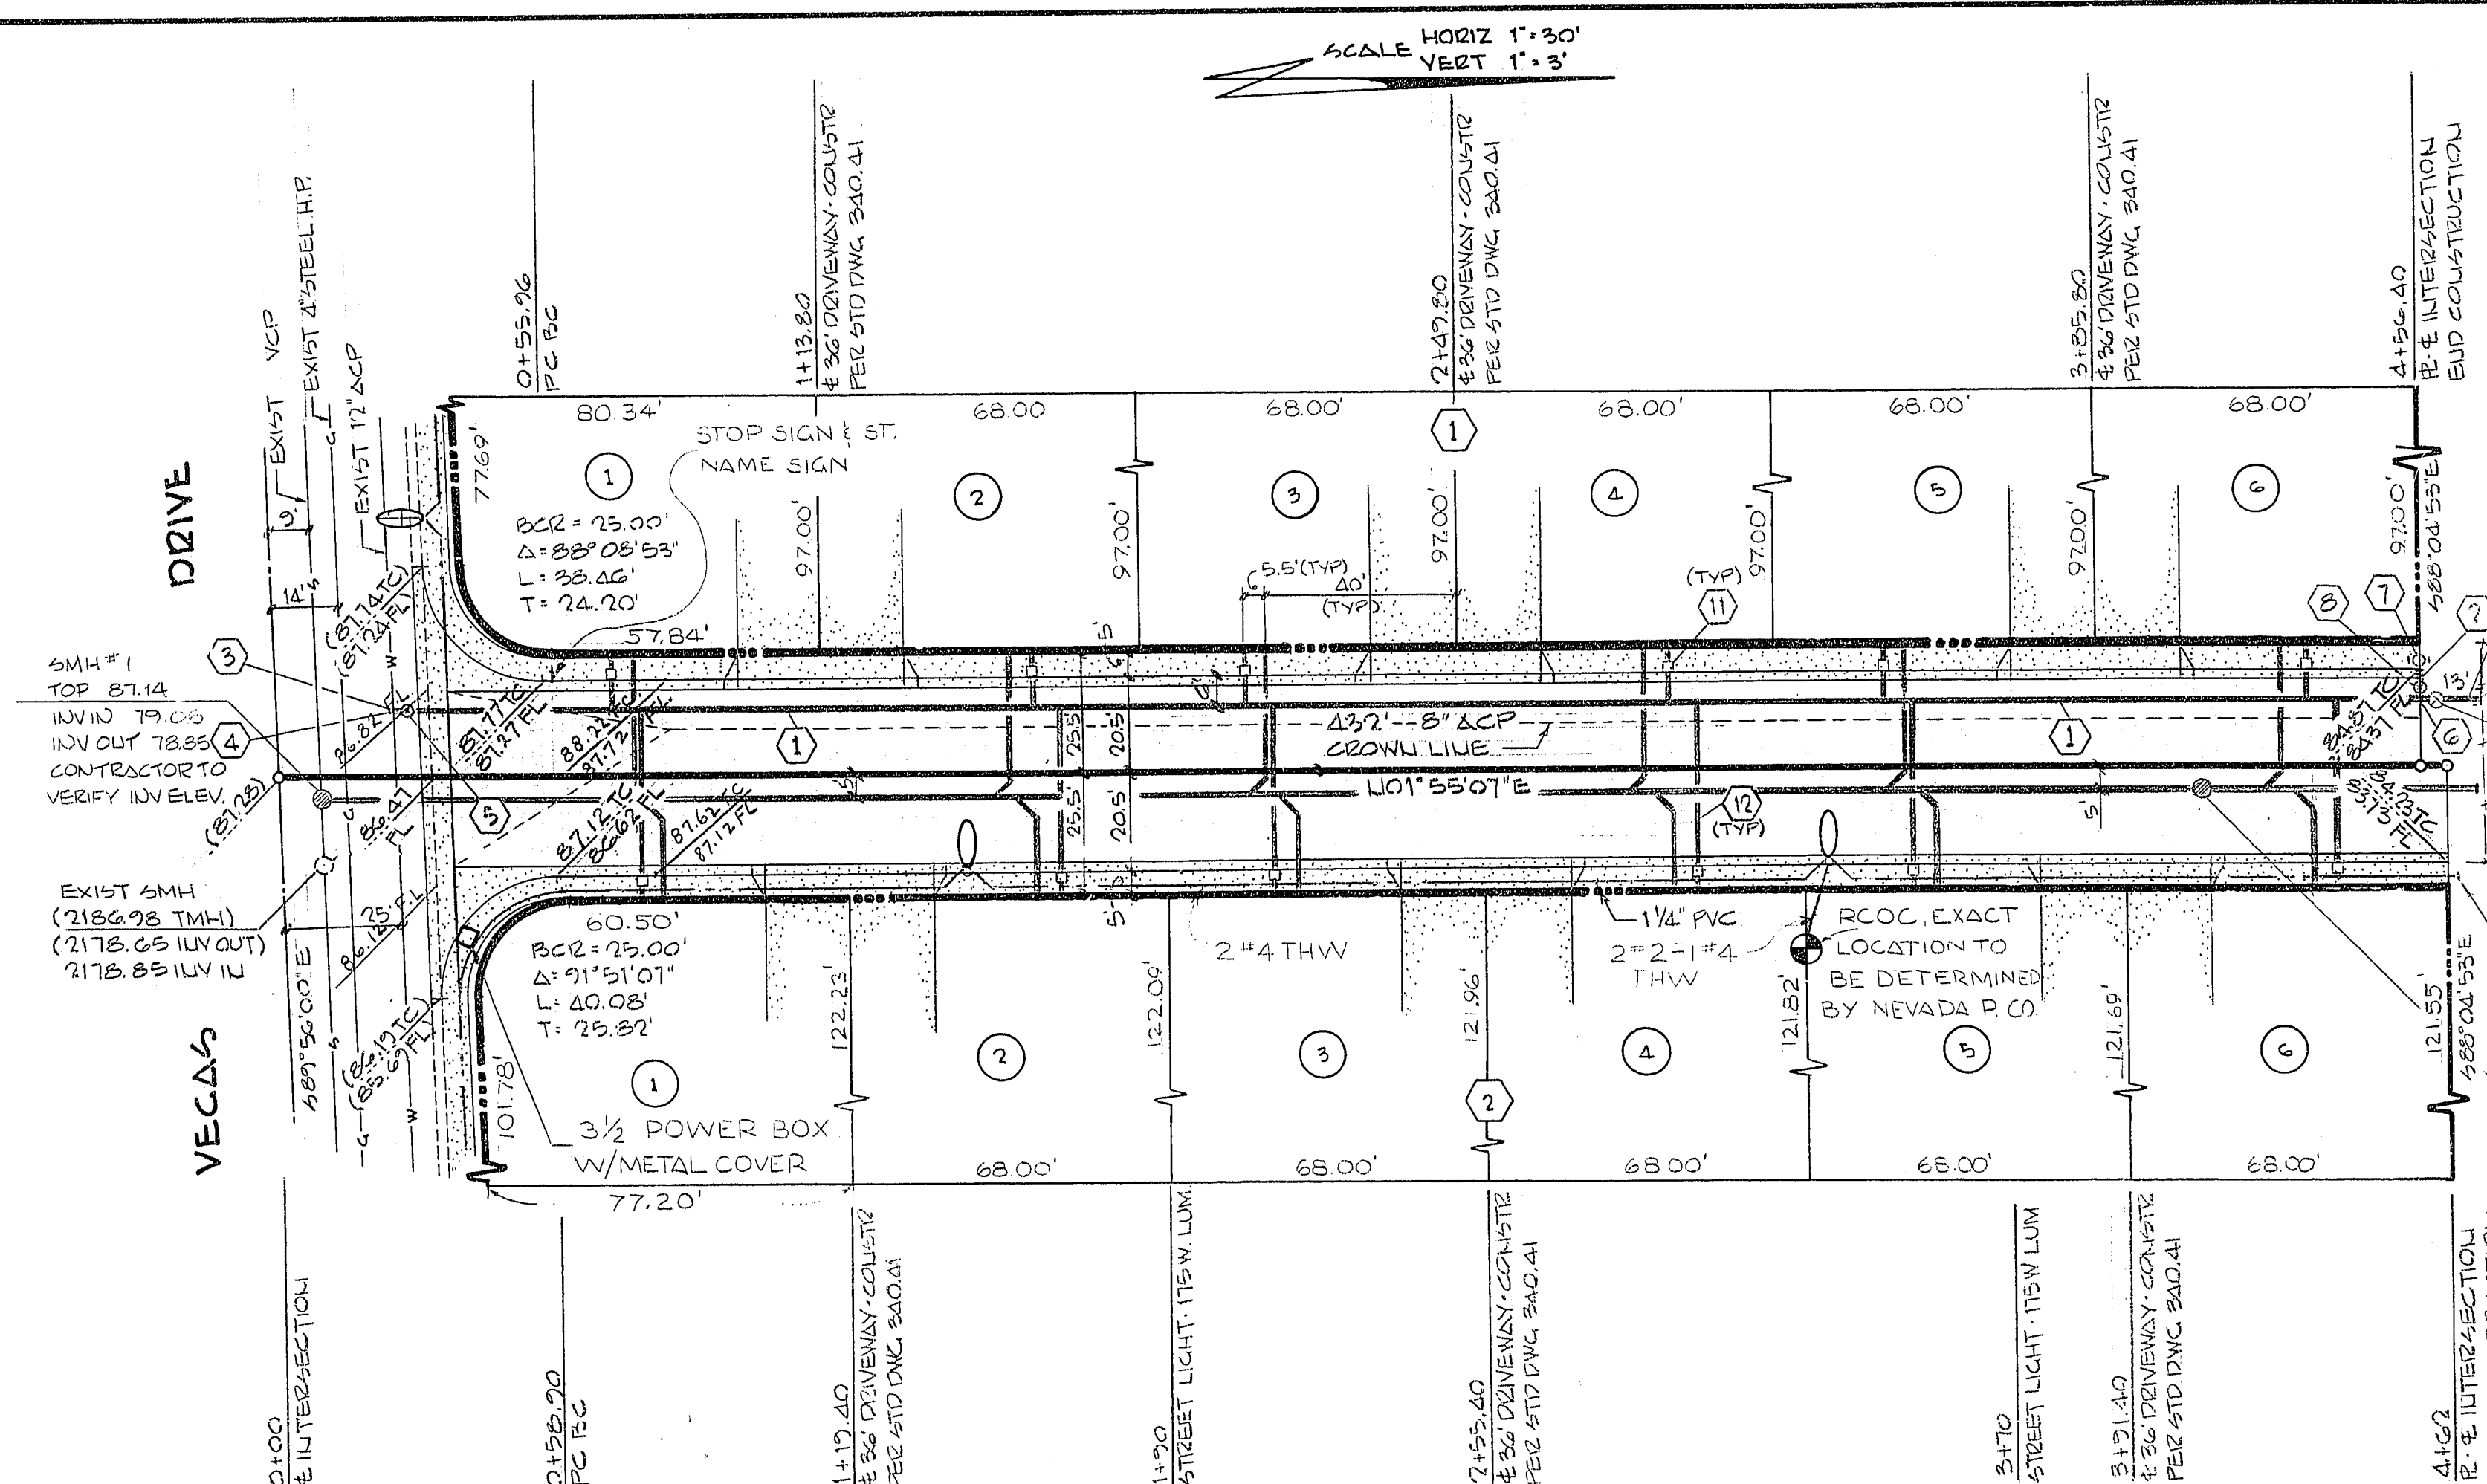


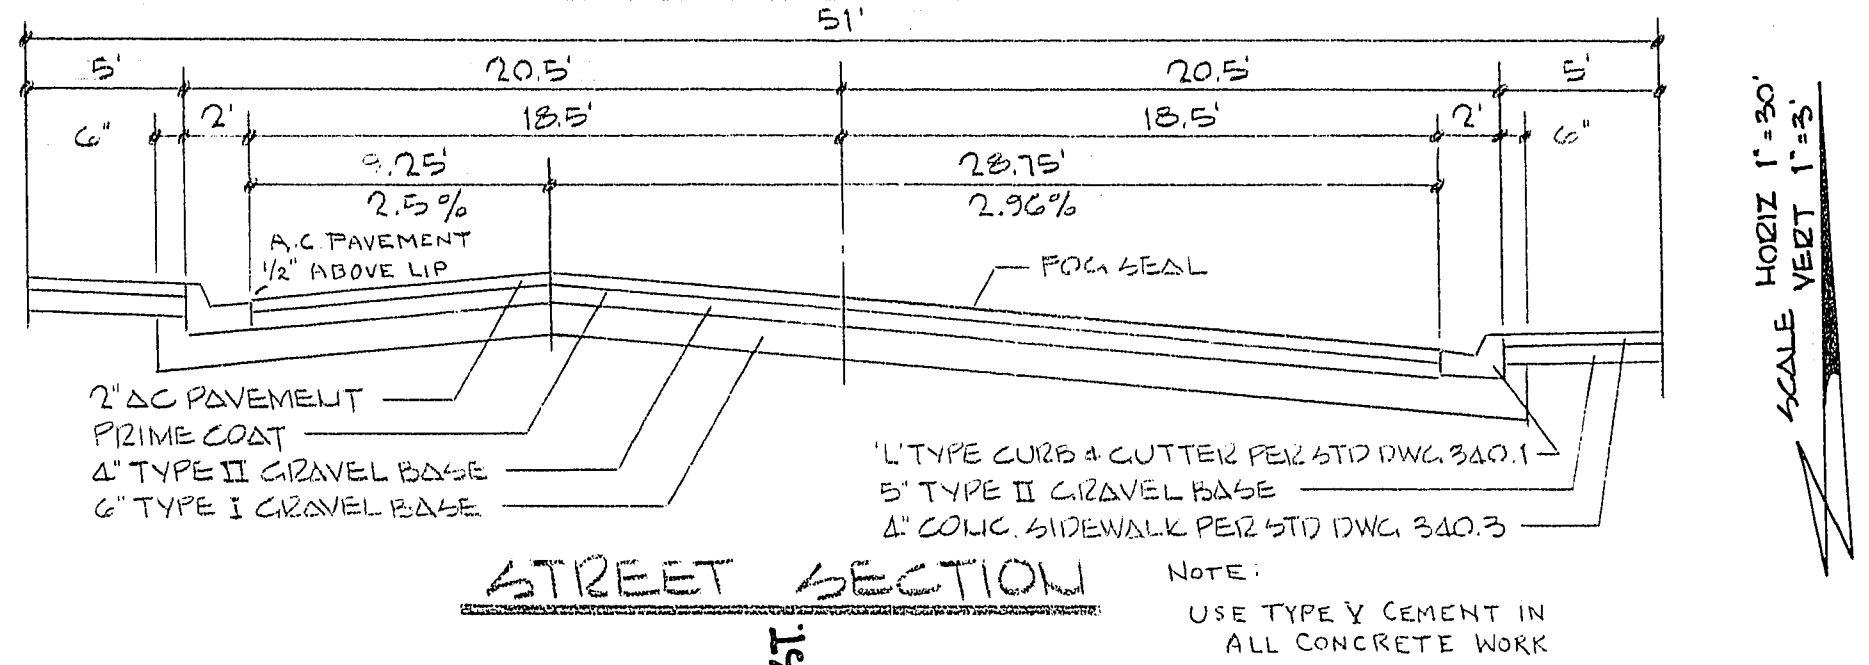


NOTES:
 1. ALL CONSTRUCTION SHALL CONFORM TO THE LATEST REVISED UNIFORM STANDARD SPECIFICATIONS AND DIMENSIONS FOR PUBLIC WORKS CONSTRUCTION FOR CLARK COUNTY AREA, CLARK COUNTY, NEVADA.

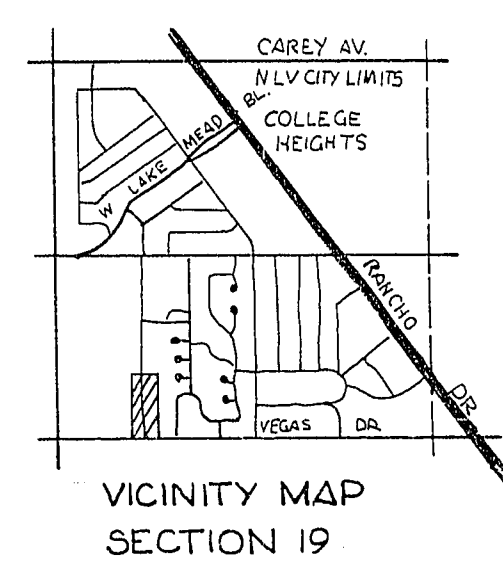

BENCH MARK
 CLV BM #00117 IS LOCATED AT THE NE COR. OF CORRAL LAKE & MAGELLAN DRIVE ELEVATION 7183.74

YELLOW ROSE STREET

VECAS DRIVE

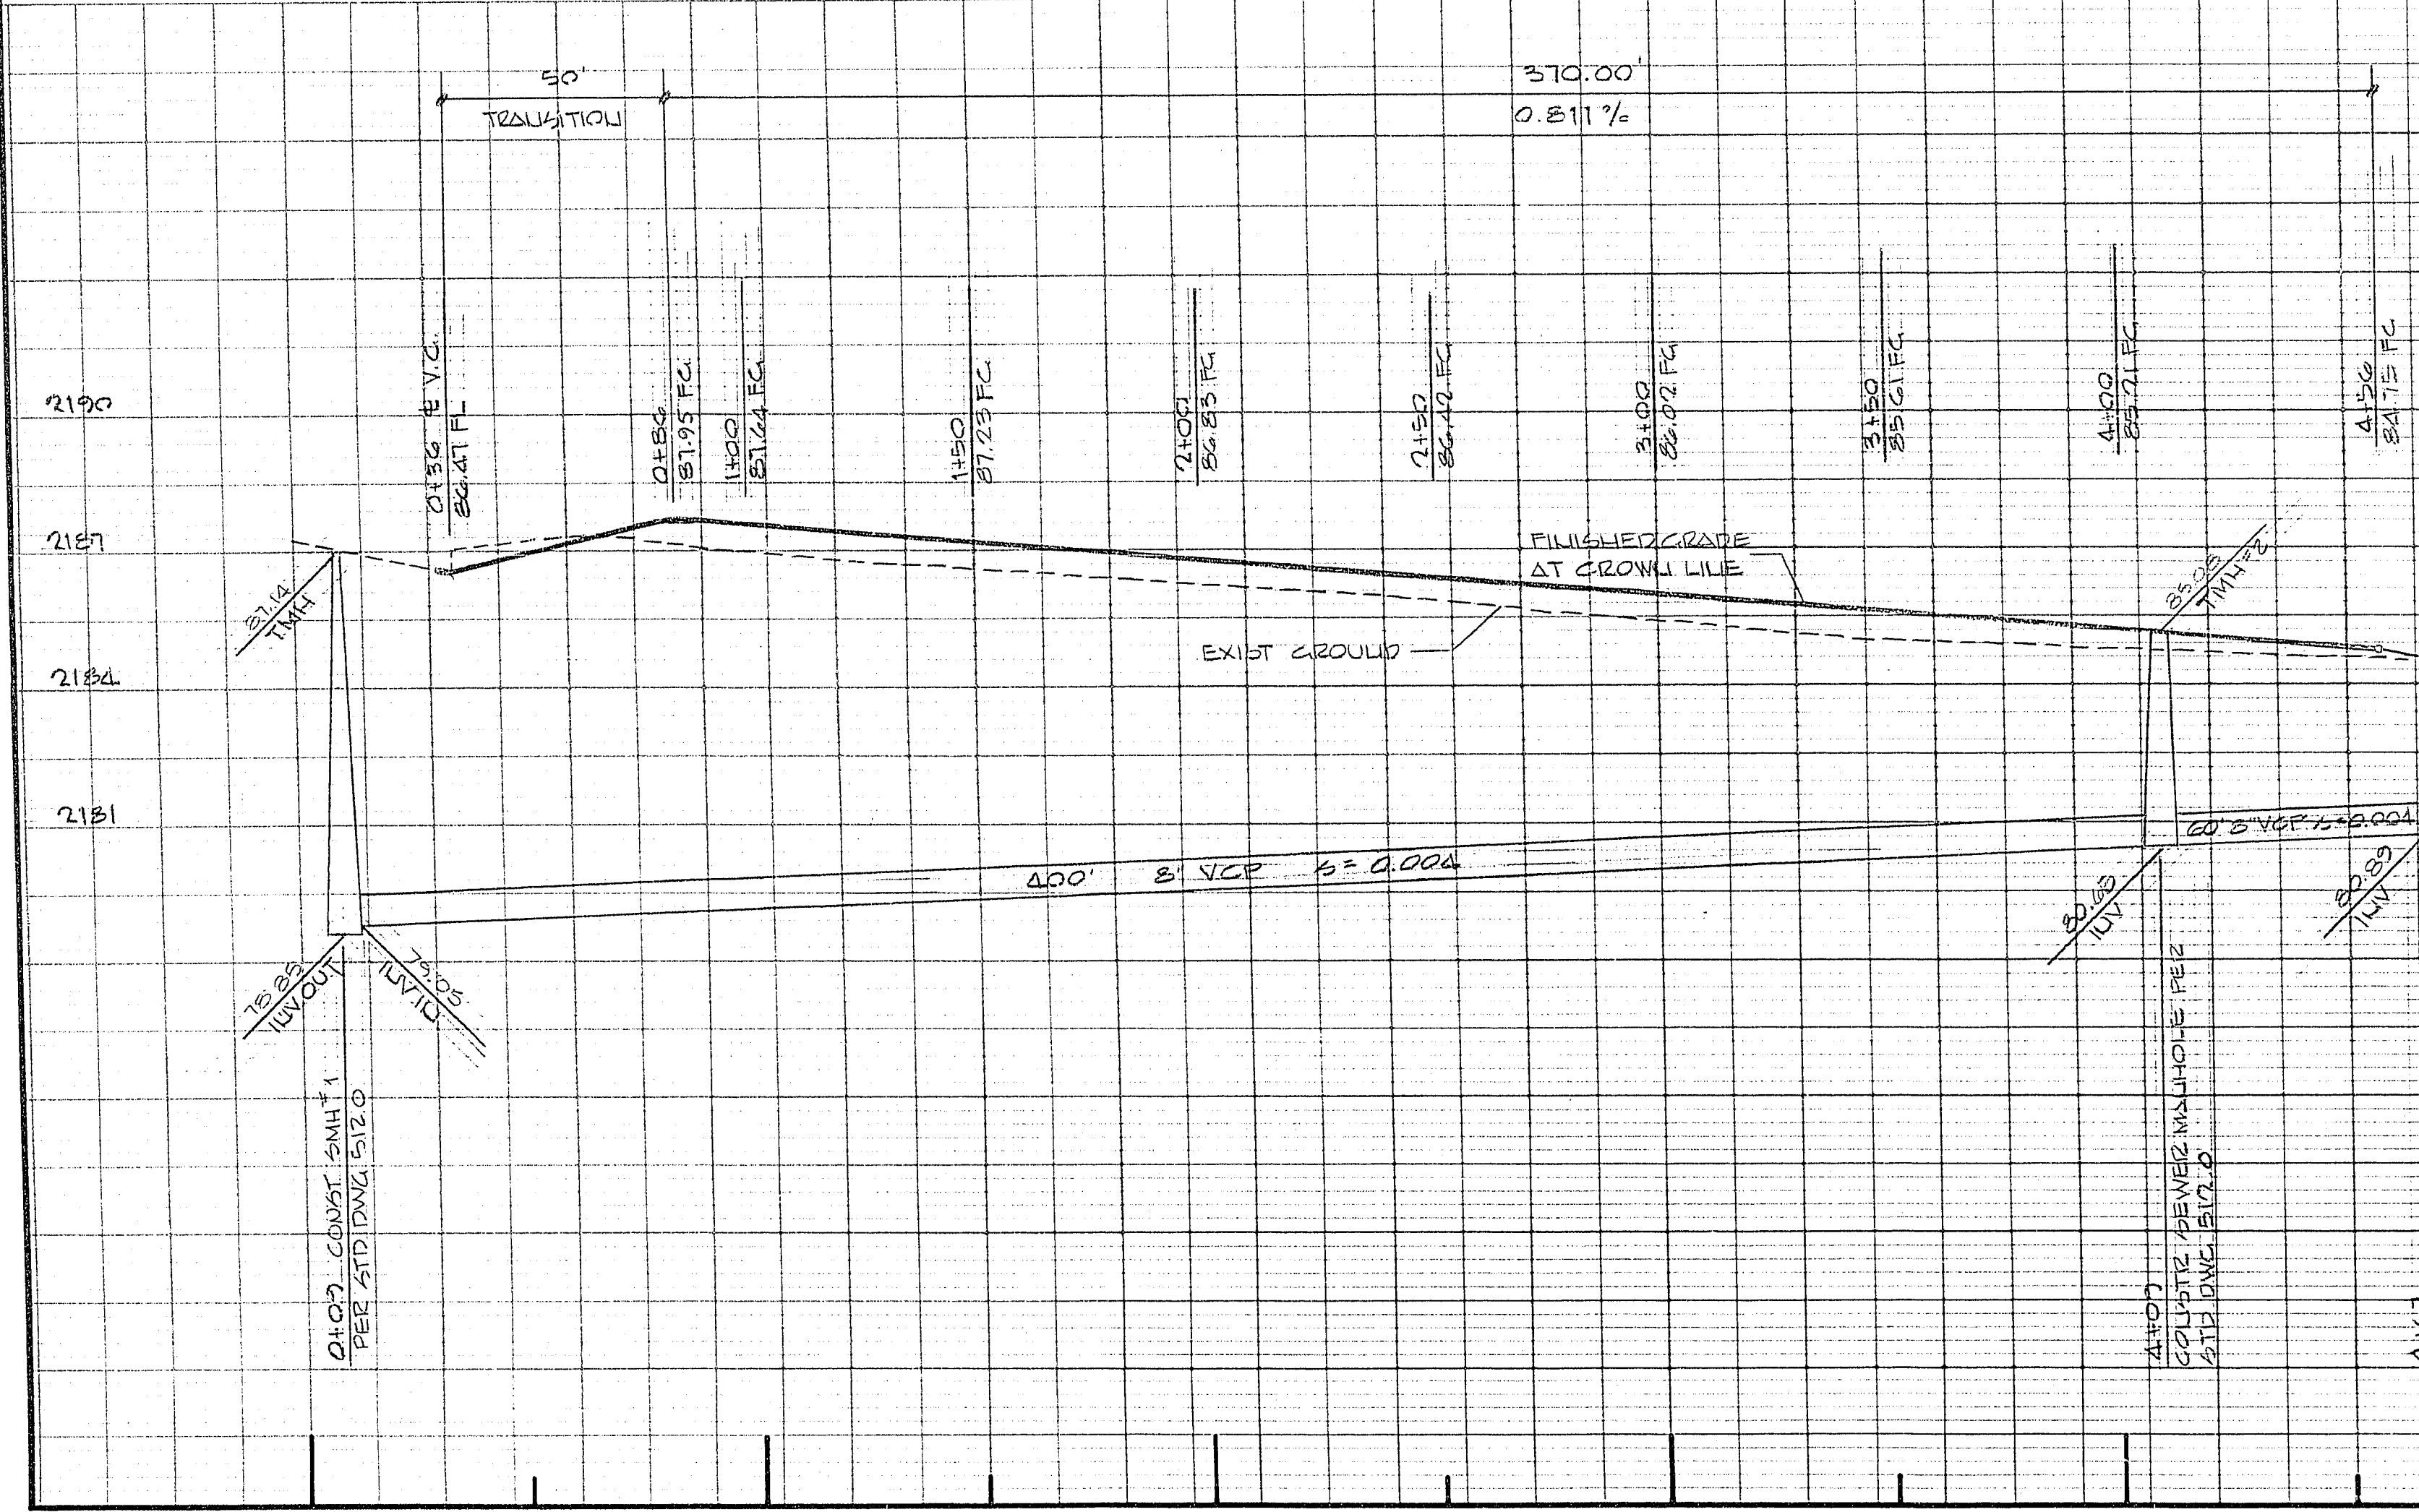

ESTIMATED QUANTITIES (WATER LINE)

1	8" ACP	460 LF
2	6" ACP	1 LF
3	WET TAP	1 EA.
4	12" x 12" TAPPING TEE WITH THROST BLOCK	1 EA.
5	8" W/2 TAPPING VALVE W/ VALVE BOX & COVER	1 EA.
6	8" x 8" TEE	1 EA.
7	FIRE HYDRANT	1 EA.
8	6" W/2 GATE VALVE W/ VALVE BOX & COVER	1 EA.
9	8" W/2 GATE VALVE W/ VALVE BOX & COVER	1 EA.
10	8" PLUG WITH THROST BLOCK	1 EA.
11	3/4" WATER METER BY LNWWD	12 EA.
12	3/4" WATER SERVICE LINE	310 LF.
13	3/4" WATER SERVICE CONNECTION	12 EA.

WATER LINE NOTES:

- All work to conform to Las Vegas Valley Water District standard plates.
 - All work, except as modified hereon or by Note No. 1 shall be done in accordance with the most current draft or edition of Uniform Standard Specifications for Public Works Construction Offsite Improvements Clark County 2008.
 - Notice to be given Engineering Department of the Las Vegas Valley Water District 48 hours prior to actual construction.
 - Service saddles or tapped collars will be required on all services, double tap collars are not permitted.
 - All lines to be pressure tested to 200 psi.
 - All valve boxes shall have separate collars at surface of paved areas.
 - Deflection angle shall not exceed 5 degrees per 13 foot section of pipe for pipe sizes smaller than 10 inches and shall not exceed 3 degrees for pipe sizes 10 inches and larger.
 - All meters shall be located outside of driveways.
- NOTE: CONCRETE COLLARS TO BE CONSTRUCTED AROUND MAN HOLES AND WATER VALVE BOXES AT SURFACE OF PAVED AREAS.
- THE SEWER & WATER LINE SHALL BE BACKFILLED TO RELATIVE 95% COMPACTION WITH NATIVE MATERIALS.

APPROVALS

<i>[Signature]</i>	DATE
<i>[Signature]</i>	DATE
<i>[Signature]</i>	DATE
<i>[Signature]</i>	DATE
<i>[Signature]</i>	DATE
<i>[Signature]</i>	DATE
<i>[Signature]</i>	DATE
<i>[Signature]</i>	DATE
<i>[Signature]</i>	DATE
<i>[Signature]</i>	DATE

ESTIMATED QUANTITIES (SEWER LINE)

8" VCP	460 LF
4" VCP	310 LF
SEWER MANHOLE	1 EA.

PREPARED FOR: PARCHESTER ESTATES, LLC
 MR. B.V. PROVELTALIO

DATE: 10/15/17
DESIGN: BAUGHMAN, HAUGHT & TURNER
DRAWN: J.W.B.
CHECK: R.J.B.
SCALE: AS SHOWN

PROJECT: STREET LIGHT DESIGN
 VECAS DRIVE & YELLOW ROSE ST.
 SECTION 19, TOWNSHIP 20 SOUTH, RANGE 01 WEST, MERIDIAN 11 WEST, CLARK COUNTY, NEVADA

PROJ. NO: FB 74 - 9153

7-8-2015

