


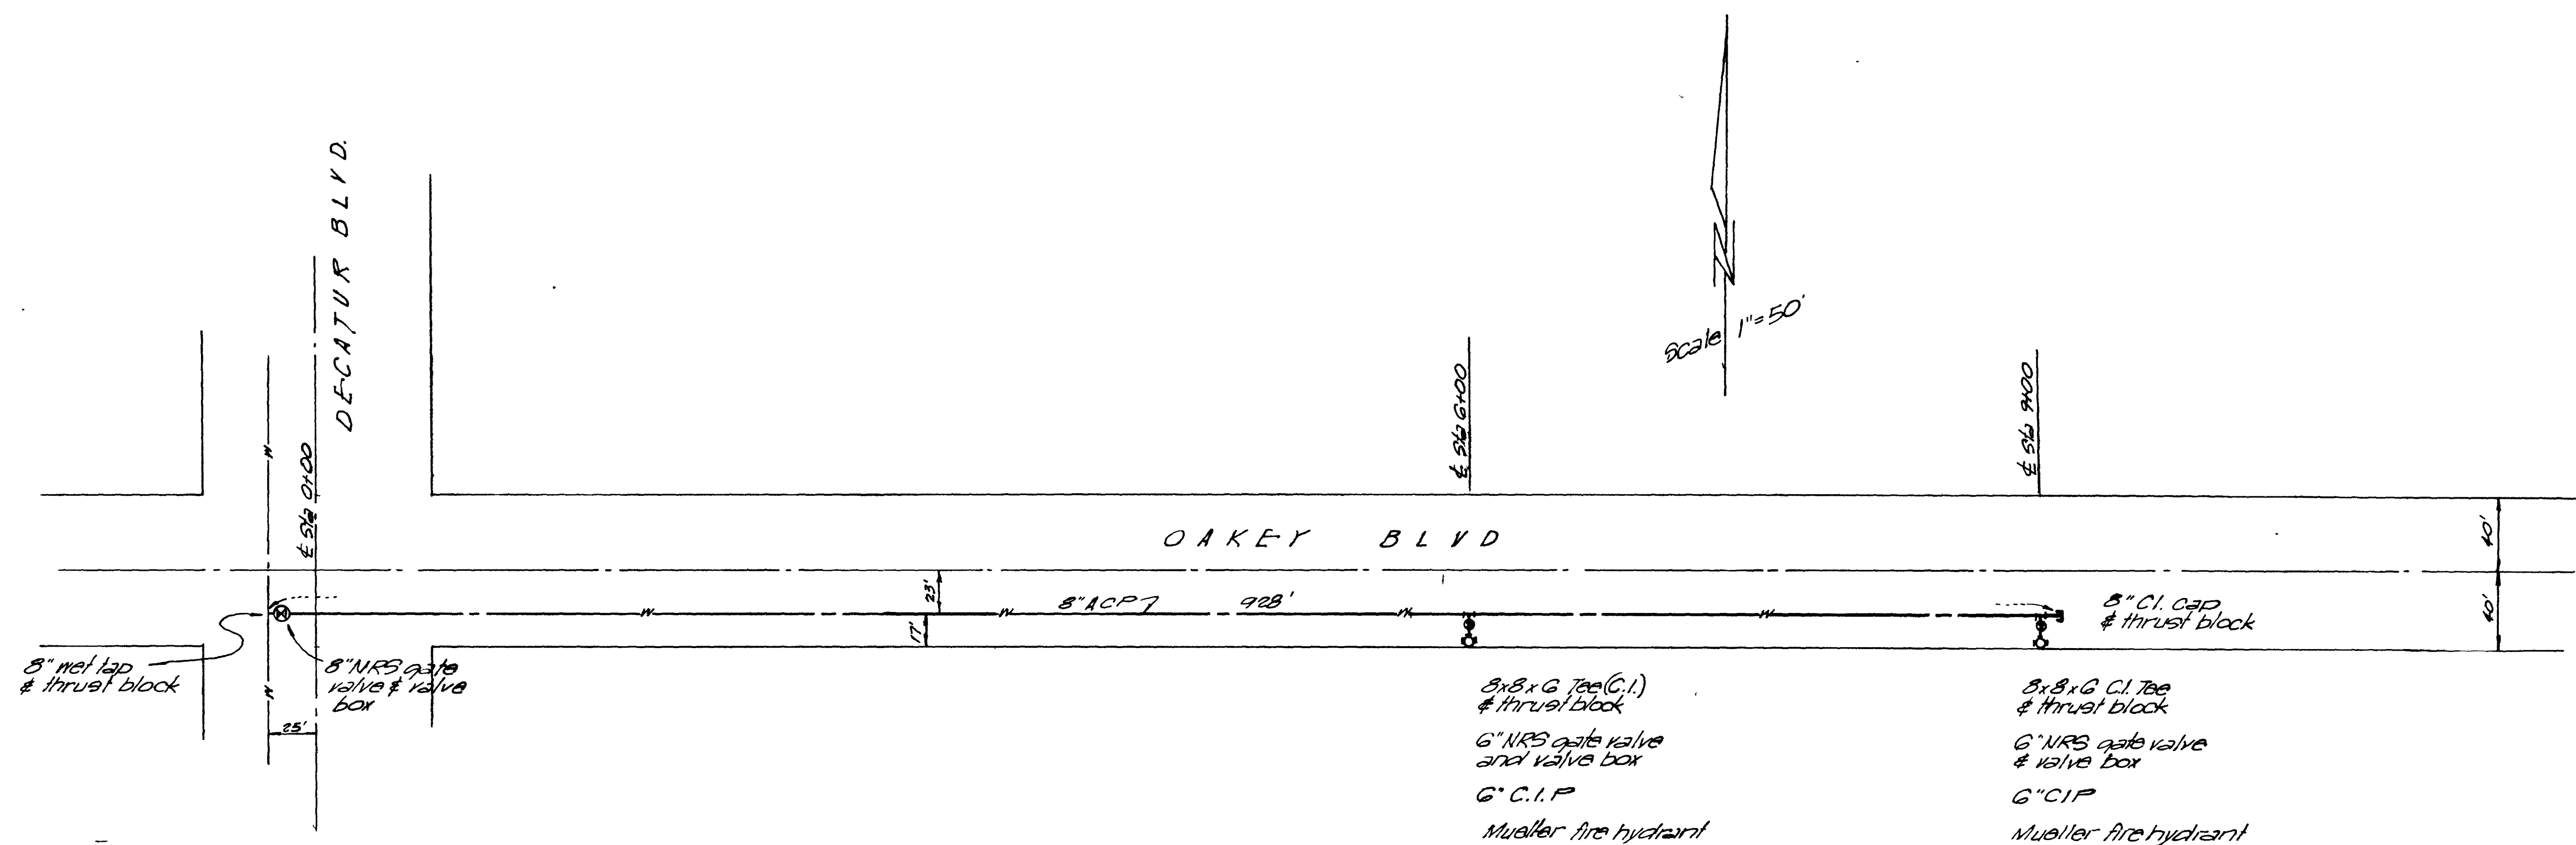


ESTIMATED QUANTITIES

8" NRS Gate valve	1 ea
# valve box	
6" NRS Gate valve	2 ea
# valve box	
Fire hydrants	2 ea
8" net lap	1 ea
8x8x6" CI Tee	2 ea
6" C.I. pipe	17 lin ft
8" AC pipe	928 lin ft
8" C.I. Cap	1 ea

Note: All construction to conform
Uniform Std. Drawings and Specifications
for Off Site Construction Clerk
County Area.

APPROVALS

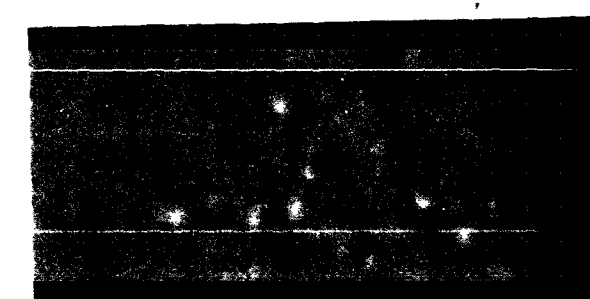

Las Vegas Valley Water District

Las Vegas Fire Chief, 10/17/11 date 10/17/11

VEGAS VILLAGE WEST
OAKLEY BLVD
FIRE LINE

A portion of Section 6
T21S, R61E, MDB#11
Las Vegas, Nevada

4-2.5