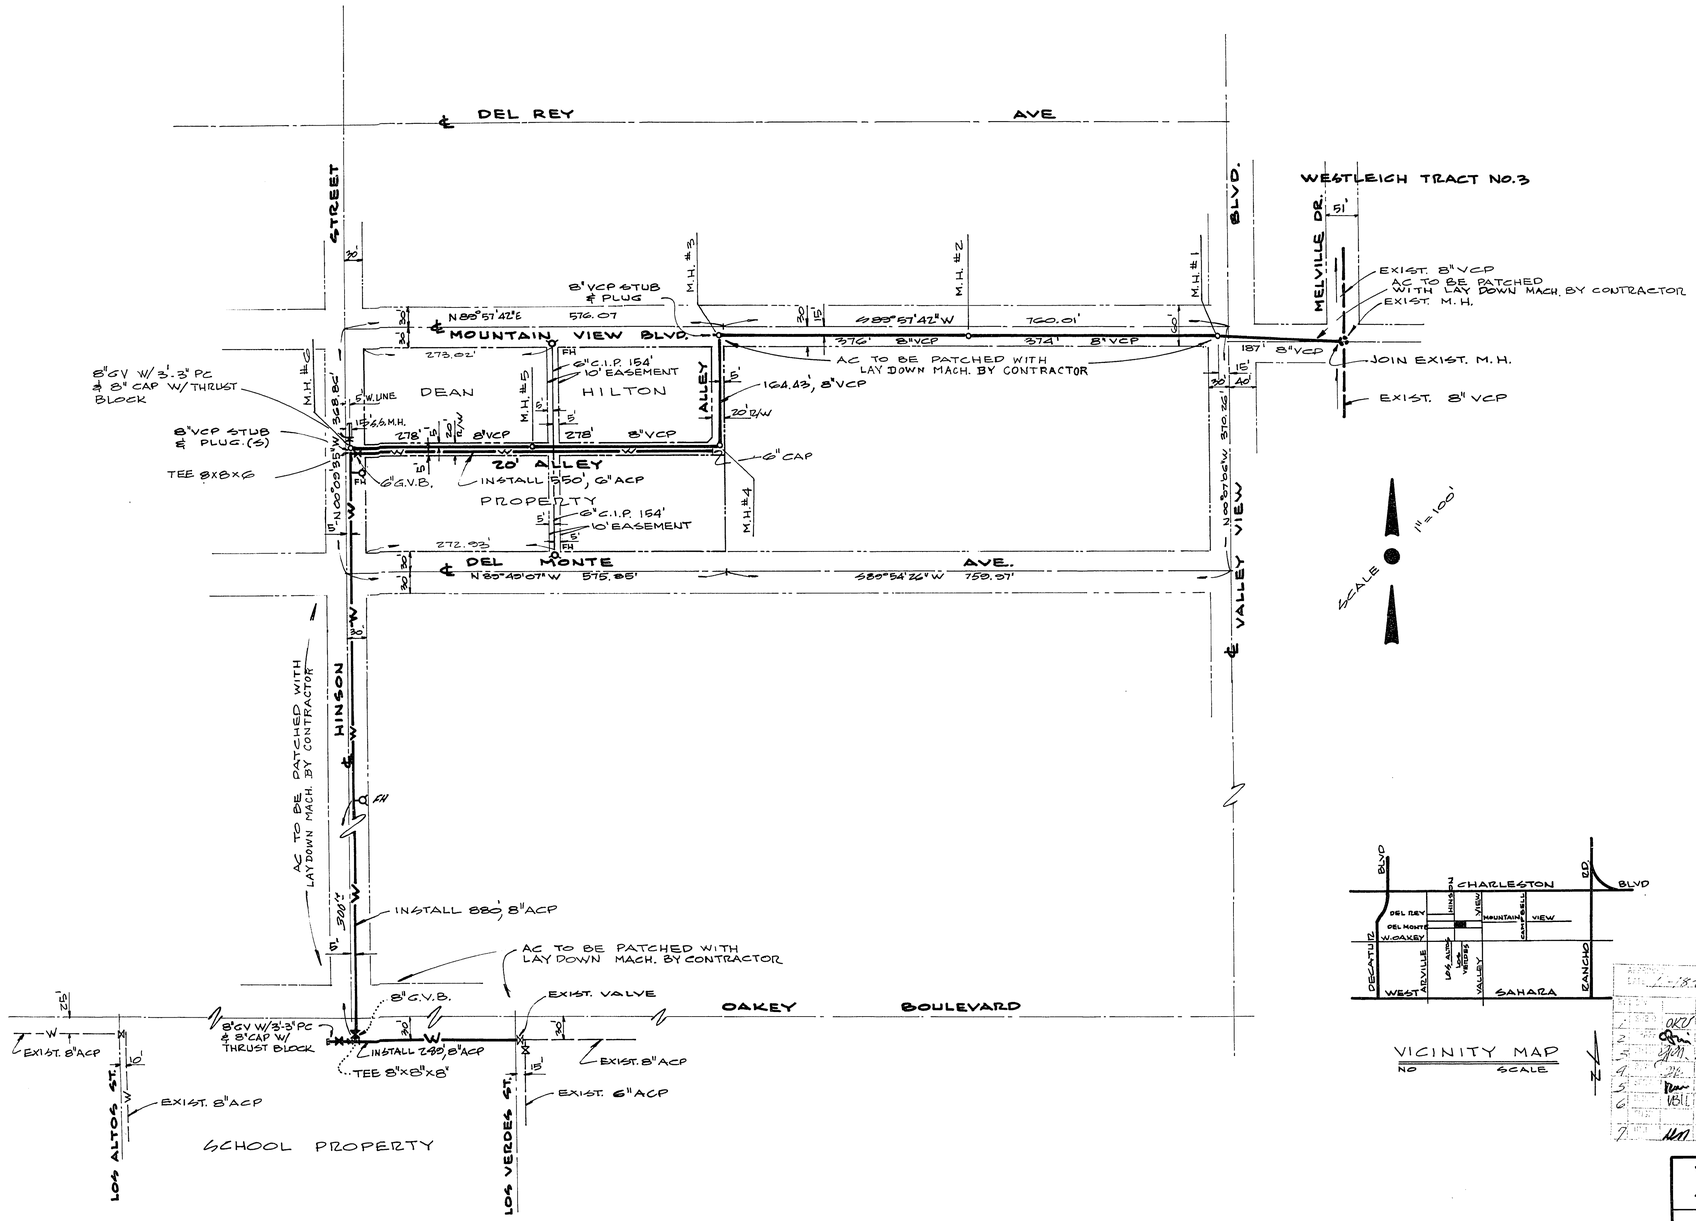

WATER LINE ESTIMATE OF QUANTITIES

8" GATE VALVE IN BOX	3	EA.
6" GATE VALVE IN BOX	1	EA.
8" x 8" x 6" TEE	1	EA.
8" x 8" x 8" TEE	1	EA.
6" PLUG	1	EA.
8" PLUG	2	EA.
6" ACP	1169	LF.
8" ACP	550	LF.
6" CIP	308	LF
FIRE HYDRANT & 6" GATE VALVE IN BOX	4	EA.

NOTE :

1. WATER AND SEWER LINES SEPARATION SHALL BE MIN. 10'
2. SERVICE LINES AND METERS TO BE INSTALLED BY PROPERTY OWNER.
3. MAIN EXTENSION FOR PRIVATE PROPERTY NOT A SUB-DIVISION.

SEWER LINE ESTIMATE OF QUANTITIES

STANDARD MANHOLE	6	EA.
8" VCP	1660	LF.

BENCH MARK

BM # 442 ≮ LV TOP OF CURB @ M.O. SW COR. OAKEY & VALLEY VIEW. EL. 2154.27

VICINITY MAP
NO SCALE

APPROVALS:

LAS VEGAS VALLEY WATER DISTRICT	DATE
CITY OF LAS VEGAS FIRE CHIEF	DATE
NEVADA STATE HEALTH DEPT.	DATE
H. A. Nicholson	11-29-65
CITY OF LAS VEGAS FIELD ENGINEER	DATE
CITY OF LAS VEGAS ENGINEER	DATE
R. A. Anton	1-20-66
SUPT. OF SANITATION	DATE

1		1-18-66
2	OKC	10/26/65
3		11/19/65
4		11/29/65
5		1/18/66
6	VGL	1/20/66
7		1-20

VOORHEIS TRINDLE COMPANY OF NEVADA

953 A EAST SAHARA AVE., SUITE 28-B, LAS VEGAS, NEVADA

A PORTION OF THE NE 1/4 OF SECTION 6, T21S, R61E, M.D.M. NEV.	PREPARED FOR DEAN HILTON
WATER & SEWER PLAN	SCALE 1" = 100' / WO # 538
SUBMITTED BY Victor G. Krametbauer 9/29/65 VICTOR G. KRAMETBAUER R.C.E. No 1511 DATE	SHEET NO. 2 OF 4

For Alley Design see 108-7187

307-V 379