
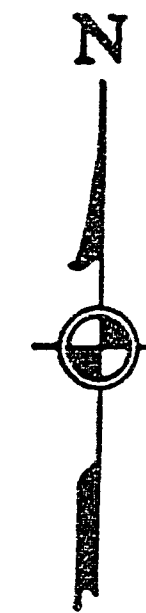


28-202

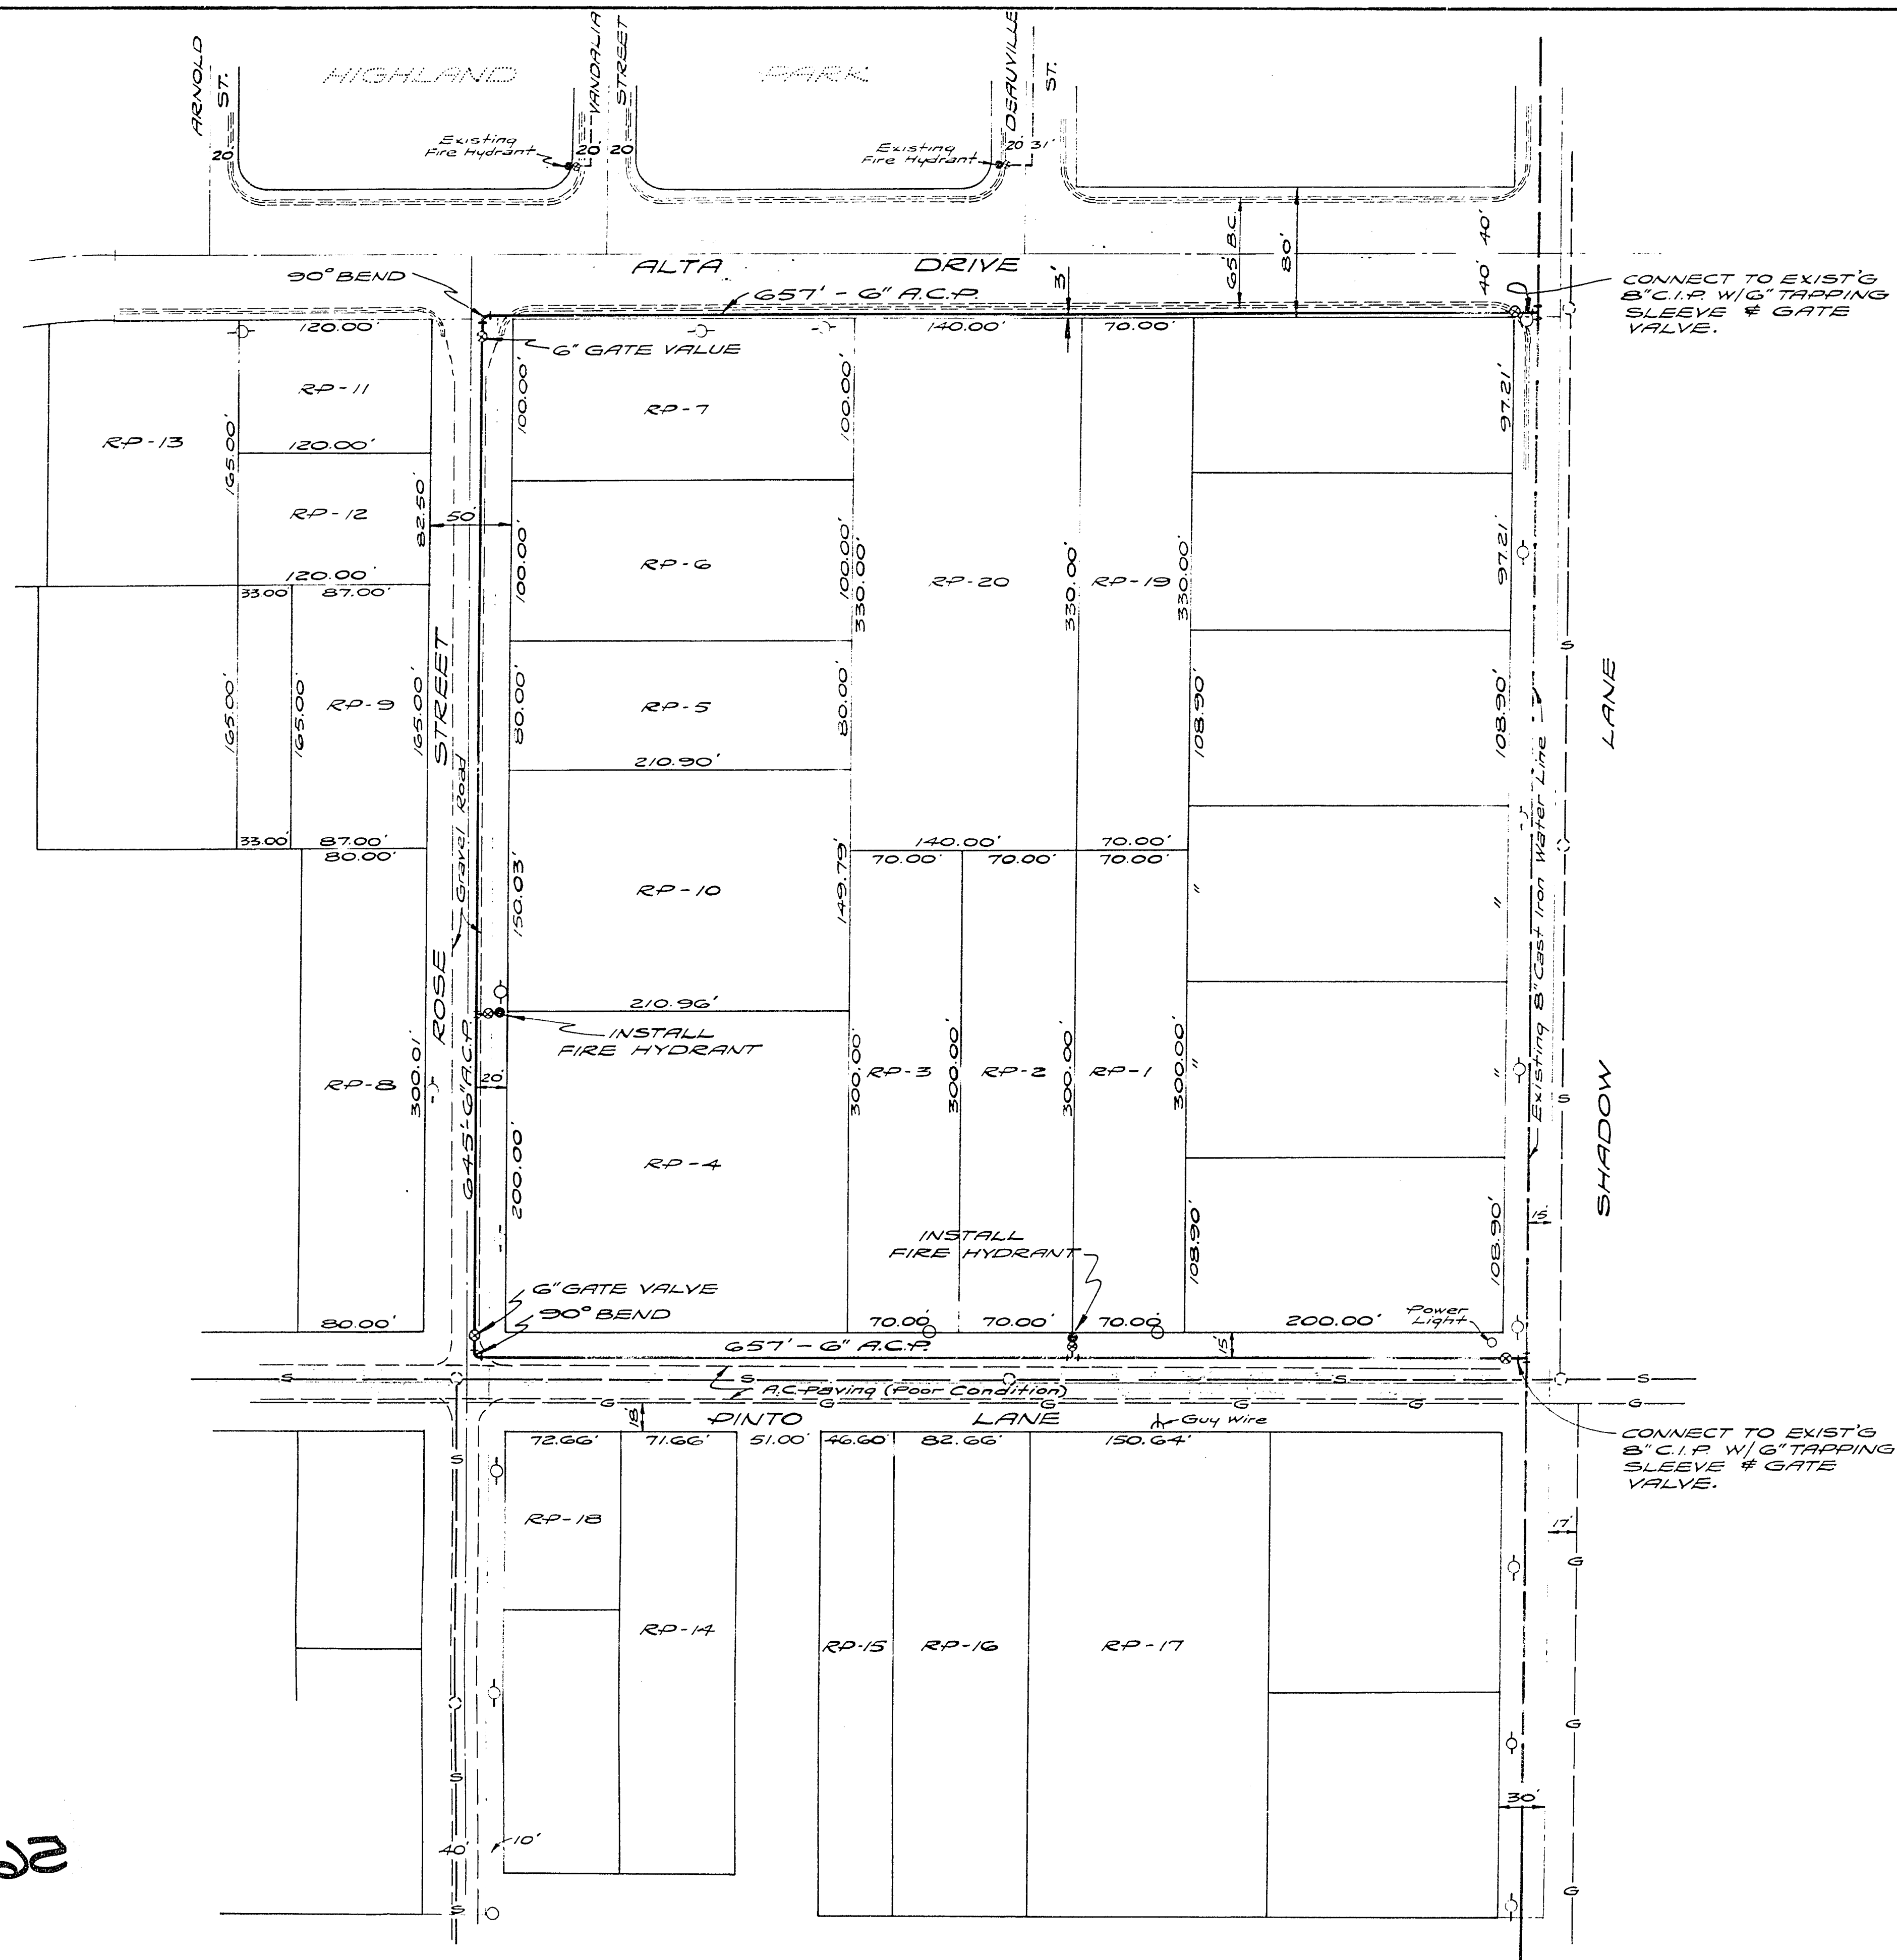

LEGEND	
	Exist'g Water Line
	New Water Line
	Gas Line
	Sewer Line
	Fire Hydrant
	Gate Valve
	Manhole
	Power Pole
	Exist'g A.C. Paving
	Exist'g Curb & Gutter

ESTIMATE OF QUANTITIES	
6" A.C.P.	1959 L.F.
6" Gate Valve	4 Ea.
6" Tapping Sleeve	2 Ea.
90° Bend	2 Ea.
Fire Hydrants	2 Ea.

APPROVALS	
William C. Renshaw, Las Vegas Valley Water District	Date
Las Vegas City Engineer	Date
Las Vegas Fire Department	Date

DRAWN		LAS VEGAS VALLEY WATER DISTRICT ASSESSMENT DISTRICT NO. 4-UNIT NO. 1	ROSE-PINTO	WILLIAM C. RENSHAW CHIEF ENGINEER & GEN. MANAGER			
CHECKED							
APPROVED							
DATE							
REVISIONS		JOB NO. 650303	SHEET NO. 1	OF / SHEETS			
HORIZ. SCALE 1" = 60'							
LAS VEGAS		APPROVED Tevfik Turgin					
LAS VEGAS		11-1-65					
LAS VEGAS		NEVADA					
LAS VEGAS		SEC. 33, T.20S., R.6E.					