


18-202

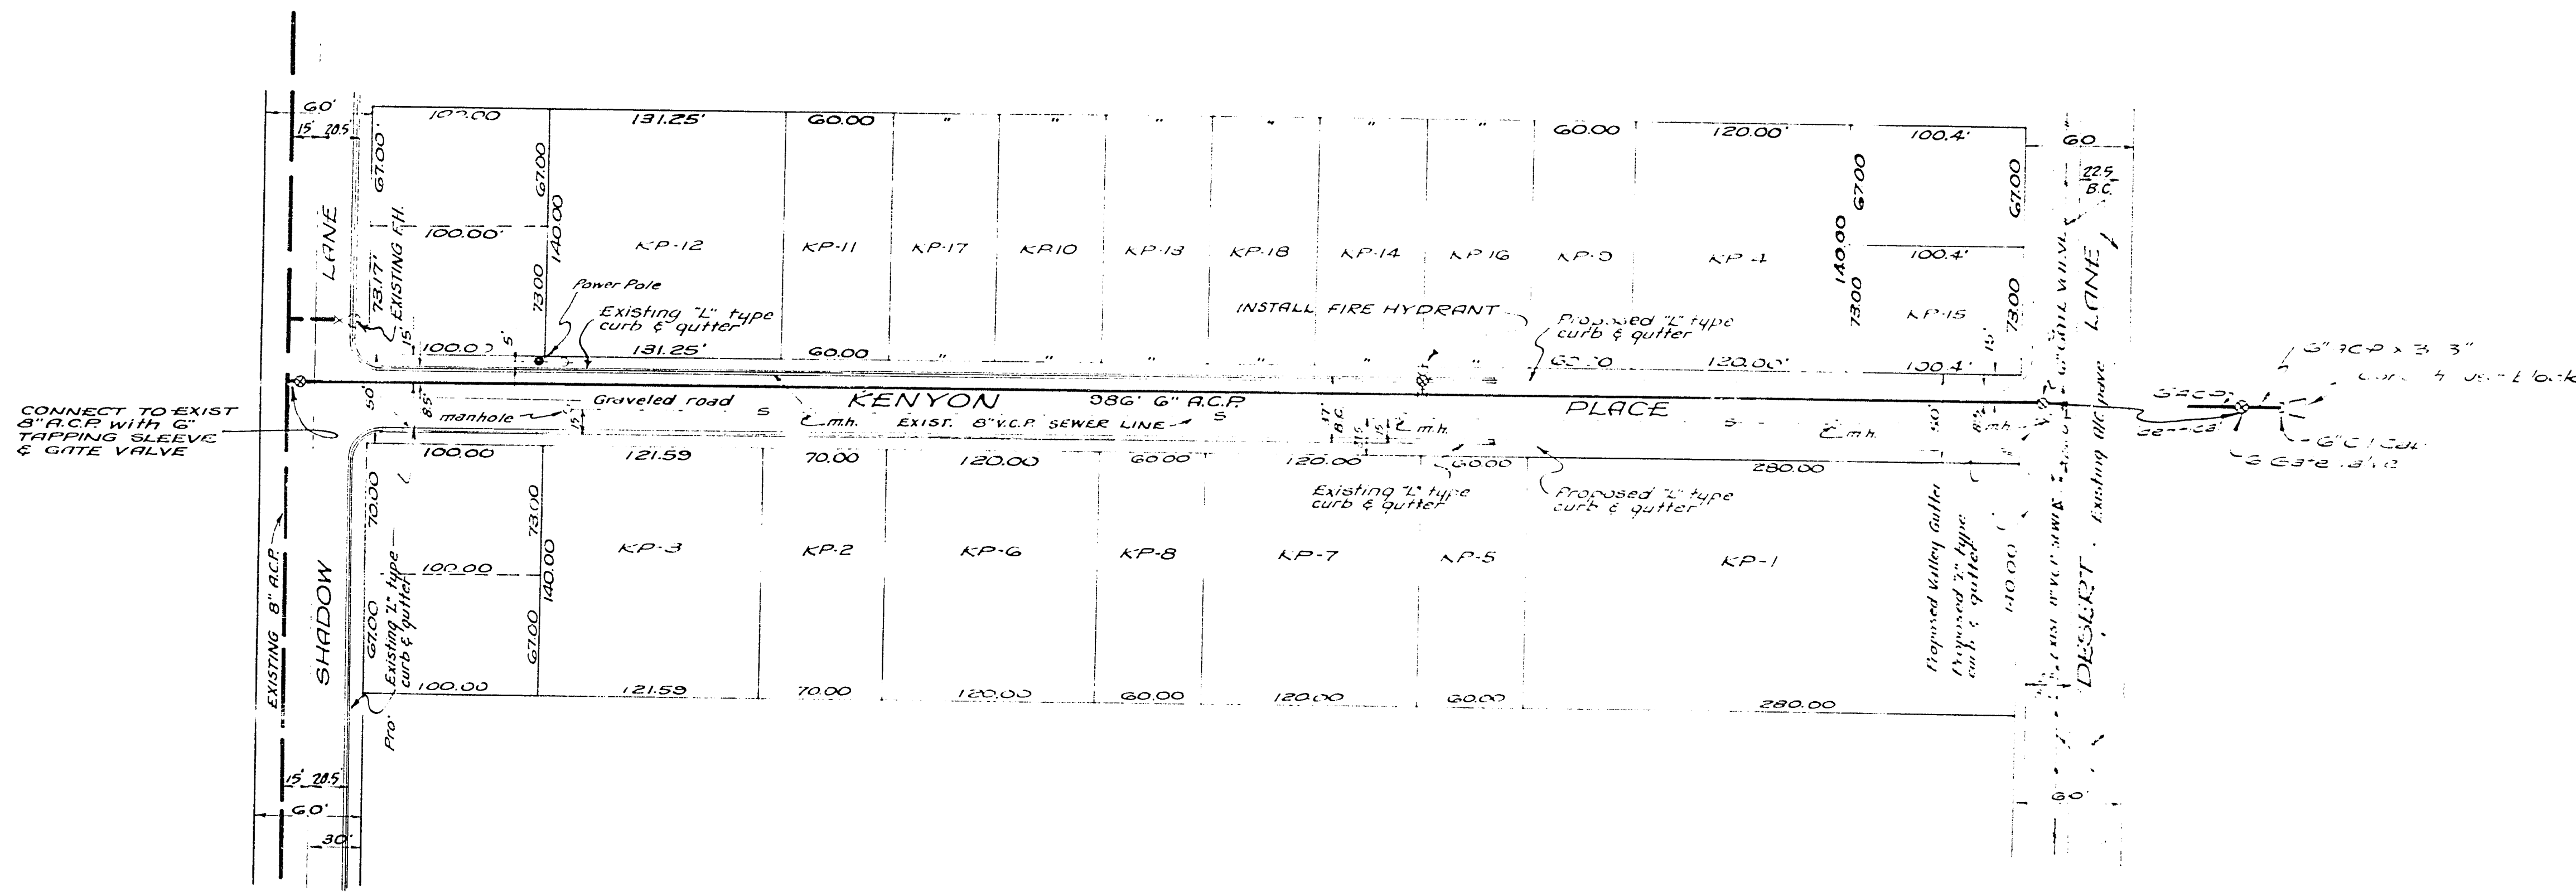

LEGEND

- Existing Water Line
- New Water Line
- Sewer Line
- Power Pole
- Guy Pole & Wire
- Fire Hydrant
- Gate Valve
- Manhole
- Existing A.C. Paving
- Existing Curb & Gutter

ESTIMATE OF QUANTITIES

6" A.C.P.	990 L.F.
3" Gate Valve	2 Ea.
6" Tapping Sleeve	1 Ea.
6" Cast Iron Cap	1 Ea.
2 1/2" Hydrants	1 Ea.

APPROVALS

William C. Renshaw, Las Vegas Water District	Date
Las Vegas City Engineer	Date
Las Vegas Fire Department	Date

DRAWN	CHECKED	APPROVED	DATE
LAS VEGAS VALLEY WATER DISTRICT			
ASSESSMENT DISTRICT NO. 4 UNIT NO. 1			
WILLIAM C. RENSCHAW CHIEF ENGINEER & GEN. MANAGER			
tevfik türegün - consulting engineer		LAS VEGAS NEVADA	
APPROVED		DATE 11-1-65	
Tevfik Türegün			
HORIZ. SCALE: 1" = 60'			
JOB NO. 650303			
SHEET NO. 1			
OF 1 SHEETS			