


CAUTION:
 WATER PRESSURE WILL EXCEED 100 PSI.
 ALL BUILDINGS SHOULD BE PROTECTED
 WITH A PRESSURE REDUCING DEVICE PER
 THE UNIFORM PLUMBING CODE
 (SECTION 1007.1.2)

Handwritten note: R.I.O.B. 1-24-91
 L.V.F.O.

ESTIMATED QUANTITIES

① 10" PVC WATER LINE	2,900 LF	⑭ 10" x 6" FRCT W/VAULT & COVER	1 EA	⑳ 10" x 6" REDUCER	2 EA
② 8" PVC WATER LINE	470 LF	⑮ 10" x 10" x 8" TEE	3 EA	㉑ 2" SERVICE COLLECTION	5 EA
③ 6" PVC WATER LINE	715 LF	⑯ 10" x 10" x 6" TEE	7 EA	㉒ 2" LIPS GATE VALVE W/VALVE BOX & COVER	6 EA
④ WET TAP	4 EA	⑰ 8" x 6" REDUCER	3 EA	㉓ 2" SERVICE LINE (PE)	265 LF
⑤ 12" x 12" x 10" TAPPING TEE	2 EA	⑱ 8" 90° ELBOW	2 EA	㉔ 6" 90° ELBOW	1 EA
⑥ 10" LIPS TAPPING VALVE W/VALVE BOX & COVER	2 EA	㉒ 8" LIPS GATE VALVE W/VALVE BOX & COVER	2 EA	㉕ 10" C.I. PIPE WATER LINE	120 LF
⑦		㉓ 6" x 6" x 6" TAPPING TEE	3 EA	㉖ 6" x 6" x 6" TAPPING TEE	1 EA
⑧		㉔ 10" 90° ELBOW	3 EA	㉗ 6" PLUG W/THRUST BLOCK	1 EA
⑨ 12" x 12" x 6" TAPPING TEE	1 EA	㉕ 10" 90° ELBOW	3 EA	㉘ 1" SERVICE LINE (PE)	35 LF
⑩ 6" LIPS TAPPING VALVE W/VALVE BOX & COVER	2 EA	㉖ FIRE HYDRANT	7 EA	㉙ 15" PVC SLEEVE	120 LF
⑪ 10" x 10" x 10" TEE	1 EA				
⑫ 10" LIPS GATE VALVE W/VALVE BOX & COVER	3 EA				
⑬ 10" PLUG W/THRUST BLOCK	1 EA				

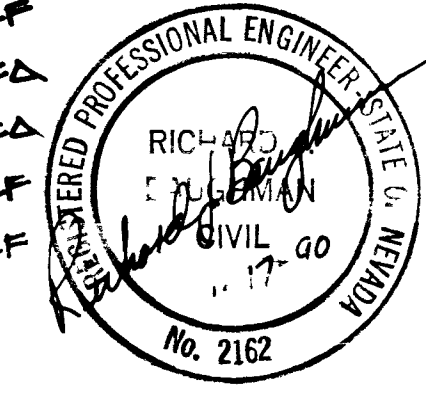

APPROVED: [Signature]
 DATE: 1/24/91
 REVISIONS: [Table]
 PREPARED FOR: SES BECK ASSOC.
 DATE: JAN 19, 1990
 DESIGN: DANVA
 DRAWN: DANVA
 CHECK: DANVA
 SCALE: 1" = 40'
 BAUGHMAN & TURNER
 CIVIL ENGINEERS
 MINING ENGINEERS
 LAND SURVEYORS
 LAS VEGAS, NEVADA
 3335 WEST CHARLESTON BOULEVARD
 702-870-8771
 WESTLAID FAIR, PHASE I
 SHEET 10 OF 12
 PROJECT NO. 567Y-4083-1

